

## KEY NOTES BY SYMBOL 'O'


- 1) MAINTAIN 10'-0" BETWEEN OUTSIDE AIR INTAKES AND ALL EXHAUST SOURCES (PLUMBING VENTS, EXHAUST FANS, COMBUSTION EXHAUST, ETC.). MECHANICAL CONTRACTOR SHALL PROVIDE OFFSETS AS NEEDED TO ENSURE EXHAUST FANS ARE 10'-0" AWAY FROM NEIGHBORING TENANT'S FRESH AIR INTAKES. PROVIDE OFFSETS AND ADJUST/RELOCATE EQUIPMENT AS NEEDED.
- 2) ROUTE 12" EXHAUST DUCT UP THROUGH ROOF. TERMINATE WITH MANUFACTURER'S ROOF CAP, WITH BIRD-SCREEN AT 24" ABOVE ROOF SURFACE. CAP AND COLLAR ROOF PENETRATION. PROVIDE WITH BACK DRAFT DAMPER. THERE WILL BE NO SERVICEABLE EQUIPMENT ON ROOF.
- 3) ROOF ACCESS POINT. COORDINATE ROOF ACCESS WITH LANDLORD.
- 4) IF PARAPET IS LESS THAN 42" TALL, ENSURE SERVICEABLE EQUIPMENT IS PLACED A MINIMUM 10'-0" FROM BUILDING EDGE.
- 5) 4" INSULATED DRYER VENT LINE ROUTED AS SHOWN TO EXTERIOR WALL, TERMINATE WITH DRYER VENT CAP. FURROUT WALL IF NECESSARY TO KEEP VENT WITHIN WALL.
- 6) EX. ROOFTOP UNIT, REFER TO EQUIPMENT SCHEDULE SHEET M1. PROVIDE FLEXIBLE CONNECTORS FOR THE SUPPLY AND RETURN AIR DUCT CONNECTIONS. TRANSITION TO DUCT SIZES SHOWN PROVIDE CANT STRIPS, FLASHING, AND WEATHER PROOFING AROUND RTU.
- 7) REROUTE EXISTING CONDENSATE LINE TO NEW MOP SINK. TERMINATE ABOVE RIM LINE OF SINK.
- 8) PROVIDE 7-DAY PROGRAMMABLE THERMOSTAT, HONEYWELL VISION PRO 8000, AND AUTO CHANGEOVER AND RELATED WIRING TO CONTROL EACH UNIT. MOUNT T-STAT AT 48" AFF, SENSOR AT 96" AFF.

HVAC DUCT DROP LOCATIONS, MIXING BOX CONFIGURATIONS (ON SPLIT SYSTEMS), RETURN AIR CONFIGURATIONS, ECONOMIZER CONFIGURATIONS, ETC. WILL VARY DEPENDING ON FIELD CONDITIONS, JOISTS, BEAMS, SPRINKLER PIPING, ETC. IT IS EXPECTED THAT THE MECHANICAL CONTRACTOR WILL MAKE MINOR ADJUSTMENTS TO BEST SUIT FIELD CONDITIONS.

ALL SUPPLY DUCTWORK SHALL BE INTERNALLY INSULATED, DOUBLE-WALL METAL "SPIRAL" DUCT MAINS. SUPPLY BRANCHES SHALL BE RIGID METAL AND INTERNALLY INSULATED. SUPPLY REGISTERS AND TAPS SHALL BE INTERNALLY INSULATED WITH THERMAL BREAKS TO PREVENT "SWEATING". FLEX DUCT AND DUCT BOARD WILL NOT BE PERMITTED, EXCEPT FOR A 5'-0" OR LESS SEGMENT OF FLEX DUCT TO CONNECT TO DIFFUSERS ABOVE A LAY-IN GRID CEILING, WHICH SHALL BE FULLY CONCEALED FROM VIEW.

## DANVILLE, CA NOTE:

NO GAS WORK WILL BE DONE ON THIS PROJECT. THERE WILL BE NO CHANGES TO GAS PIPING TO THE EX. RTU AND NO NEW GAS EQUIPMENT WILL BE ADDED.

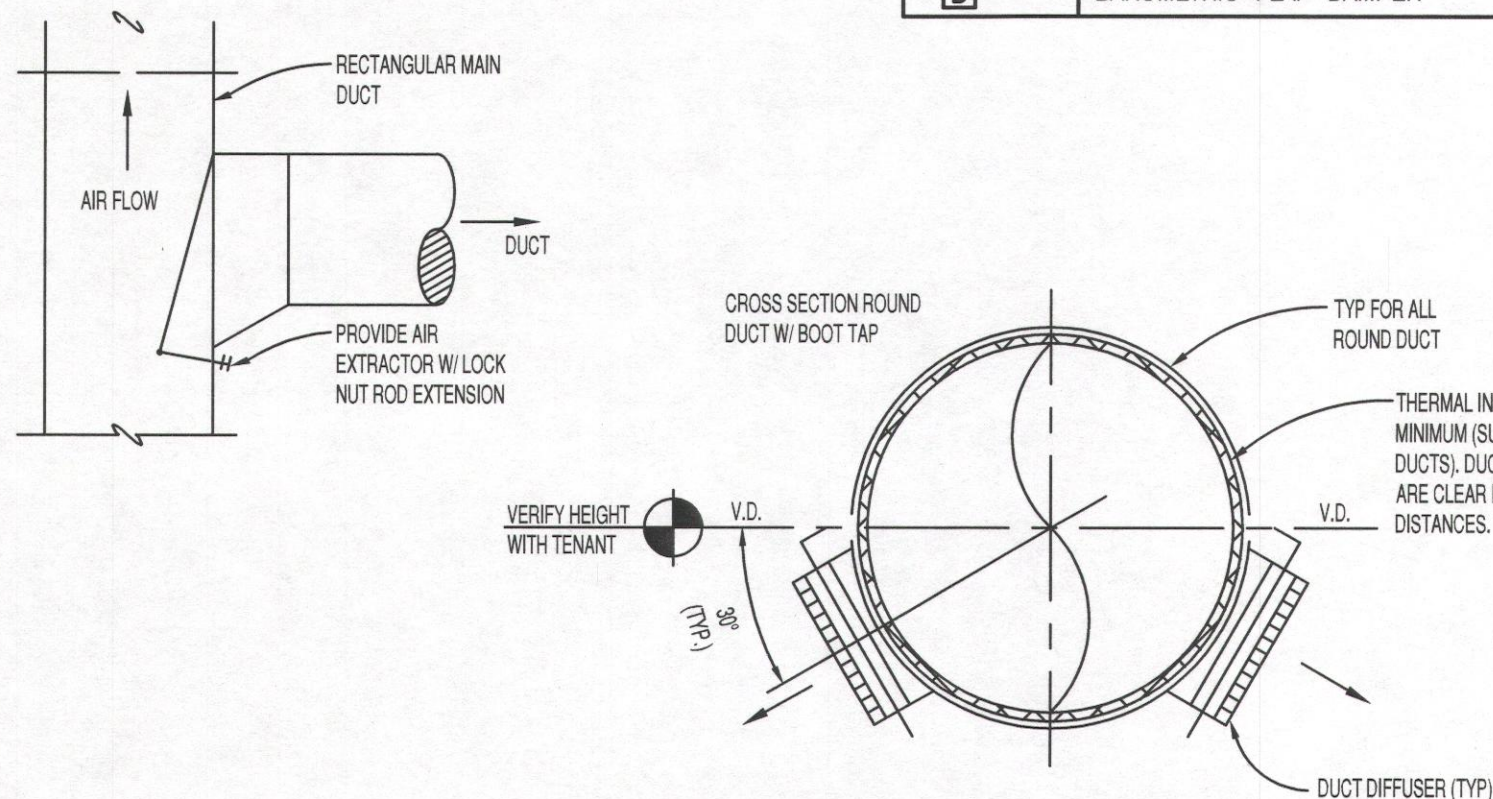03 EXPOSED SPIRAL DUCT DIFFUSER TAP DETAIL  
SCALE: NONE

## EXHAUST FAN SCHEDULE (ROOF)

MARK	MANUFACTURER	MODEL	DRIVE	AIRFLOW (CFM)	EXT. SP (IN W.C.)	V, PH, HZ	MOTOR SIZE (HP)	SERVICE	APPROXIMATE WEIGHT (LBS)	INSTALL LOCATION	NOTES
EF 1	GREENHECK	G-085-VG	DIRECT	400	0.30"	115/1/60	1/10	RR, LOCKERS & SHOWER	25	ROOF	1,2

1. CONTROL TO BE INTERLOCKED WITH EX. RTU-1  
2. PROVIDE WITH 12" ROOF CURB, GRAVITY BACK DRAFT DAMPER, AND BIRD SCREEN

ASHRAE 62.1 Ventilation Comparison (CALIFORNIA)

3/2/2018

Bishops - Danville, CA

Zone Identification													Design Case			
Zone	Occupancy Category	Area (sf)	Table 6-1 People (A1)	Table 6-1 Occupant Density (#/1000 sf)	Expected Density (#/1000 sf)	Zone Population (# persons)	Breathing Zone Outdoor Air Flow (CFM)	From Table 6-2 Zone Air Distribution Effectiveness (Ez)	Zone Outdoor Air Flow (Voz)	Zone Primary Air Flow Fraction (Vpz)	Factor Zp= Voz/Vpz	From Table 6-3 System Ventilation Efficiency (Ev)	Outdoor Air Intake Flow (CFM)	Total Outdoor Airflow provided by HVAC equip. (CFM)	Total Airflow provided by HVAC equip. (CFM)	Design % by which Outside Air Exceeds Standard
Barber Shop	Barber Shop	600	0	0.3	25	15	180.0	0.8	225.0	1	225.0	1	225.0	250	1400	11.1%
Laundry/Restr Laundry/RR		540	0	0.12	2	1.08	64.8	0.8	81.0	1	81.000	1	81.0	150	200	85.2%
Total		1140					16					Total (CFM):	306.0	400	1600	
$V_{bz} = R_p \cdot P_2 + R_s \cdot A_2$																
$V_{pz}$ = Total airflow provided by the HVAC equipment (Outdoor + Recirculated).																
$V_{bz} = V_{bz}/E_z$																
		Laundry Room Required Exhaust					50 CFM	as required by Table 6.4 minimum exhaust rates.								
		Barber Shop Required Exhaust =					300 CFM	as required by Table 6.4 minimum exhaust rates.								
		Restroom Required Exhaust =					50 CFM	as required by Table 6.4 minimum exhaust rates.								
		Total Exhaust Required =					400 CFM									
Terminology has been adopted from ASHRAE std 62.1-2010, refer to Chapter 6 of that code for additional terminology, equations, etc.																

## ROOF-TOP UNIT SCHEDULE - 208V (EXISTING)

MARK	MANUFACTURER/ MODEL	NOMINAL TONS	CFM	O/A CFM	E.S.P. (IN. W.C.)	SEER	COOLING CAP. (MBH)			HEATING GAS INPUT (MBH)	ELECTRICAL (VOLTS/PH/Hz)	UNIT MCA	UNIT MOCP	UNIT WEIGHT (LBS)	MFG DATE (EX. UNITS)	NOTES
							TOTAL	SENSIBLE	WET BULB/ WET BULB °F							
RTU-1 (EX.)	TRANE YHC043A3RLA13D	4.0	1600	400	0.75"	13.0	47.4	39.9	80/67	60	208/3/60	21.2	30	794	APPROX. 2006	11,12

NOTES:  
1. LABEL EACH RTU AND EXHAUST FAN WITH "BISHOPS" AND SUITE NUMBER.  
2. COOLING CAPACITY IS BASED ON 80°F DB AND 67°F WB CONDITIONS.  
3. PROVIDE PROGRAMMABLE ROOM THERMOSTAT, HONEYWELL TH8000 SERIES.  
4. PROVIDE UNWIRED CONVENIENCE OUTLET (ELECTRICIAN SHALL FIELD WIRE TO 208V PANEL) AND 14" ROOF CURB.  
5. VERIFY VOLTAGE AVAILABLE ON SITE PRIOR TO ORDERING NEW UNITS. OBTAIN STRUCTURAL APPROVAL PRIOR TO PLACING UNIT.  
6. UNIT PROVIDED WITH DUAL COMPRESSORS/2-STAGE COOLING.  
7. PROVIDE FACTORY ELECTROFAN OR EQUAL ANTI-CORROSION COATING ON OUTDOOR COILS.  
8. WEIGHTS INCLUDE ACCESSORIES.  
9. ORDER WITH ACCESSORIES INCLUDING: CURB, ECONOMIZER, HAIL GUARD, 2-POSITION DAMPER, DUAL ENTHALPY SENSORS, DUCT DETECTORS, ETC.  
10. MCA BASED ON MEDIUM STATIC FAN.  
11. LANDLORD TO FULLY SERVICE AND WARRANTY FOR ONE(1) YEAR.  
12. BRING EXISTING UNIT TO LIKE NEW OPERATING AND PERFORMANCE CONDITIONS. COMB OUT FINS, CHANGE BELTS, BRING TO FACTORY SPEC REFRIGERANT LEVELS, ETC.

## CONTRACTOR NOTES:

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ARCHITECT, LANDLORD OR TENANT OF ANY DISCREPANCIES ENCOUNTERED ON THE PLANS OR IN EXISTING CONDITIONS PRIOR TO COMMENCEMENT OF WORK. COORDINATE ROOF ACCESS WITH LANDLORD.

BIDDERS ARE TO VISIT THE SITE AND FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS AND SATISFY THEMSELVES AS TO THE NATURE AND SCOPE OF WORK. THE BASE BID SHALL REFLECT MODIFICATIONS TO SYSTEMS AND DEVICES AS REQUIRED BY STATE AND LOCAL CODES WHETHER INDICATED OR NOT ON CONTRACT DOCUMENTS. THE SUBMISSIONS OF A BID WILL BE EVIDENCE THAT SUCH AN EXAMINATION AND COMPLIANCE WITH GOVERNING CODES / REQUIREMENTS HAS BEEN MADE. LATER CLAIMS FOR LABOR, EQUIPMENT, OR MATERIALS REQUIRED OR FOR DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN, HAD AN EXAMINATION AND CODE REVIEW BEEN MADE, WILL NOT BE ALLOWED.

ANY EXISTING HVAC EQUIPMENT THAT IS BEING REUSED SHALL HAVE ITS POWER (SERVICE OUTLET, HVAC UNIT POWER, DUCT DETECTOR, ETC.) MIGRATED TO THE NEW ELECTRICAL PANEL(S). REUSE DISCONNECTS WHERE CODE COMPLIANT. REPLACE WHEN IN POOR SHAPE, UNDERSIZED OR OTHERWISE NECESSARY. CIRCUIT TO OPEN BREAKERS IF CIRCUIT IS NOT CALLED OUT.

## MECHANICAL SYMBOL LEGEND

SYMBOL	DESCRIPTION
①	THERMOSTAT @ 48" AFF
②	DUCT MOUNTED SMOKE DETECTOR
③	REMOTE ROOM TEMPERATURE SENSOR AT 96" AFF
④	VOLUME DAMPER
⑤	MOTORIZED DAMPER WITH ACTUATOR
AHU	AIR HANDLING UNIT
EF	EXHAUST FAN
B	BAROMETRIC FLAP DAMPER

## DANVILLE, CA NOTE:

ALL DUCTS AND REFRIGERANT LINES SHALL BE SUPPORTED PER THE MINIMUM REQUIREMENTS OF CMC 603.3 AND SHALL BE BRACED AND GUYED TO PREVENT LATERAL OR HORIZONTAL SWING. THE USE OF LATERAL OR HORIZONTAL SEISMIC RESTRAINT GUIDELINES PER "SMACNA" IS ALSO APPLICABLE.

A) DUCTS SHALL BE EQUIPPED WITH TIGHT-FITTING CIRCULAR BANDS EXTENDING AROUND THE ENTIRE PERIMETER OF THE DUCT AT EACH SPECIFIED SUPPORT INTERVAL, PER CMC 603.3.2.1.

## DRYER VENT CALCULATION

24'-0"	HORIZONTAL LENGTH
16'-0"	VERTICAL LENGTH
0	45 DEGREE ELBOWS
2	90 DEGREE ELBOWS
60'-0"	TOTAL DEVELOPED DUCT LENGTH

## SAMPLE DRYER PLACARD

WARNING  
CHECK THE MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR ANY DOMESTIC DRYER THAT WILL BE INSTALLED AT THIS LOCATION. THE INSTALLATION INSTRUCTION MUST ALLOW THE DRYER TO BE CONNECTED TO AN EXHAUST DUCT (VENT) THAT IS \_\_\_\_\_ FEET.

## AIR DEVICE SCHEDULE

SYMBOL	TAG	MANUF.	CATALOG #	FIXTURE DESCRIPTION	NECK SIZE	REMARKS
⊗	A	TITUS	TMS	24x24 SUPPLY GRILLE/ 12x12 SUPPLY GRILLE	SEE PLAN	ALUMINUM, BORDER TYPE 1 IN GYP. BD. CLG. PAINTED BLACK TO MATCH CEILING WHERE CEILING IS NOT WHITE, REF ARCH. SHEETS.
⊗	C	NAILOR	51EC	24x24 RETURN GRILLE/ 12x12 RETURN GRILLE	SEE PLAN	EGGCRATE, BORDER TYPE 1
⊞	D	NAILOR	61DV-0	SIDEWALL SUPPLY, 1/2" WIDTH, WHITE. PAINTED TO MATCH SPIRAL DUCT.	---	SURFACE MOUNT, EACH SHALL HAVE SADDLE-MOUNT FITTING WITH NECK VOLUME DAMPER.

## NOTE:

1. ALL GRILLES IN GYP BOARD CEILING SHALL BE ORDERED WITH INTEGRAL BALANCING DAMPERS.
2. PROVIDE RECTANGULAR TO ROUND ADAPTERS WHEREVER NECESSARY.
3. NOT ALL DEVICES USED ON ALL JOBS.
4. TRANSITION NECK SIZE ON SUPPLY AND RETURN AS NEEDED TO ENSURE SAME SIZE (WITHIN 2") SUPPLY AND RETURN REGISTERS FOR UNIFORM APPEARANCE.


## DANVILLE, CA NOTE:

CIRCULAR BANDS SHALL BE NOT LESS THAN 1 INCH WIDE NOR LESS THAN EQUIVALENT TO THE GAUGE OF THE DUCT MATERIAL IT SUPPORTS. CMC 603.3.2.2.

- 1) DUCTS NOT MORE THAN 10 INCHES IN DIAMETER SHALL BE PERMITTED TO BE SUPPORTED BY NO. 18 GAUGE GALVANIZED STEEL WIRE.
- 2) EACH CIRCULAR BAND SHALL BE PROVIDED WITH MEANS OF CONNECTING TO THE SUSPENDING SUPPORT. CMC.

## BISHOPS PROTO NOTE:

IF DRYER DUCT RUN EXCEEDS 15', DRYER DUCT SHALL BE INSULATED.

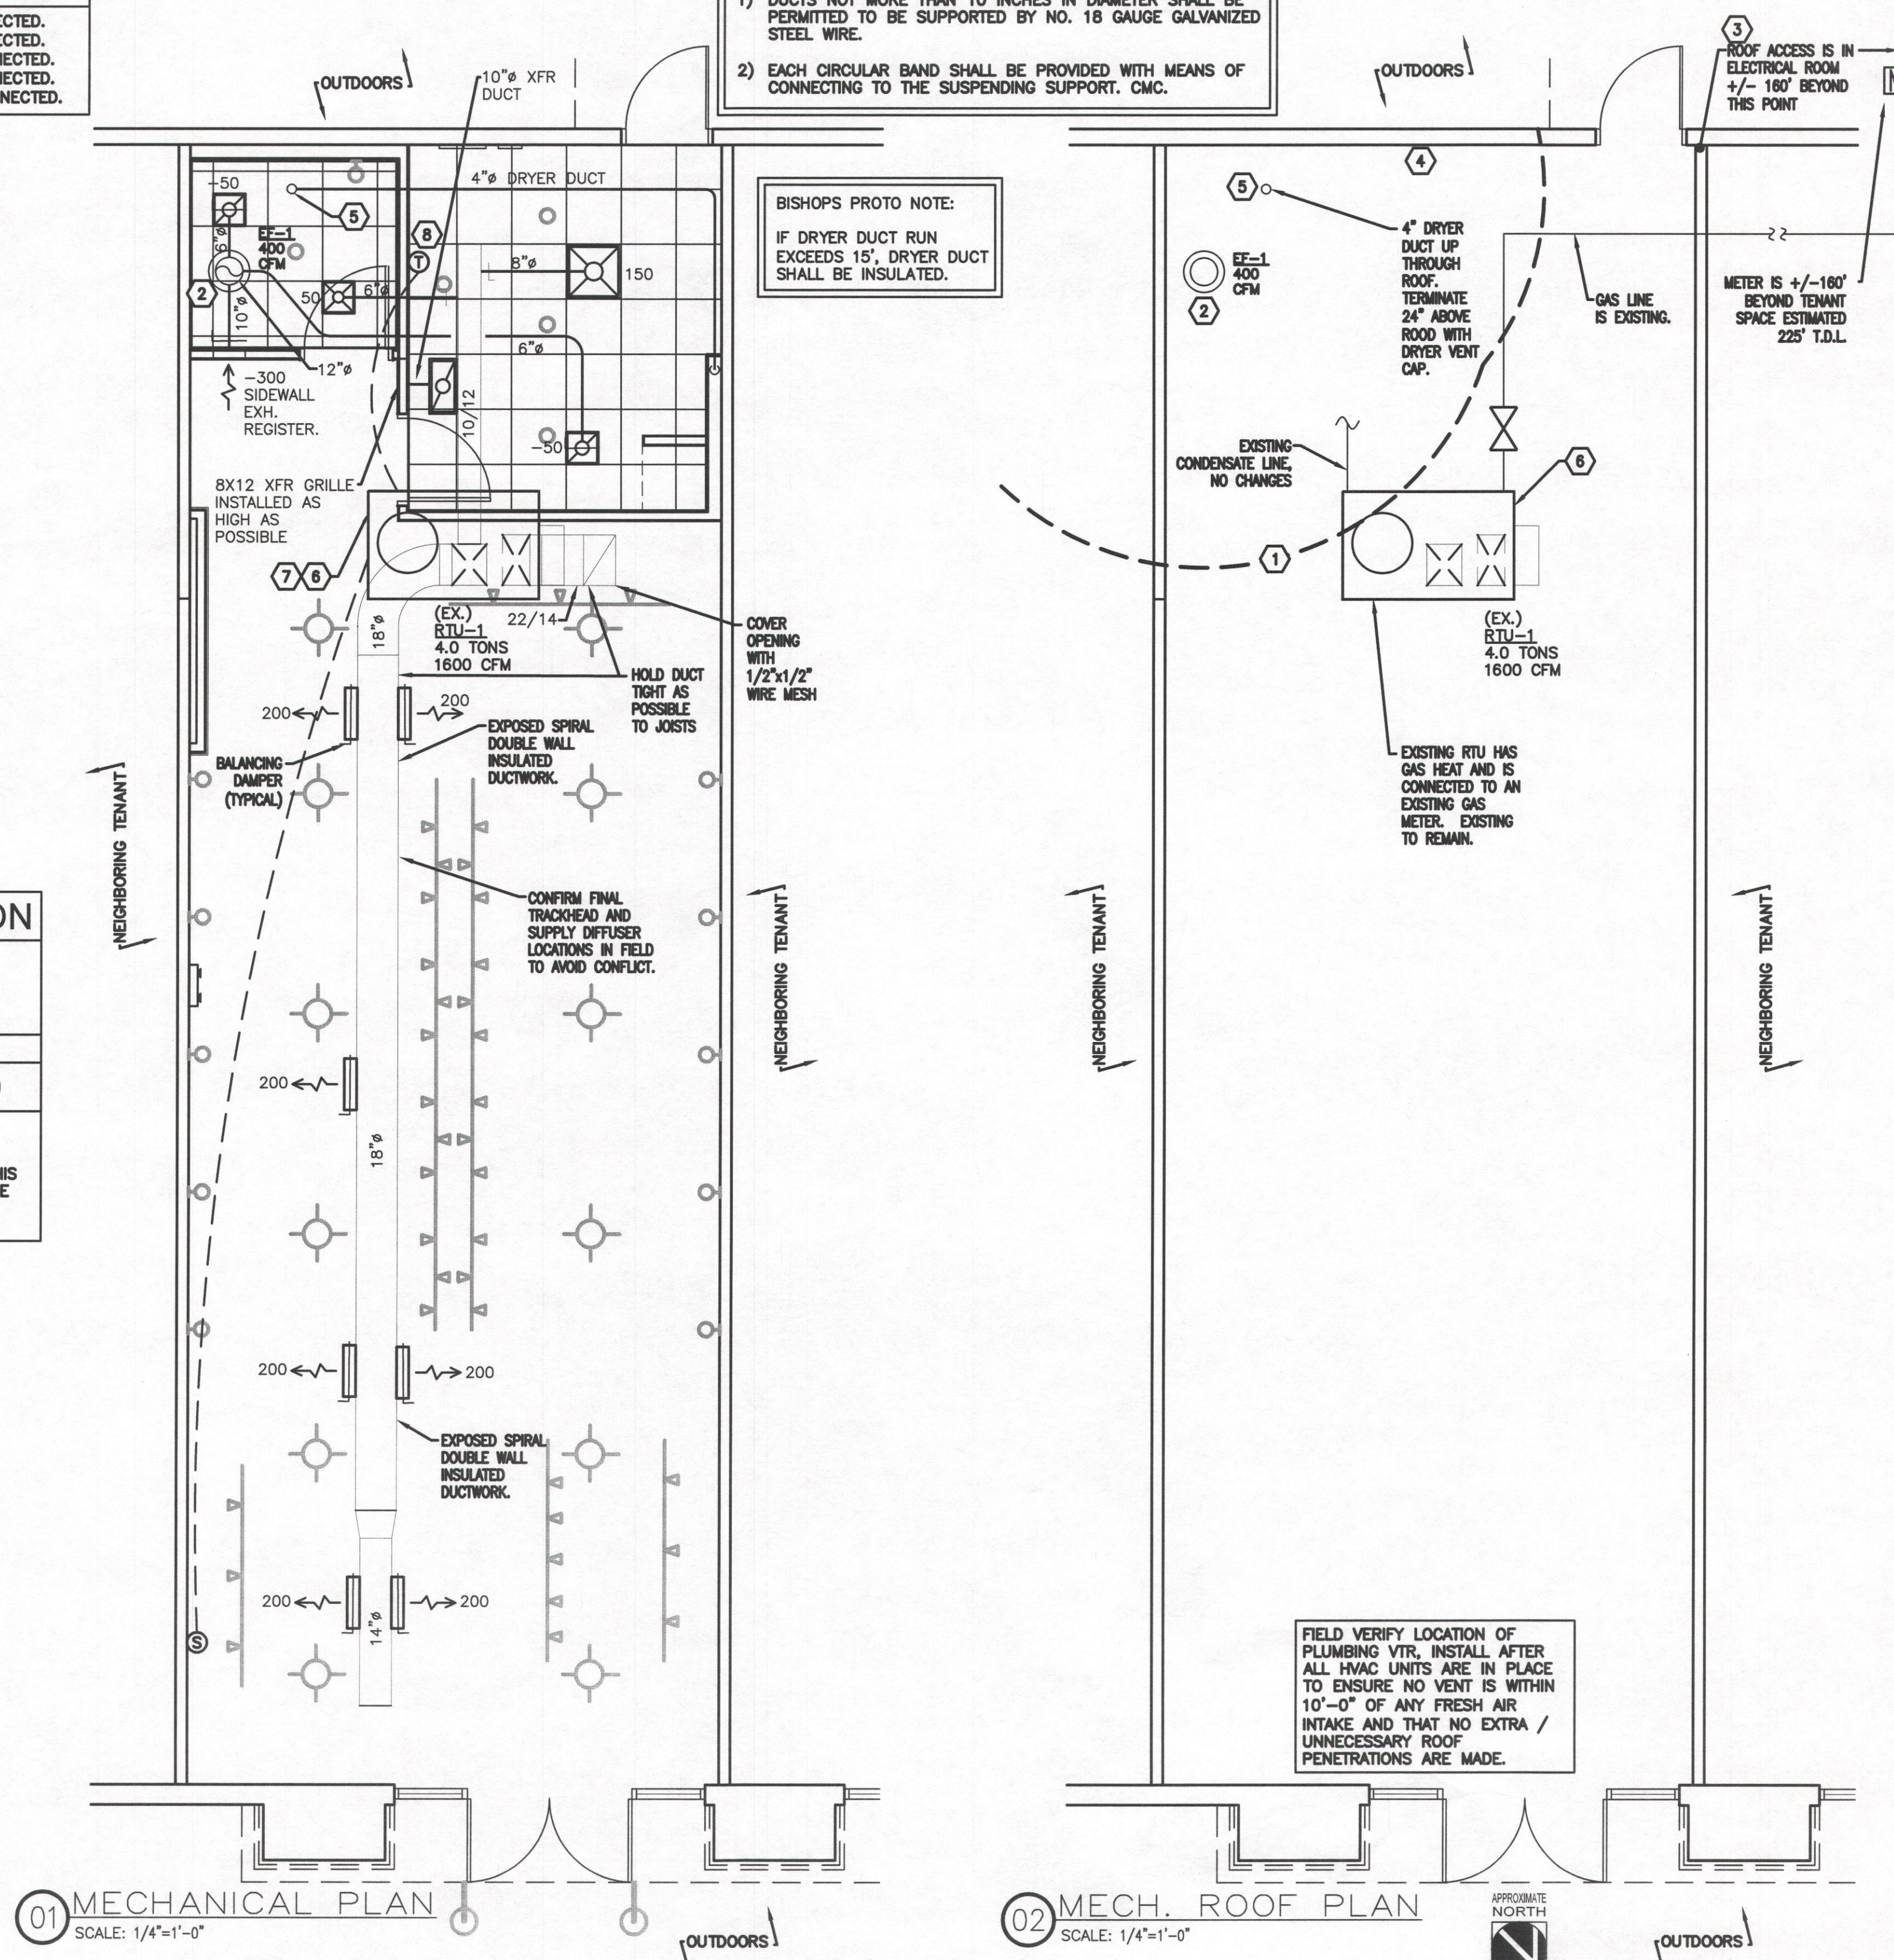

## AIR DEVICE NECK CHART

8"ø	- 0 TO 180 CFM
10"ø	- 185 TO 350 CFM
12"ø	- 355 TO 550 CFM
14"ø	- 555 TO 850 CFM
16"ø	- 855 TO 1350 CFM
18"ø	- 1360 TO 1750 CFM

\*\*USE ABOVE SIZES UNLESS OTHERWISE INDICATED.

GH A

Architecture / Development  
14901 Quorum Drive  
Suite 300  
Dallas Texas 75254

Ph: (972) 239-8884  
Fax: (972) 239-5054

BISHOPS - TENANT FINISHOUT  
DANVILLE SQUARE  
39 RAILROAD AVE  
DANVILLE, CA 94526

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION



ISSUE

Peter A. Leptuch, P.E.  
CA-M35700/CA-E19072  
1236 Golden Eagle Ct.  
Aubrey, TX 76227  
(940) 735-5127


PROJECT NUMBER  
C170445

SHEET NUMBER

M1.0  
MECHANICAL  
PLANS  
DATE OF THIS PRINTING - 03/21/18


ISSUE FOR PERMIT 03/22/18



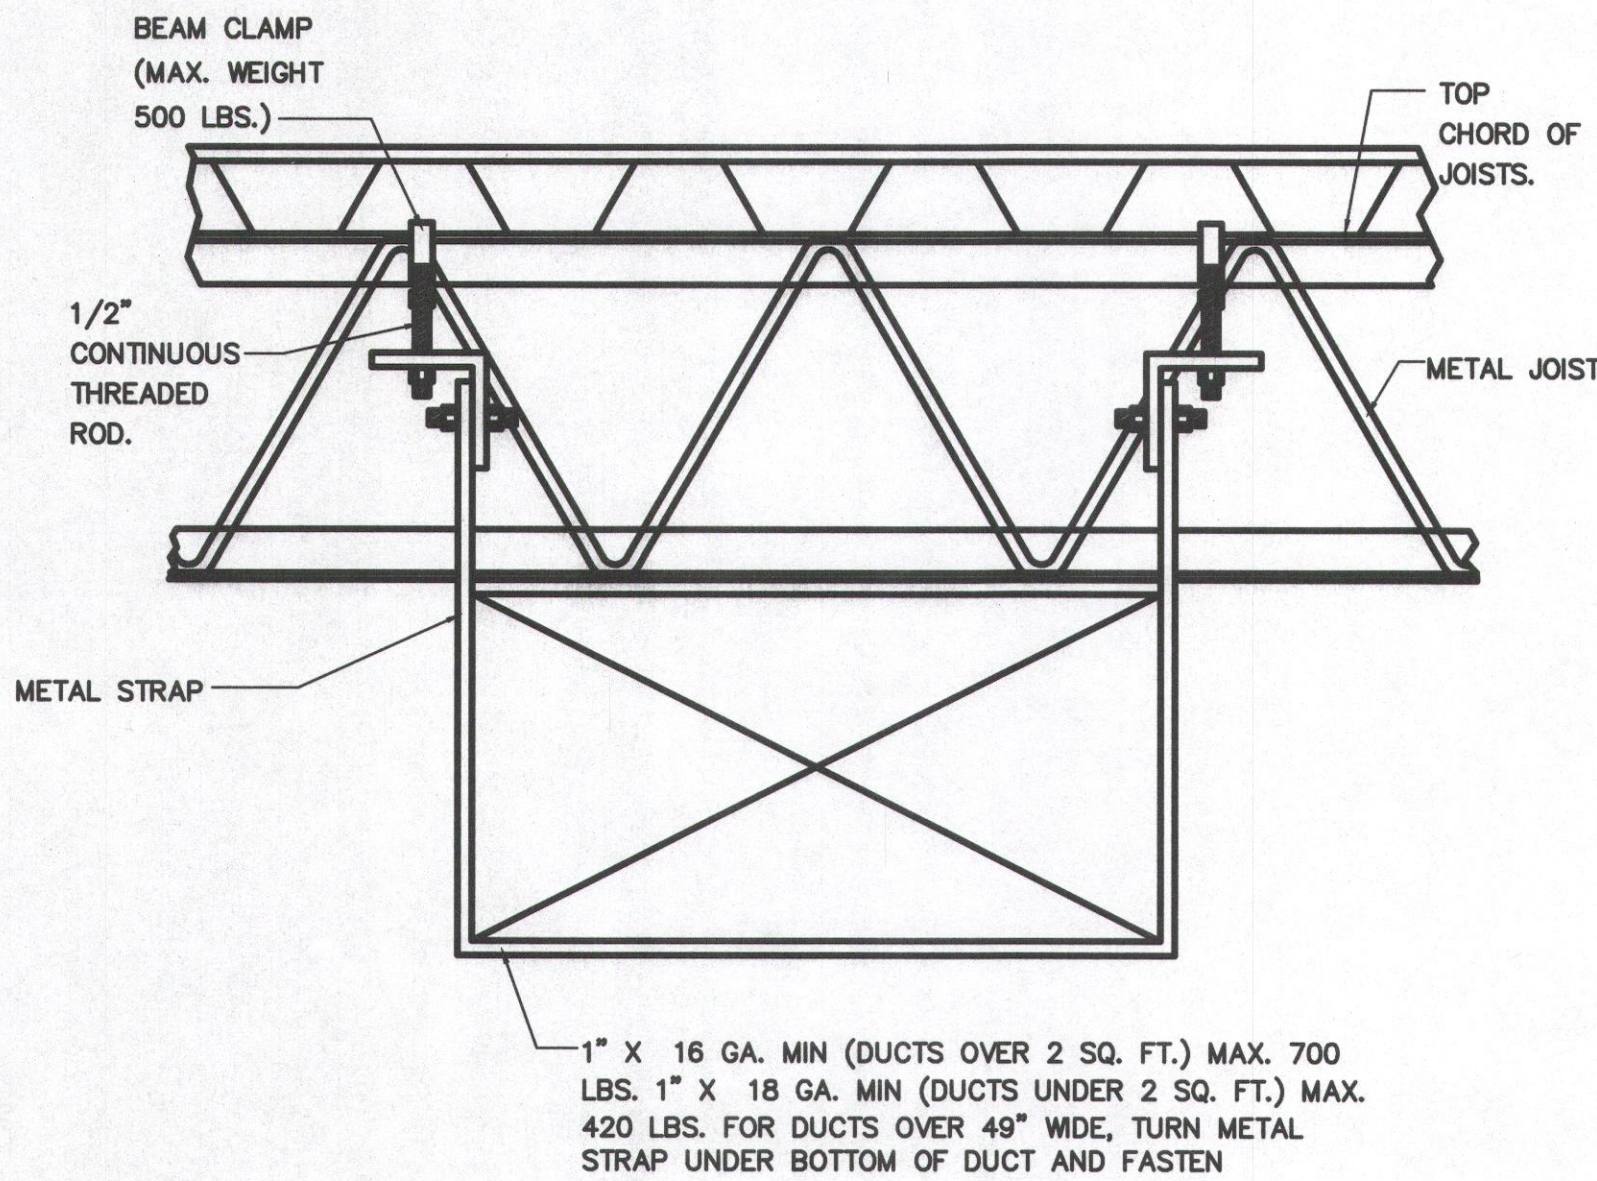

DUCTWORK SUPPORT DETAIL  
NOT TO SCALE

	RECTANGULAR DUCTS	ALUMINUM MIN. B & S GAUGE
MAX. SIDE INCHES THROUGH 12	MIN. GALV. SHT. GAUGE	24 (0.020 IN.)
13 THROUGH 30	26 (0.022 IN.)	22 (0.025 IN.)
31 THROUGH 54	24 (0.028 IN.)	20 (0.032 IN.)
55 THROUGH 84	22 (0.034 IN.)	18 (0.040 IN.)
OVER 84	20 (0.040 IN.)	16 (0.051 IN.)
	18 (0.052 IN.)	

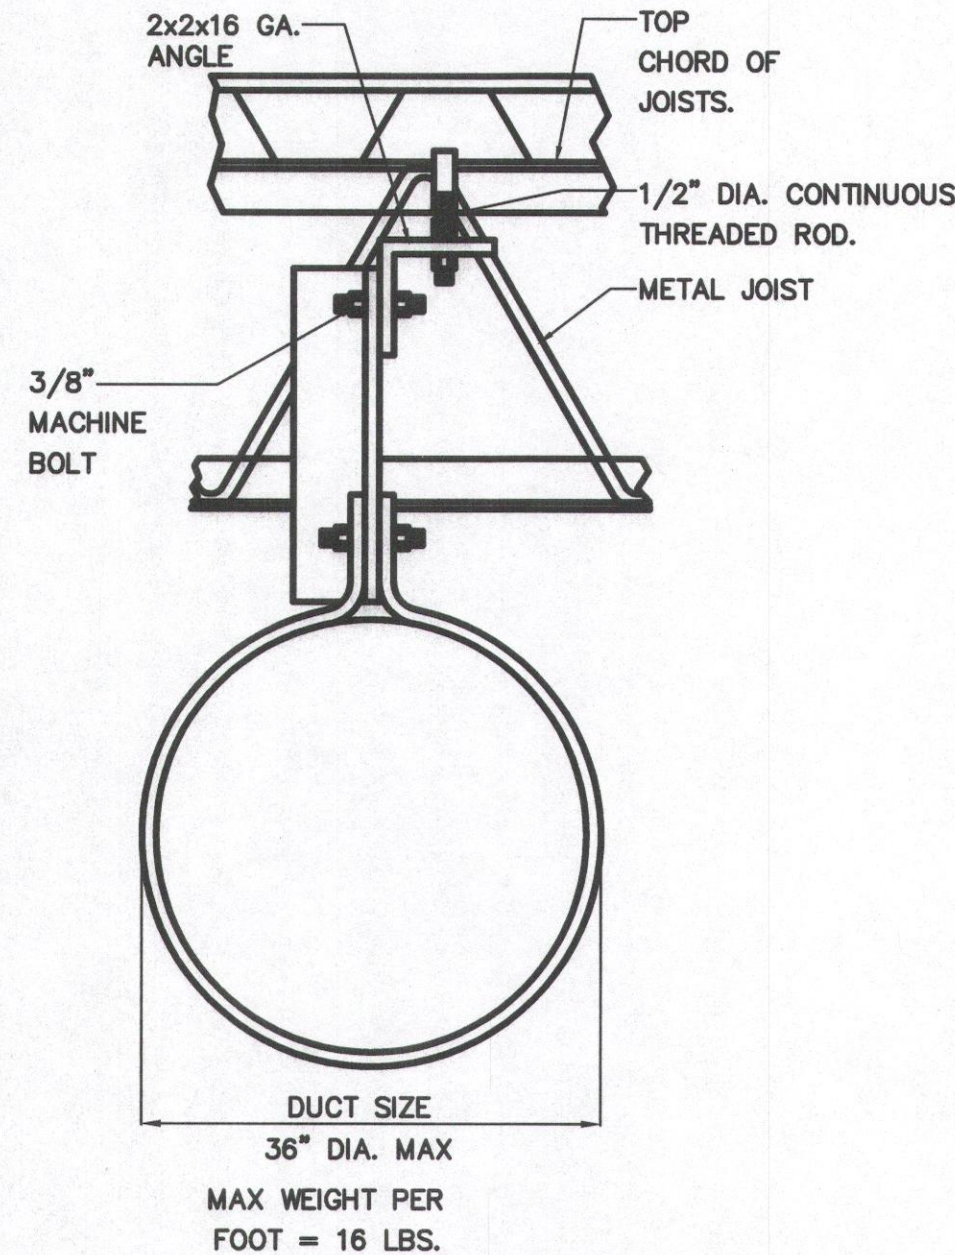

NOTE:  
DISTANCE BETWEEN DUCT HANGERS SHALL BE IN ACCORDANCE WITH THE RULES OF THE AGENCIES HAVING JURISDICTION.

ROUND DUCT SUPPORT DETAIL  
NOT TO SCALE

	SPIRAL SEAM DUCT STEEL MIN. GALV. SHT. GAUGE	ROUND DUCTS LONGITUDINAL SEAM DUCT STEEL MIN. GALV. SHT. GAUGE	FITTINGS STEEL MIN. GALV. SHT. GAUGE
DIAMETER INCHES THROUGH 12	28 (0.019 IN.)	26 (0.022 IN.)	26 (0.022 IN.)
13 THROUGH 18	26 (0.022 IN.)	24 (0.028 IN.)	24 (0.028 IN.)
19 THROUGH 28	24 (0.028 IN.)	22 (0.034 IN.)	22 (0.034 IN.)
29 THROUGH 36	22 (0.034 IN.)	20 (0.040 IN.)	20 (0.040 IN.)
37 THROUGH 52	20 (0.040 IN.)	18 (0.052 IN.)	18 (0.052 IN.)

01 DUCTWORK SUPPORT DETAIL  
SCALE: 1/4"=1'-0"

TABLE 6-4: DUCT INSULATION SCHEDULE  
2016 CALIFORNIA MECHANICAL CODE

DUCT LOCATION	INSULATION TYPES MECHANICALLY CODED	HEATING ZONE ?	INSULATION TYPES HEATING ONLY
ON ROOF ON EXTERIOR OF BUILDING	C, V <sup>a</sup> AND W	I II III	A AND W B AND W C AND W
ATTICS, GARAGES AND CRAWL SPACES	A AND V <sup>a</sup>	I II III	A A B
IN WALLS, WITHIN FLOOR-CEILING SPACES <sup>1</sup>	A AND V <sup>a</sup>	I II III	A B B
WITH THE CONDITIONED SPACE OR IN BESEMENTS; RETURN DUCTS IN AIR PLENUMS			
CEMENT SLAB OR WITHIN GROUND			

NOTE: WHERE DUCTS ARE USED FOR BOTH HEATING AND COOLING, THE MINIMUM INSULATION SHALL BE AS REQUIRED FOR THE MOST RESTRICTIVE CONDITION.

1. HEATING DEGREE DAYS:

ZONE I	BELOW 4500 D.D.
ZONE II	4501 TO 8000 D.D.
ZONE III	OVER 8000 D.D.

2. VAPOR RETARDERS SHALL BE INSTALLED ON SUPPLY DUCTS IN SPACES VENTED TO THE OUTSIDE IN GEOGRAPHIC AREAS WHERE THE SUMMER DEW POINT TEMPERATURE BASED ON THE 2-1/2% COLUMN OF DRY-BULB AND MEAN COINCIDENT WET-BULB TEMPERATURE EXCEEDS 60° DEG. F.

3. INSULATION MAY BE OMITTED ON THAT PORTION OF A DUCT WHICH IS LOCATED WITHIN A WALL OR FLOOR CEILING SPACE WHERE:

- BOTH SIDES OF THE SPACE ARE EXPOSED TO CONDITIONED AIR.
  - THE SPACE IS NOT VENTILATED.
  - THE SPACE IS NOT USED AS A RETURN PLENUM.
  - THE SPACE IS NOT EXPOSED TO UNCONDITIONED AIR.
- CEILINGS WHICH FORM PLENUMS NEED NOT BE INSULATED.

4. INSULATION TYPES:

A. A MATERIAL WITH AN INSTALLED CONDUCTANCE OF 0.48 OR THE EQUIVALENT THERMAL RESISTANCE OF 2:1.

EXAMPLE OF MATERIALS CAPABLE OF MEETING THE ABOVE REQUIREMENTS:  
1 INCH 60 LB/CU. FT. MINERAL FIBER, ROCK, SLAG OR GLASS BLANKETS.  
1/2 INCH, 1.5 TO 3 LB/CU. FT. MINERAL FIBER BLANKET DUCT LINER.  
1/2 INCH, 3 TO 10 LB/CU. FT. MINERAL FIBER BOARD.

B. A MATERIAL WITH AN INSTALLED CONDUCTANCE OF 0.24 OR THE EQUIVALENT THERMAL RESISTANCE OF 4:2.

EXAMPLE OF MATERIALS CAPABLE OF MEETING THE ABOVE REQUIREMENTS:  
2 INCH 0.60 LB/CU. FT. MINERAL FIBER BLANKETS.  
1/2 INCH, 1.5 TO 3 LB/CU. FT. MINERAL FIBER BLANKET DUCT LINER.  
1/2 INCH, 3 TO 10 LB/CU. FT. MINERAL FIBER BOARD

C. A MATERIAL WITH AN INSTALLED CONDUCTANCE OF 0.16 OR THE EQUIVALENT THERMAL RESISTANCE OF 6:3.

EXAMPLE OF MATERIALS CAPABLE OF MEETING THE ABOVE REQUIREMENTS:  
3 INCH 0.60 LB/CU. FT. MINERAL FIBER BLANKETS.  
1/2 INCH, 1.5 TO 3 LB/CU. FT. MINERAL FIBER BLANKET DUCT LINER.  
1/2 INCH, 3 TO 10 LB/CU. FT. MINERAL FIBER BOARD

- D. VAPOR RETARDERS: MATERIAL WITH A PERM RATING NOT EXCEEDING 0.5 PERM. ALL JOINTS TO BE SEALED.  
E. APPROVED WEATHER PROOF BARRIER.

THE EXAMPLE OF MATERIALS LISTED UNDER EACH TYPE IS NOT MEANT TO LIMIT OTHER AVAILABLE THICKNESS AND DENSITY COMBINATIONS WITH THE EQUIVALENT INSTALLED CONDUCTANCE OR RESISTANCE BASED ON THE INSULATION ONLY.

02 DUCT INSULATION AND SUPPORT  
SCALE: 1/4"=1'-0"

TABLE 6-5: DUCT SUPPORT  
PART 1 - VERTICAL DUCTS

MAXIMUM SIDE OF RECTANGULAR DUCT	METAL STRAP OR ANGLE BRACKET	MAXIMUM DIAMETER OF ROUND DUCTS	STRAPS
ON ROOF ON EXTERIOR OF BUILDING	C, V <sup>a</sup> AND W	I II III	A AND W B AND W C AND W
ATTICS, GARAGES AND CRAWL SPACES	A AND V <sup>a</sup>	I II III	A A B
IN WALLS, <sup>1</sup> WITHIN FLOOR-CEILING SPACES <sup>1</sup>	A AND V <sup>a</sup>	I II III	A B B
WITH THE CONDITIONED SPACE OR IN BESEMENTS; RETURN DUCTS IN AIR PLENUMS			
CEMENT SLAB OR WITHIN GROUND			
CEMENT SLAB OR WITHIN GROUND			

HVAC Load Calculation - Barber Shop

3/2/2018

Bishops - Danville, CA

18.011

Cooling Load Analysis:  
Sensible Heat:

ASHRAE DESIGN:  
Basis of Design: San Jose, CA  
Design Indoor Temp

DB = 92.3  
WB = 66.9  
68 F

H\_sensible, O.A. = 1.08 \* cfm \* delta T  
H\_sensible, lighting = watts \* 3.413  
H\_sensible, people = 250 \* # people  
H\_sensible, walls = A\*u\*dT  
H\_sensible, floor = A\*u\*dT  
H\_sensible, roof = A\*u\*dT  
H\_sensible, window conductance = A\_glass\*U\*dT  
H\_sensible, window transmittance = A\_glass\*SHGC\*Et

H\_sensible\_OA =  
H\_sens\_lgt =  
H\_sens ppl =  
H\_sens\_wall =  
H\_sens\_floor =  
H\_sens\_roof =  
H\_sens\_glass =  
H\_sens\_solar gain =

10497.6 dT = 24.3  
5877.186  
6750  
4774.737 (dT = 40F)  
1148 (dT = 1F)  
2870 (dT = 50F)  
2643.3  
0

H\_latent, O.A. = 0.68 \* q\*delta w\_grains  
H\_latent, people = 250 \* # people

H\_latent\_OA =  
H\_latent ppl =

-3944  
6750

Lighting Load (watts) 1722 (from Comcheck/ T-24 / FlaCom)  
Occupant Load 27 (Auto Populate - from ASHRAE calculation)  
Grains O.A. = 57.7 <---- update per site  
Grains I.A. = 72.2 (72.2 is for saturated air at 58F)  
Outside Air, Ventilation = 400 (Auto Populate - from ASHRAE calculation)  
Roof / Floor Area = 1148 (Auto Populate - from ASHRAE calculation)  
Wall Height - Average 16.2 <---- update per site  
Perimeter (unconditioned) 140 <---- update per site  
Wall Area = 2268  
Window Length = 18 <---- update per site  
Window Height = 8.9 <---- update per site  
Window Area = 160.2  
Shading Factor = 1 (0 = none, 1.0 = fully shaded)  
R-value Walls = (R\_net) = 19 New Wall  
U-value Walls = 0.052632 Average Wall  
R-floor = (R\_net) = 1  
U-floor = 1  
R-roof = (R\_net) = 20 EX. Roof  
U-roof = 0.05 Average Roof  
U-glass = 0.55 (use 1.1 for 1-pane glass; use 0.55 for double pane glass, energy star windows can be 0.55 max.)  
SHGC = 0.76 (use 0.76 for ordinary windows)  
Et = incident solar radiation 200 (assume peak daily, btu/hr p.s.f. Solar constant is 442 BTUH/hr at top of atmos, 317 at sfc.)

Total Cooling Load: 37366.82  
Space Load - Tonnage Required 3.113902 tons  
Safety Factor (10%) 41103.51  
Space Load - Recommended Tonnage 3.425292 tons  
Mechanical contractor shall verify Existing HVAC Unit meets the above minimum requirement.

Square footage per ton - baseline (lower bound) 211.6015  
Square footage per ton - baseline (upper bound) 368.6693

HVAC Load Calculation - Barber Shop

3/2/2018

Bishops - Danville, CA

Heating Load Analysis:  
Sensible Heat Loss:

ASHRAE DESIGN:  
Design Temp

DB = 35.7  
70

H\_sensible, O.A. = 1.08 \* cfm \* delta T  
H\_sensible, O.A. = 1.08 \* cfm \* delta T  
H\_sensible, walls = A\*u\*dT  
H\_sensible, floor = A\*u\*dT  
H\_sensible, roof = A\*u\*dT  
H\_sensible, window conductance = A\_glass\*U\*dT

H\_sensible\_OA = -14817.6 (dT = 57F)  
H\_sensible\_OA = -11113.2 (dT = 57F)  
H\_sens\_wall = -4094.34 (dT = 57F)  
H\_sens\_floor = 3444 (dT = 3F)  
H\_sens\_roof = -1968.82 (dT = 57F)  
H\_sens\_glass = -3022.17

Outside Air, ventilation = 400 (from ASHRAE calculation)  
Outside Air, intrusion = 300 (from open doors on windy winter days)  
Outside Air = 700  
Roof / Floor Area = 1148 <---- update per site  
Wall Height - Average 16.2 <---- update per site  
Perimeter (unconditioned) 140 <---- update per site  
Wall Area = 2268  
Window length = 18 <---- update per site  
Window height = 8.9 <---- update per site  
Window Area = 160.2  
Shading Factor = 1 (0 = none, 1.0 = fully shaded)  
R-value Walls = (R\_net) = 19 New Wall  
U-value Walls = 0.052631579 Average Wall  
R-floor = (R\_net) = 1  
U-floor = 1  
R-roof = (R\_net) = 20 New Roof  
U-roof = 0.05 Average Roof  
U-glass = 0.55 (use 1.1 for 1-pane glass; use 0.55 for double pane glass, energy star windows can be 0.55 max.)


Total Heating Load: -31572.1  
Safety Factor (25%) -39465.2 MBH  
Space Load - Tonnage Required 11.56319 KW  
Mechanical contractor shall verify Existing HVAC Equipment meets the above minimum requirement.  
Provide 180 mbh heat for quick heat-up in the mornings.

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION



ISSUE

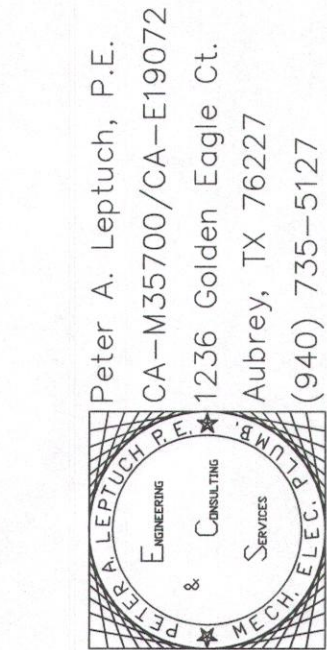

PROJECT NUMBER  
C170445

SHEET NUMBER

M2.0  
SEISMIC MECHANICAL  
DETAILS  
DATE OF THIS PRINTING - 03/21/18

ISSUE FOR PERMIT 03/22/18



STATE OF CALIFORNIA  
MECHANICAL SYSTEMS  
DEC-NRCC-MCH-01-E (Revised 01/16)  
CALIFORNIA ENERGY COMMISSION  
CERTIFICATE OF COMPLIANCE  
Mechanical Systems  
Project Name: Bishops at Danville, CA  
Date Prepared: 3/8/2018  
NRCC-MCH-01-E  
(Page 1 of 4)

A. MECHANICAL COMPLIANCE DOCUMENTS & WORKSHEETS (check box if worksheet is included)  
For detailed instructions on the use of this and all Energy Efficiency Standards compliance forms, refer to the 2016 Nonresidential Manual  
Note: The Enforcement Agency may require all forms to be incorporated onto the building plans.  
YES NO Comp. Doc./Worksheet # Title  
☐ ☐ NRCC-MCH-01-E (Part 1 of 3) Certificate of Compliance, Declaration. Required on plans for all submittals.  
☐ ☐ NRCC-MCH-01-E (Part 2 of 3) Certificate of Compliance, Required Acceptance Tests (MCH-02-A to 13-A). Required on plans for all submittals.  
☐ ☐ NRCC-MCH-01-E (Part 3 of 3) Certificate of Compliance, Required Acceptance Tests (MCH-12-A to 18-A). Required on plans where applicable.  
☐ ☐ NRCC-MCH-02-E (Part 1 of 2) Mechanical Dry Equipment Summary is required for all submittals with Central Air Systems. It is optional on plans.  
☒ ☐ NRCC-MCH-02-E (Part 2 of 2) Mechanical Wet Equipment Summary is required for all submittals with chilled water, hot water or condenser water systems. It is optional on plans.  
☐ ☐ NRCC-MCH-03-E Mechanical Ventilation and Reheat is required for all submittals with multiple zone heating and cooling systems. It is optional on plans.  
☐ ☐ NRCC-MCH-07-E (Part 1 of 2) Power Consumption of Fans. Required on plans where applicable.  
☐ ☐ NRCC-MCH-07-E (Part 2 of 2) Power Consumption of Fans, Declaration. Required on plans where applicable.

STATE OF CALIFORNIA  
MECHANICAL SYSTEMS  
DEC-NRCC-MCH-01-E (Revised 01/16)  
CALIFORNIA ENERGY COMMISSION  
CERTIFICATE OF COMPLIANCE  
Mechanical Systems  
Project Name: Bishops at Danville, CA  
Date Prepared: 3/8/2018  
NRCC-MCH-01-E  
(Page 2 of 4)

B. MECHANICAL HVAC ACCEPTANCE FORMS (check box for required compliance documents)  
Test Performed By:  
Designer:  
This compliance document is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for HVAC systems. The designer is required to check the applicable boxes for all acceptance tests that apply and list all equipment that requires an acceptance test. All equipment of the same type that requires a test, list the equipment description and the number of systems.  
Installing Contractor:  
The contractor who installed the equipment is responsible to either conduct the acceptance test themselves or have a qualified entry run the test for them. If more than one person has responsibility for the acceptance testing, each person shall sign and submit the Certificate of Acceptance applicable to the portion of the construction or installation for which they are responsible.  
Enforcement Agency:  
Plancheck - The NRCC-MCH-01-E compliance document is not considered a completed document and is not to be accepted by the building department unless the correct boxes are checked.  
Inspector - Before occupancy permit is granted all newly installed process systems must be tested to ensure proper operations.  
Test Description MCH-02-A MCH-03-A MCH-04-A MCH-05-A MCH-06-A MCH-07-A MCH-08-A MCH-09-A MCH-10-A MCH-11-A  
Equipment Requiring Testing or Verification # of Units Outdoor Air Single Zone Unitary Air Distribution Ducts Economizer Controls Demand Control Ventilation (DCV) Supply Fan VAV Valve Leakage Test Supply Water Temp. Reset Hydronic System Variable Flow Control Automatic Demand Shed Control  
A O Smith Water 1 ☐ ☐ ☐ ☐ ☐ ☐ ☐ ☐ ☐ ☐

STATE OF CALIFORNIA  
MECHANICAL SYSTEMS  
DEC-NRCC-MCH-01-E (Revised 01/16)  
CALIFORNIA ENERGY COMMISSION  
CERTIFICATE OF COMPLIANCE  
Mechanical Systems  
Project Name: Bishops at Danville, CA  
Date Prepared: 3/8/2018  
NRCC-MCH-01-E  
(Page 3 of 4)

C. MECHANICAL HVAC ACCEPTANCE FORMS (check box for required compliance documents)  
Test Performed By:  
Designer:  
This compliance document is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for HVAC systems. The designer is required to check the applicable boxes for all acceptance tests that apply and list all equipment that requires an acceptance test. All equipment of the same type that requires a test, list the equipment description and the number of systems.  
Installing Contractor:  
The contractor who installed the equipment is responsible to either conduct the acceptance test themselves or have a qualified entry run the test for them. If more than one person has responsibility for the acceptance testing, each person shall sign and submit the Certificate of Acceptance applicable to the portion of the construction or installation for which they are responsible.  
Enforcement Agency:  
Plancheck - The NRCC-MCH-01-E compliance document is not considered a completed document and is not to be accepted by the building department unless the correct boxes are checked.  
Inspector - Before occupancy permit is granted all newly installed process systems must be tested to ensure proper operations.  
Test Description MCH-12-A MCH-13-A MCH-14-A MCH-15-A MCH-16-A MCH-17-A MCH-18-A  
Equipment Requiring Testing or Verification # of Units Fault Detection & Diagnostics for DX Units Automatic Fault Detection & Diagnostics for Air & Zone Distributed Energy Storage DX AC Systems Thermal Energy Storage (TES) Systems Supply Air Temperature Reset Controls Condenser Water Reset Controls ECMs  
A O Smith Water 1 ☐ ☐ ☐ ☐ ☐ ☐ ☐


STATE OF CALIFORNIA  
MECHANICAL SYSTEMS  
DEC-NRCC-MCH-01-E (Revised 01/16)  
CALIFORNIA ENERGY COMMISSION  
CERTIFICATE OF COMPLIANCE  
Mechanical Systems  
Project Name: Bishops at Danville, CA  
Date Prepared: 3/8/2018  
NRCC-MCH-01-E  
(Page 4 of 4)  
DOCUMENTATION AUTHOR'S DECLARATION STATEMENT  
I certify that this Certificate of Compliance documentation is accurate and complete.  
Documentation Author Name: Peter A. Leptuch  
Signature: Peter A. Leptuch, P.E.  
Address: 1236 Golden Eagle Court  
City/State/Zip: Aubrey, TX 76227  
Phone: (940) 735-5127  
RESPONSIBLE PERSON'S DECLARATION STATEMENT  
I certify the following under penalty of perjury, under the laws of the State of California:  
1. The information provided on this Certificate of Compliance is true and correct.  
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).  
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.  
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.  
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.  
Responsible Designer Name: Peter A. Leptuch  
Signature: Peter A. Leptuch, P.E.  
Address: 1236 Golden Eagle Court  
City/State/Zip: Aubrey, TX 76227  
Phone: (940) 735-5127

STATE OF CALIFORNIA  
HVAC DRY & WET SYSTEM REQUIREMENTS  
DEC-NRCC-MCH-02-E (Revised 01/16)  
CALIFORNIA ENERGY COMMISSION  
CERTIFICATE OF COMPLIANCE  
HVAC Dry & Wet System Requirements  
Project Name: Bishops at Danville, CA  
Date Prepared: 3/8/2018  
NRCC-MCH-02-E  
(Page 1 of 3)  
A. Equipment Tags and System Description<sup>1</sup> - Dry Systems  
MANDATORY MEASURES T-24 Sections Reference to the Requirements in the Contract Documents<sup>2</sup>  
Heating Equipment Efficiency<sup>3</sup> 110.1 or 110.2(a)  
Cooling Equipment Efficiency<sup>3</sup> 110.1 or 110.2(a)  
HVAC or Heat Pump Thermostats 110.2(b), 110.2(c)  
Furnace Standby Loss Control 110.2(d)  
Low Leakage AHUs 110.2(f)  
Ventilation<sup>4</sup> 120.1(b)  
Demand Control Ventilation<sup>5</sup> 120.1(c)(4)  
Occupant Sensor Ventilation Control<sup>6</sup> 120.1(d), 120.2(e)  
Shutoff and Reset Controls<sup>7</sup> 120.2(c)  
Outdoor Air and Exhaust Damper Control 120.2(f)  
Isolation Zones 120.2(g)  
Automatic Demand Shed Controls 120.2(h)  
Economizer FDD 120.2(i)  
Duct Insulation 120.4  
PRESCRIPTIVE MEASURES  
Equipment is sized in conformance with 140.4(a & b) Y/N Y/N Y/N  
Supply Fan Pressure Control 140.4(c)  
Simultaneous Heat/Cool<sup>8</sup> 140.4(d)  
Economizer 140.4(e)  
Heat and Cool Air Supply Reset 140.4(f)  
Electric Resistance Heating<sup>9</sup> 140.4(g)  
Duct Leakage Sealing and Testing<sup>10</sup> 140.4(i)  
Notes:  
1. Provide equipment tags (e.g. AHU 1 to 10) and system description (e.g. Single Duct VAV reheat) as appropriate. Multiple units with common requirements can be grouped together.  
2. Provide references to plans (i.e. Drawing Sheet Numbers) and/or specifications (including Section name/number and relevant paragraphs) where each requirement is specified. Enter "N/A" if the requirement is not applicable to this system.  
3. The referenced plans and specifications must include all of the following information: equipment tag, equipment nominal capacity, Title 24 minimum efficiency requirements, and actual rated equipment efficiencies. Where multiple efficiency requirements are applicable (e.g. full- and part-load) include all. Where appliance standards apply (110.1), identify where equipment is required to be listed per Title 20 1601 et seq.  
4. Identify where the ventilation requirements are documented for each central HVAC system. Include references to both central unit schedules and sequences of operation. If one or more spaces is naturally ventilated identify where this is documented in the plans and specifications. Multiple zone central air systems must also provide a MCH-03-E compliance document.  
5. If one or more spaces has demand controlled ventilation identify where it is specified including the sensor specifications and the sequence of operation.  
6. If one or more space has occupant sensor ventilation control identify where it is specified including the sensor specifications and the sequence of operation.  
7. If the system is DDC identify the sequences for the system start/stop, optimal start, setback (if required) and setup (if required). For all systems identify the specification for the thermostats and time clocks (if applicable).  
8. Identify where the heating, cooling and deadband airflows are scheduled for this system. Include a reference to the specification of the zone controls. Provide a MCH-03-E compliance document.  
9. Enter N/A if there is no electric heating. If the system has electric heating indicate which exception to 140.4(g) applies.  
10. If duct leakage sealing and testing is required, a MCH-04-A compliance document must be submitted.


STATE OF CALIFORNIA  
HVAC DRY & WET SYSTEM REQUIREMENTS  
DEC-NRCC-MCH-02-E (Revised 01/16)  
CALIFORNIA ENERGY COMMISSION  
CERTIFICATE OF COMPLIANCE  
HVAC Dry & Wet System Requirements  
Project Name: Bishops at Danville, CA  
Date Prepared: 3/8/2018  
NRCC-MCH-02-E  
(Page 2 of 3)  
B. Equipment Tags and System Description<sup>1</sup> - Wet Systems A O Smith Water  
MANDATORY MEASURES T-24 Sections Reference to the Requirements in the Contract Documents<sup>2</sup>  
Heating Hot Water Equipment Efficiency<sup>3</sup> 110.1  
Cooling Chilled and Condenser Water Equipment Efficiency<sup>3</sup> 110.1, 140.4(i)  
Open and Closed Circuit Cooling Towers conductivity or flow-based controls 110.2(e) 1  
Open and Closed Circuit Cooling Towers Maximum Achievable Cycles of Concentration (L/G)<sup>4</sup> 110.2(e) 2  
Open and Closed Circuit Cooling Towers Flow Meter with analog output 110.2(e) 3  
Open and Closed Circuit Cooling Towers Overflow Alarm 110.2(e) 4  
Open and Closed Circuit Cooling Towers Efficient Drift Eliminators 110.2(e) 5  
Pipe Insulation 120.3  
PRESCRIPTIVE MEASURES  
Cooling Tower Fan Controls 140.4(h)2, 140.4(h)5 Y Y/N Y/N Y/N  
Cooling Tower Flow Controls 140.4(h)3  
Centrifugal Fan Cooling Towers<sup>5</sup> 140.4(h)4  
Air-Cooled Chiller Limitation<sup>6</sup> 140.4(i)  
Variable Flow System Design 140.4(k)  
Chiller and Boiler Isolation 140.4(k)  
CHW and HHW Reset Controls 140.4(k)  
W/HP Isolation Valves 140.4(k)  
VSD on CHW, CW & W/HP Pumps >5HP 140.4(k)  
DP Sensor Location 140.4(k)  
Notes:  
1. Provide equipment tags (e.g. CH 1 to 3) or system description (e.g. CHW loop) as appropriate. Multiple units with common requirements can be grouped together.  
2. Provide references to plans (i.e. Drawing Sheet Numbers) and/or specifications (including Section name/number and relevant paragraphs) where each requirement is specified. Enter "N/A" if the requirement is not applicable to this system.  
3. The referenced plans and specifications must include all of the following information: equipment tag, equipment nominal capacity, Title 24 minimum efficiency requirements, and actual rated equipment efficiencies. Where multiple efficiency requirements are applicable (e.g. full- and part-load) include all. For chillers operating at non-standard efficiencies provide the Kadj values. For chillers also note whether the efficiencies are Path A or Path B.  
4. Identify if cooling towers have propeller fans. If towers use centrifugal fans document which exception is used.  
5. If air-cooled chillers are used, document which exceptions have been used to comply with 140.4(i) and the total installed design capacity of the air-cooled chillers in the chilled water plant.  
6. Identify the existence of a completed MCH-06-E when open or closed circuit cooling towers are specified to be installed, otherwise enter "N/A".

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION

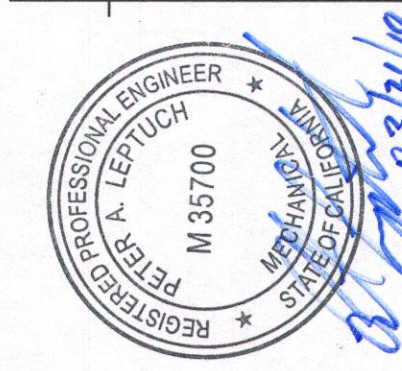

ISSUE

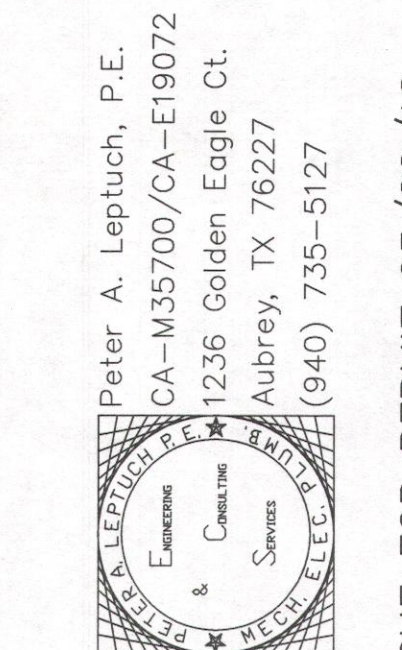




PROJECT NUMBER  
C170445

SHEET NUMBER

M2.1  
MECHANICAL  
TITLE 24  
DATE OF THIS PRINTING 03/21/18




STATE OF CALIFORNIA <b>HVAC SYSTEM REQUIREMENTS</b> (REVISED 04/14/2014)		CALIFORNIA ENERGY COMMISSION 	
<b>CERTIFICATE OF COMPLIANCE</b> HVAC Wet System Requirements		NRC-MCH-02-02 (Page 3 of 3)	
Project Name: <b>Bishops at Danville, CA</b>		Date Received: <b>3/8/2018</b>	
<b>DOCUMENTATION AUTHOR'S DECLARATION STATEMENT</b>			
I certify that this Certificate of Compliance Documentation is accurate and complete.			
Documentation Author Name: <b>Peter A. Leptuch</b>		Documentation Author Signature: 	
Company: <b>Peter A. Leptuch, P.E.</b>		Signature Date: <b>3/8/2018</b>	
Address: <b>1236 Golden Eagle Court</b>		CEA/REIS Certification Identification (if applicable):	
City/State/Zip: <b>Aubrey, TX 76227</b>		Phone: <b>(940) 735-5127</b>	
<b>RESPONSIBLE PERSON'S DECLARATION STATEMENT</b>			
I certify the following under penalty of perjury, under the laws of the State of California:			
1. The information provided on this Certificate of Compliance is true and correct.			
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).			
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.			
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.			
5. I further ensure that a completed signed copy of this Certificate of Compliance will be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.			
Responsible Designer Name: <b>Peter A. Leptuch</b>		Responsible Designer Signature: 	
Company: <b>Peter A. Leptuch, P.E.</b>		Date Signed: <b>3/8/2018</b>	
Address: <b>1236 Golden Eagle Court</b>		License: <b>M35700</b>	
City/State/Zip: <b>Aubrey, TX 76227</b>		Phone: <b>(940) 735-5127</b>	

STATE OF CALIFORNIA <b>REQUIRED ACCEPTANCE TESTS</b> PRE-MECHANICAL (Revised 01/15)		 CALIFORNIA ENERGY COMMISSION										
<b>CERTIFICATE OF COMPLIANCE</b> Required Acceptance Tests		NRCC-MCH-04-1 (Page 1 of 3)										
Project Name: <b>Bishops at Danville, CA</b>	Date Prepared: <b>3/8/2018</b>											
<b>A. MECHANICAL COMPLIANCE FORMS &amp; WORKSHEETS</b> (Indicate if worksheet is included)												
<i>For detailed instructions on the use of this and the Energy Standards compliance documents, refer to the 2016 Nonresidential Manual. Note: The Enforcement Agency may require all compliance documents to be incorporated into the building plans. The NRCC-MCH-04-E are alternative compliance documents to NRCC-MCH-01-E, NRCC-MCH-02-E and NRCC-MCH-03-E for projects using only single zone packaged HVAC systems.</i>												
<b>YES</b>	<b>NO</b>	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 30%;">Form</th> <th style="width: 70%;">Title</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">✓</td> <td>NRCC-MCH-04-E (1 of 2) Certificate of Compliance. Required on plans when used.</td> </tr> <tr> <td style="text-align: center;">✓</td> <td>NRCC-MCH-04-E (2 of 2) Mechanical Acceptance Tests. Required on plans when used.</td> </tr> <tr> <td style="text-align: center;">✓</td> <td>NRCC-MCH-05-E (1 of 2) HVAC Prescriptive Requirements. It is required on plans when used.</td> </tr> <tr> <td style="text-align: center;">✓</td> <td>NRCC-MCH-05-E (2 of 2) Mechanical SWH Equipment Summary is required for all submittals with service water heating, pools or spas. It is required on plans when applicable.</td> </tr> </tbody> </table>	Form	Title	✓	NRCC-MCH-04-E (1 of 2) Certificate of Compliance. Required on plans when used.	✓	NRCC-MCH-04-E (2 of 2) Mechanical Acceptance Tests. Required on plans when used.	✓	NRCC-MCH-05-E (1 of 2) HVAC Prescriptive Requirements. It is required on plans when used.	✓	NRCC-MCH-05-E (2 of 2) Mechanical SWH Equipment Summary is required for all submittals with service water heating, pools or spas. It is required on plans when applicable.
Form	Title											
✓	NRCC-MCH-04-E (1 of 2) Certificate of Compliance. Required on plans when used.											
✓	NRCC-MCH-04-E (2 of 2) Mechanical Acceptance Tests. Required on plans when used.											
✓	NRCC-MCH-05-E (1 of 2) HVAC Prescriptive Requirements. It is required on plans when used.											
✓	NRCC-MCH-05-E (2 of 2) Mechanical SWH Equipment Summary is required for all submittals with service water heating, pools or spas. It is required on plans when applicable.											

[illegible]

STATE OF CALIFORNIA <b>REQUIRED ACCEPTANCE TESTS</b> <small>(SUSPENDED 04-04-2016, Renewed 2017)</small>		CALIFORNIA ENERGY COMMISSION NRC-CMCH-04-6 (Page 3 of 3)
CERTIFICATE OF COMPLIANCE Required Acceptance Tests		Date Prepared: 3/8/2018
Project Name: <b>Bishops at Danville, CA</b>		


  
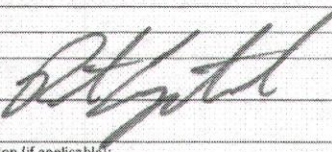
<b>DOCUMENTATION AUTHOR'S DECLARATION STATEMENT</b> I certify that this Certificate of Compliance documentation is accurate and complete.		Documentation Author Signature: 
Documentation Author Name: <b>Peter A. Leptuch</b>		
Company: <b>Peter A. Leptuch, P.E.</b>		
Address: <b>1236 Golden Eagle Court</b>		
City/State/Zip: <b>Aubrey, TX 76227</b>		Signature Date: <b>3/8/2018</b> CEAC/HERI Certification Identification (if applicable): Phone: <b>(940) 735-5127</b>

<b>RESPONSIBLE PERSON'S DECLARATION STATEMENT</b> I certify the following under penalty of perjury, under the laws of the State of California: 1. The information provided on this Certificate of Compliance is true and correct. 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer). 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations. 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this required permit application. 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.	
Responsible Designer Name: <b>Peter A. Leptuch</b>	
Company: <b>Peter A. Leptuch, P.E.</b>	
Address: <b>1236 Golden Eagle Court</b>	
City/State/Zip: <b>Aubrey, TX 76227</b>	

Responsible Designer Signature: 	
Date Signed: <b>3/8/2018</b>	
License: <b>M35700</b>	
Phone: <b>(940) 735-5127</b>	

STATE OF CALIFORNIA  
**REQUIREMENTS FOR PACKAGED SINGLE ZONE UNITS**  
 TECHNICAL SPECIFICATIONS (PART 1) (11/11/11)  
**CERTIFICATE OF COMPLIANCE**  
 Requirements for Packaged Single-Zone Units  
 Project Name: **Bishops at Danville, CA**






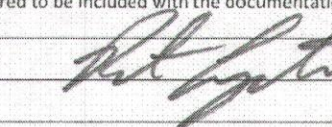
CALIFORNIA ENERGY EFFICIENCY  
 NRC-C-MCH-05-e  
 (Page 1 of 2)

Date Prepared: **3/8/2018**

Equipment Tag(s) <sup>1</sup>	T-24 Sections	Requirement <sup>2</sup>	As Scheduled <sup>3</sup>	Requirement <sup>2</sup>	As Scheduled <sup>3</sup>	Requirement <sup>2</sup>	As Scheduled <sup>3</sup>
<b>MANDATORY MEASURES</b>							
Heating Equipment Efficiency <sup>4</sup>	110.1 or 110.2(a)						
Cooling Equipment Efficiency <sup>4</sup>	110.1 or 110.2(a)						
Thermostats <sup>5</sup>	110.2(b), 110.2(c)						
Furnace Standby Loss Control <sup>6</sup>	110.2(d)						
Low Leakage A/H/J	110.2(f)						
Ventilation	120.1(b)						
Demand Control Ventilation <sup>7</sup>	120.1(c)						
Occupant Sensor Ventilation Control <sup>8</sup>	120.1(c)(3), 120.1e(3)						
Shutoff and Reset Controls <sup>9</sup>	120.2(a)						
Outdoor Air and Exhaust Damper Control	120.2(b)						
Automatic Demand Shed Controls	120.2(h)						
Economizer FQD	120.2(j)						
Duct Insulation	120.4						
<b>PRESCRIPTIVE MEASURES</b>							
Equipment is sized in conformance with 140.4 (a & b)	140.4(a & b)						
Economizer	140.4(a)						
Electric Resistance Heating <sup>10</sup>	140.4(b)						
Duct Leakage Sealing and Testing <sup>11</sup>	140.4(f)						

**Notes:**

- Provide equipment tags (e.g. AC1 or AC1 to 10). Multiple units of the same make and model with the same application and accessories can be grouped together.
- Enter the following tags as appropriate: Unit Manufacturer; Unit Model Number (including all accessories); Description of the unit (e.g. gas-pack or heat pump; rated heating capacity (enter "N/A" if no heating); and, rated cooling capacity (enter "N/A" if no cooling). For unit capacities include the units (e.g. kWhr or tons).
- For each requirement, enter the minimum requirement from the Standard in the left column (under "Standard Requirement"), in the right column (under "As Scheduled") enter the value for the units as specified.
- If there is more than one requirement (e.g. full and part load efficiency) enter both with the appropriate labels (e.g. COP and EER).
- In the left column identify the thermodynamic requirements from the Standard (e.g. programmable setback thermostat or heat pump with electric heat). In the right column indicate the capabilities of the thermostat as scheduled.
- If the unit has a furnace which is rated at >25,000 Btu/h of capacity, indicate the rated standby loss and ignition source (e.g. ID). If there is no furnace or the unit is rated for <25,000 Btu/h indicate "N/A".
- In the left column, enter both the required ventilation value from Table 120.1A and for the number of occupants Times 15 cfm/person. In the right column enter the actual minimum ventilation as scheduled. If the space is naturally ventilated enter "N/A" in the left column and "the space is naturally ventilated" in the right column.
- If the space is required to have either DCV or Occupant Sensor Ventilation Control indicate "required" in the left column (otherwise indicate "N/A" in the left column). If either DCV or Occupant Sensor Ventilation Control is provided indicate "provided" in the right column (otherwise indicate "N/A" in the right column).
- In the left column indicate the required time controls from the Standard. In the right column identify the device that provides this functionality (e.g. EMCS or programmable thermostat).
- Enter N/A if there is no electric heating. If the system has electric heating indicate which exception to 140.4(a) applies.
- If duct leakage sealing and testing is required, a NCH-04-F compliance document must be submitted.

STATE OF CALIFORNIA <b>REQUIREMENTS FOR PACKAGED SINGLE ZONE UNITS</b> CEC-RECORDS-COMPLIANCE (Version 12-18)		CALIFORNIA ENERGY COMMISSION NRC-001-05-05 (Page 2 of 2)			
<b>CERTIFICATE OF COMPLIANCE</b>					
Requirements for Packaged Single-Zone Units					
Project Name: <b>Bishops at Danville, CA</b>		Date Prepared: <b>3/8/2018</b>			
<div style="border: 1px solid black; padding: 10px;"> <b>DOCUMENTATION AUTHOR'S DECLARATION STATEMENT</b>          I, <u><b>1</b></u> certify that this Certificate of Compliance documentation is accurate and complete.  <table style="width: 100%; border: none;"> <tr> <td style="width: 50%; vertical-align: top; padding-bottom: 10px;">           Documentation Author Name:  <b>Peter A. Leptuch</b>            Company:  <b>Peter A. Leptuch, P.E.</b>            Address:  <b>1236 Golden Eagle Court</b>            City/State/Zip:  <b>Aubrey, TX 76227</b> </td> <td style="width: 50%; vertical-align: top; padding-bottom: 10px;">           Documentation Author Signature:              Signature Date:      <b>3/8/2018</b>            CA/EU/ERS Certificate Identification (if applicable):              Phone:      <b>(940) 735-5127</b> </td> </tr> </table> </div>				Documentation Author Name: <b>Peter A. Leptuch</b> Company: <b>Peter A. Leptuch, P.E.</b> Address: <b>1236 Golden Eagle Court</b> City/State/Zip: <b>Aubrey, TX 76227</b>	Documentation Author Signature:  Signature Date: <b>3/8/2018</b> CA/EU/ERS Certificate Identification (if applicable):  Phone: <b>(940) 735-5127</b>
Documentation Author Name: <b>Peter A. Leptuch</b> Company: <b>Peter A. Leptuch, P.E.</b> Address: <b>1236 Golden Eagle Court</b> City/State/Zip: <b>Aubrey, TX 76227</b>	Documentation Author Signature:  Signature Date: <b>3/8/2018</b> CA/EU/ERS Certificate Identification (if applicable):  Phone: <b>(940) 735-5127</b>				
<div style="border: 1px solid black; padding: 10px;"> <b>RESPONSIBLE PERSON'S DECLARATION STATEMENT</b>          I certify the following under penalty of perjury, under the laws of the State of California:          1. The information provided on this Certificate of Compliance is true and correct.          2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).          3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.          The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.          I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.  <table style="width: 100%; border: none;"> <tr> <td style="width: 50%; vertical-align: top; padding-bottom: 10px;">           Responsible Designer Name:      <b>Peter A. Leptuch</b>            Company:      <b>Peter A. Leptuch, P.E.</b>            Address:      <b>1236 Golden Eagle Court</b>            City/State/Zip:      <b>Aubrey, TX 76227</b> </td> <td style="width: 50%; vertical-align: top; padding-bottom: 10px;">           Responsible Designer Signature:              Date Signed:      <b>3/8/2018</b>            License:      <b>M35700</b>            Phone:      <b>(940) 735-5127</b> </td> </tr> </table> </div>				Responsible Designer Name: <b>Peter A. Leptuch</b> Company: <b>Peter A. Leptuch, P.E.</b> Address: <b>1236 Golden Eagle Court</b> City/State/Zip: <b>Aubrey, TX 76227</b>	Responsible Designer Signature:  Date Signed: <b>3/8/2018</b> License: <b>M35700</b> Phone: <b>(940) 735-5127</b>
Responsible Designer Name: <b>Peter A. Leptuch</b> Company: <b>Peter A. Leptuch, P.E.</b> Address: <b>1236 Golden Eagle Court</b> City/State/Zip: <b>Aubrey, TX 76227</b>	Responsible Designer Signature:  Date Signed: <b>3/8/2018</b> License: <b>M35700</b> Phone: <b>(940) 735-5127</b>				



STATE OF CALIFORNIA  
WATER HEATING SYSTEM GENERAL INFORMATION  
CEC-NRCC-PLB-01-E (Revised 01/18) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-PLB-01-E  
Water Heating System General Information (Page 1 of 2)  
Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

A. GENERAL INFORMATION/SYSTEM INFORMATION

01	Water Heater System Name:	<u>A O Smith Water Products DEL 40</u>
02	Water Heater System Configuration:	<u>Non-Central</u>
03	Water Heater System Type:	
04	Building Type:	
05	Total Number of Water Heaters in Systems:	<u>1</u>
06	Central DHW Distribution Type:	<u>n/a</u>
07	Dwelling Unit DHW Distribution Type:	<u>All Pipes Ins</u>

B. WATER HEATER INFORMATION  
Each water heater type requires a separate compliance document.

01	Water Heater Type:	<u>Small Storage Electric</u>
02	Fuel Type:	<u>Electric Res</u>
03	Manufacturer Name:	<u>A O Smith Water Products DEL 40</u>
04	Model Number:	
05	Number of Identical Water Heaters:	<u>1</u>
06	Installed Water Heater System Efficiency:	<u>1.00</u>
07	Required Minimum Efficiency:	<u>1.00</u>
08	Standby Loss Percent or Standby Loss Total:	<u>0.990</u>
09	Rated Input:	<u>20,478</u>
10	Pilot Energy:	
11	Water Heater Tank Storage Volume:	<u>40</u>
12	Exterior Insulation on Water Heater:	<u>0</u>
13	Volume of Supplemental Storage:	
14	Internal Insulation on Supplemental Storage:	
15	Exterior Insulation on Supplemental Storage:	

C. PLUMBING COMPLIANCE FORMS & WORKSHEETS  
Check box if worksheet is included.

For detailed instructions on the use of this and all Energy Standards compliance documents, refer to the 2016 Nonresidential Manual. Note: The Enforcement Agency may require all compliance documents to be incorporated onto the building plans.

YES	NO	Doc/Worksheet #	Title
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-PLB-01-E	Certificate of Compliance, Declaration, Required on plans for all submittals.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-PLB-01-E	Certificate of Installation, Required on plans for all submittals.
<input type="checkbox"/>	<input type="checkbox"/>	NRCC-PLB-02-E	Certificate of Installation, required on central systems in high-rise residential, hotel/motel application.
<input type="checkbox"/>	<input type="checkbox"/>	NRCC-PLB-03-E	Certificate of Installation, required on single dwelling unit systems in high-rise residential, hotel/motel application.
<input type="checkbox"/>	<input type="checkbox"/>	NRCC-PLB-21-H	Certificate of Installation, required on HERS verified central systems in high-rise residential, hotel/motel application.
<input type="checkbox"/>	<input type="checkbox"/>	NRCC-PLB-22-H	Certificate of Installation, required on HERS verified single dwelling unit systems in high-rise residential, hotel/motel application.
<input type="checkbox"/>	<input type="checkbox"/>	NRCC-STH-01-E	Certificate of Installation, required on any solar water heating.

STATE OF CALIFORNIA  
WATER HEATING SYSTEM GENERAL INFORMATION  
CEC-NRCC-PLB-01-E (Revised 01/18) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-PLB-01-E  
Water Heating System General Information (Page 2 of 2)  
Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT  
I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Peter A. Leptuch Documentation Author Signature: [Signature]  
Company: Peter A. Leptuch, P.E. Signature Date: 3/8/2018  
Address: 1236 Golden Eagle Court CEA/HERS Certification Identification (if applicable):  
City/State/Zip: Aubrey, TX 76227 Phone: (940) 735-5127

RESPONSIBLE PERSON'S DECLARATION STATEMENT  
I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Peter A. Leptuch Responsible Designer Signature: [Signature]  
Company: Peter A. Leptuch, P.E. Date Signed: 3/8/2018  
Address: 1236 Golden Eagle Court License: M35700  
City/State/Zip: Aubrey, TX 76227 Phone: (940) 735-5127

STATE OF CALIFORNIA  
CONSTRUCTION DOCUMENTS  
CEC-NRCC-COR-03-E (Revised 01/18) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-COR-03-E  
Construction Documents (Page 1 of 2)  
Project Name: Bishops Date Prepared:

A. General Information

Climate Zone:  Building Type:  Conditioned Area (ft<sup>2</sup>):

Reviewer's Name:  Reviewer's Agency:   
*Note: Design Review for each system/subsystem must be submitted*

Enforcement Agency:  Permit Number:

Enforcement Agency Use: Checked by  Enforcement Agency Use: Date

B. Design Review Checklist

Code Section	Measure	Design Reviewer		Designer Response	
		Yes, Complies	Does Not Comply	Complies	Will Include in Next Draft - State Reason
SIMPLE HVAC SYSTEMS					
DESIGN - FAN SYSTEMS					
120.1(e) 3	Measured outdoor air rates of constant volume mechanical ventilation and space-conditioning systems shall be within 10% of required outside air rate.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
140.4(c) 1	Fan power index at design conditions meets the following: 0.8 W/cfm supply air for constant volume fan systems with total horsepower over 25 hp.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Best Practices: <u>Fans appear to be correctly sized for application, accounting for a factor of safety, diversity and redundancy issues.</u>					
CONTROLS					
110.2(c)	Controls for unitary single-zone, air conditioners, heat pumps and furnaces must have a setback thermostat.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
140.4(m)	Cooling systems identified in Table 140.4-D have fan controls to vary the indoor fan airflow as a function of load: 1. DX and chilled water cooling systems that control capacity based on occupied space temperature have a minimum of 2 stages of control with no more than 66% speed operating at stage 1 and draw no more than 40% of fan power at full fan speed when operating at 66% speed. 2. Systems that control space temperature by modulating airflow to the space have proportional fan control such that at 30% airflow the power draw is no more than 30% of fan power at full fan speed. 3. Systems with air side economizer have a minimum of 2 speeds of fan control during economizer operation.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
NOTES					

STATE OF CALIFORNIA  
CONSTRUCTION DOCUMENTS  
CEC-NRCC-COR-03-E (Revised 01/18) CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-COR-03-E  
Construction Documents (Page 2 of 2)  
Project Name: Bishops Date Prepared:



DOCUMENTATION AUTHOR'S DECLARATION STATEMENT  
I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Peter A. Leptuch, P.E. Documentation Author Signature: [Signature]  
Company: Peter A. Leptuch, P.E. Signature Date: 03/08/18  
Address: 1236 Golden Eagle Ct CEA/HERS Certification Identification (if applicable):  
City/State/Zip: Aubrey, TX 76227 Phone: (940) 735-5127

RESPONSIBLE PERSON'S DECLARATION STATEMENT  
I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Person Name: Peter A. Leptuch, P.E. Responsible Person Signature: [Signature]  
Company: Peter A. Leptuch, P.E. Date Signed: 03/08/18  
Address: 1236 Golden Eagle Ct License: E19072  
City/State/Zip: Aubrey, TX 76227 Phone: (940) 735-5127

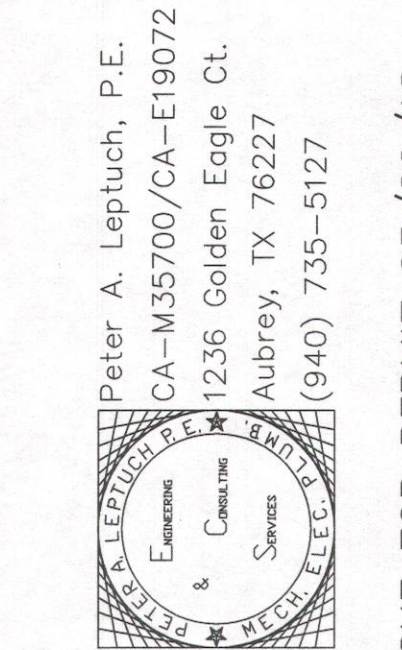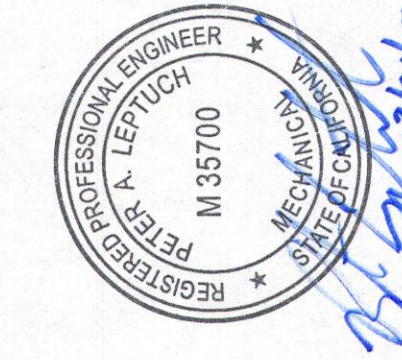



## ELECTRICAL SPECIFICATIONS

### 16010 WORK INCLUDED:

- CONTRACTOR SHALL PROVIDE THE FOLLOWING:
  - LABOR
  - SUPPLIES
  - MATERIALS
  - SHOP DRAWINGS
  - PERMITS AND INSPECTION FEES
  - CERTIFICATION OF FINAL INSPECTION AND APPROVAL
  - ONE YEAR GUARANTEE
- CONTRACTOR SHALL PERFORM THE FOLLOWING:
  - INSTALLATION OF ALL ELECTRICAL EQUIPMENT.
  - COORDINATE WITH OTHER TRADES OF ELECTRICAL EQUIPMENT INSTALLATION.
  - MATERIAL PROTECTION DURING CONSTRUCTION.
  - TEST OF ENTIRE SYSTEM IN PRESENCE OF OWNER OR HIS REPRESENTATIVE AND CORRECT ANY DEFICIENCIES DISCOVERED.
  - COORDINATION OF ELECTRICAL SERVICE AND METERING WITH LOCAL POWER COMPANY.
  - COORDINATION OF TELEPHONE SERVICE WITH LOCAL TELEPHONE COMPANY.
- GOVERNING CODES SHALL BE THE FOLLOWING:
  - LOCAL MUNICIPALITY ELECTRICAL CODE.
  - PER LATEST NATIONAL ELECTRICAL CODE (NEC)
  - UTILITY COMPANY REGULATIONS
  - AMERICANS WITH DISABILITY ACT
  - CURRENT APPLICABLE BUILDING CODES
  - LOCAL BUILDING CODES AND ORDINANCES
  - THE NATIONAL MANUFACTURER'S ASSOCIATION STANDARDS (NEMA)
  - UNDERWRITER LABORATORIES INCORPORATED STANDARD(S)
  - AMERICAN NATIONAL STANDARD INSTITUTE (ANSI)
  - THE MANUFACTURER'S RECOMMENDATION
- MATERIAL WILL BE:
  - NEW
  - UL LISTED

### 16110 RACEWAYS

- USE AND TYPES
  - SERVICE ENTRANCE -- RIGID STEEL
  - FEEDERS -- RIGID STEEL EXCEPT ABOVE 6"-0" AND INDOOR THEN EMT
  - BRANCH CIRCUIT, TELEPHONE OR COMMUNICATIONS -- EMT
  - IN EARTH OR CONCRETE -- SCHEDULE 40 PVC
  - RECESSED LIGHTING FIXTURES -- FLEXIBLE STEEL CONDUIT (SHORT BUT MAXIMUM 72")
  - OUTDOOR FINAL CONNECTION TO EQUIPMENT OR IN WET LOCATIONS -- LIQUID TIGHT FLEXIBLE STEEL CONDUIT (MAXIMUM 36")
  - ALL RACEWAYS, UNLESS SPECIFICALLY INDICATED TO BE EXPOSED, SHALL BE CONCEALED IN WALLS, CEILING OR FLOORS.
  - PAIN ALL EXPOSED RACEWAYS COLOR AS DIRECTED BY ARCHITECT.
- CONDUIT BUSHING.
  - PROVIDE INSULATED CONDUIT BUSHING AT EACH END OF EVERY CONDUIT RUN.

### 16120 WIRES AND CABLES 600 VOLTS

- COLOR CODING 

208Y/120V	480Y/277V
PHASE A	BLACK
PHASE B	BLUE
PHASE C	RED
NEUTRAL	WHITE
GROUND	GREEN
- INSULATED, THIN, THINW, XXHHW 75 DEGREE C (THIN OR BETTER, WET-RATED FOR BELOW GRADE).
- PROVIDE COPPER WIRING UNLESS ALUMINUM IS SPECIFICALLY SHOWN ON THE DRAWINGS. WHEN ALUMINUM CONDUCTORS ARE UTILIZED -- PROVIDE COMPRESSION LUG FITTINGS.
- FIXTURE WIRE, 600 VOLTS, 200 DEGREE C, #14 AWG MINIMUM STRANDED, TINNED COPPER WITH SILICONE RUBBER INSULATION AND AN OVERALL JACKET OF GLASS BRAID, AND RATED AS NEC TYPE "SF-2"

### 16130 BOXES

- ATTACHED SECURELY TO BUILDING CONSTRUCTION OR SUPPORT FROM SAME
- MASONRY BOXES SHALL BE RACO OR STEEL CITY
- EXPOSED BOXES SHALL BE CAST TYPE SIMILAR TO CROUSE HINDS TYPE FS
- ALL OTHERS SHALL BE STAMPED STEEL

### 16140 WIRING DEVICES

- RECEPTACLES
  - DUPLEX -- 15 AMPS, 125V, AC GROUNDED UNO
  - SINGLE -- 15 AMPS, 125V, AC GROUNDED UNO
  - COORDINATE COLOR OF DEVICE WITH ARCHITECT, ALSO SEE NOTES ON E1.0
  - COORDINATE FINISH AND COLOR OF COVER PLATE WITH ARCHITECT, ALSO SEE NOTES ON E1.0
- WALL SWITCHES
  - SINGLE POLE -- 20 AMPS, SINGLE THROW, QUIET TYPE, GROUNDED
  - COORDINATE COLOR OF DEVICE WITH ARCHITECT, ALSO SEE NOTES ON E1.0
  - COORDINATE FINISH AND COLOR OF COVER PLATE WITH ARCHITECT, ALSO SEE NOTES ON E1.0
- TIME CLOCK
  - FURNISH AND INSTALL A TWENTY FOUR (24), SEVEN (7) DAY TIME CLOCK INCLUDING ALL INTEGRAL WIRING AND LOAD BALANCING (PANEL) FOR CONTROLLING THE STOREFRONT SIGN AND SHOW WINDOW LIGHTING, WHETHER SUCH WORK IS OR IS NOT SHOWN ON PLANS OR SPECIFICATIONS

### 16170 PANEL BOARDS

- PANEL BOARDS SHALL HAVE, BUT NOT BE LIMITED TO THE FOLLOWING:
  - THREE PHASE, 4 WIRE, COPPER BUSING, NEMA 1 ENCLOSURE FOR INDOOR, NEMA 3R FOR OUTDOOR.
  - GROUND BUS WITH SET SCREW CONNECTIONS
  - SOLID NEUTRAL, 100K RATED WITH SET SCREW CONNECTION
  - SWITCH RATED BOLT-ON BREAKERS
  - TYPE WRITTEN DIRECTORY
  - PLAQUE, BLACK WITH 1" HIGH WHITE LETTERS TO INDICATE PANEL NAME
  - SQUARE D, GENERAL ELECTRIC OR SIEMENS

### 16190 GROUNDING

- FEEDERS AND BRANCH CIRCUITS
  - PROVIDE A GREEN INSULATED GROUND CONDUCTOR, SIZED PER THE NEC IN EACH RACEWAY

### 16200 LIGHTING FIXTURES

- COORDINATE FIXTURE TRIMS WITH CEILING IN/ON WHICH IT IS BEING INSULATED.
- MATCH VOLTAGE OF FIXTURE TO CIRCUIT TO WHICH FIXTURE IS SHOWN CONNECTED
- PROVIDE LOW TEMPERATURE HIGH EFFICIENCY ELECTRONIC BALLASTS IN FLUORESCENT FIXTURES
- PROVIDE THERMAL OVERLOAD PROTECTION IN BOTH FLUORESCENT AND INCANDESCENT FIXTURES
- NARRATIVE DESCRIPTION IN LIGHTING FIXTURE SCHEDULE TAKES PRECEDENCE OVER CATALOG NUMBER
- PROVIDE INTEGRAL DISCONNECTING MEANS FOR ALL FLUORESCENT FIXTURES PER THE NEC

### 16210 EXISTING CONDITION

- VISIT SITE AND BECOME FAMILIAR WITH EXISTING CONDITIONS IN AND AROUND THE BUILDINGS

PROTOTYPICAL "NO SURPRISE" MEP BID NOTE:  
EACH SET OF DRAWINGS IS INDIVIDUALLY ASSEMBLED AND AN ATTEMPT IS MADE TO INCLUDE LEASE SCOPE IN THE DRAWING SET. HOWEVER, THE CONTRACTOR SHALL VISIT THE SITE TO CONFIRM WHAT IS LISTED AS EXISTING BY LANDLORD, OR SIMILAR IS ACTUALLY THERE, AND IF IT IS NOT, THE CONTRACTOR SHALL PROVIDE ITEMIZED BID TO COMPLETE SUCH GAP WORK TO ENSURE ALL WORK THAT WILL BE REQUIRED BY CONTRACTOR IS INCLUDED IN THE CONTRACTOR'S SCOPE. IF THE CONTRACTOR PROVIDES A BULK BID OR SINGLE PRICE BID, IT WILL INCLUDE EVERYTHING REQUIRED TO BUILD A COMPLETE STORE, INCLUDING ANY WORK "BY OTHERS" THAT IS NOT PRESENT.

### 16220 TELEPHONE SERVICE

- SAFETY SWITCHES SHALL BE HEAVY DUTY TYPE, 600 OR 250 VOLT, WITH NUMBER OF POLES REQUIRED. FUSED SAFETY SWITCHES SHALL BE QUICK-BREAK, QUICK-BREAK MECHANISM, VISIBLE BLADES WITH REJECTION TYPE FUSE CLIPS AND NEMA CLASS "1PV" FUSES, THE SWITCHES SHALL BE NEMA 3R FOR OUTDOOR. ALL SWITCHES SHALL BE LOCKABLE.

## PLUMBING SPECIFICATIONS

### SECTION 15-A - PLUMBING

#### 15A-01 GENERAL:

- ALL PLUMBING WORK SHALL CONFORM TO THE LANDLORD'S CRITERIA, THE STATE, COUNTY, CITY, LOCAL CODES AND ORDINANCES, SAFETY AND HEALTH CODES, NFPA CODES, ENERGY CODES AND ALL OTHER APPLICABLE CODES AND REQUIREMENTS. INCORPORATE ALL REQUIREMENTS WITH THIS WORK, WHETHER SPECIFICALLY INDICATED ON PLANS OR NOT. ADVISE ARCHITECT IF REQUIREMENTS ARE CONTRARY TO THESE PLANS. IT IS INTENDED THAT THE CONTRACTOR SHALL PROVIDE A COMPLETE AND FUNCTIONAL SYSTEM.
- THIS CONTRACTOR SHALL OBTAIN AND PAY FOR ALL LICENSES, PERMITS, INSPECTIONS AND FEES REQUIRED OR RELATED TO HIS WORK.
- CONTRACTOR SHALL DETERMINE THE LOCATION OF EXISTING WATER SUPPLY AND DRAIN LINES AND MAKE PROPER CONNECTION THERETO, INCLUDING VENTS.
- ALL MATERIALS SHALL BE NEW AND SHALL FIT THE SPACE AVAILABLE. VERIFY ALL DIMENSIONS AT THE SITE.
- ALL VALVES, CLEANOUTS, ETC., SHALL BE SO LOCATED AND INSTALLED TO PERMIT ACCESS FOR SERVICE WITHOUT DAMAGE TO BUILDING OR FINISHED MATERIAL.
- ALL PLUMBING EQUIPMENT AND WORK SHALL BE GUARANTEED FOR ONE YEAR AFTER FINAL ACCEPTANCE BY LANDLORD AND TENANT.

#### 15A-02 MATERIALS

- REFER TO PLANS FOR SCHEDULES OF EQUIPMENT AND FIXTURES. AMERICAN STANDARD, KOHLER AND CRANE ARE CONSIDERED ACCEPTABLE AS EQUALS. ALL PLUMBING EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- SANITARY PIPING:
  - WHERE NOT OTHERWISE SPECIFIED THROUGHOUT THE DRAWING SET, WASTE, DRAIN AND VENT PIPING SHALL BE PER LOCAL CODE AND AUTHORITY HAVING JURISDICTION. VENT PIPING ABOVE FLOOR 2" OR SMALLER MAY BE GALVANIZED STEEL.
  - PROVIDE LINE-ITEM BID TO UTILIZE PVC, OBTAIN APPROVAL FROM INSPECTOR PRIOR TO INSTALLATION THAT PVC IS ALLOWED FOR THE SPECIFIC HVAC LAYOUT FOR THIS PROJECT.
  - INSULATE ALL HORIZONTAL RUNS OF PIPING LOCATED IN CEILING SPACES OF TENANTS IN SPACES BELOW WHEN APPLICABLE. INSULATION TO BE AS SPECIFIED FOR WATER PIPING.
  - CONDENSATE PIPING SHALL BE TYPE "L" HARD DRAWN COPPER TUBE WITH 95-5 TIN-ANTIMONY SOLDERED JOINTS AND WROUGHT COPPER FITTINGS WITH DIELECTRIC SEPARATION BETWEEN DISSIMILAR METALS. CONDENSATE PIPING BELOW ROOF DECK MAY BE PVC. PROVIDE SHARKBITE TRANSITION FROM PVC TO COPPER.
  - ANY WASTE PIPING EXPOSED IN PARKING AREAS SHALL BE PROTECTED FROM MECHANICAL DAMAGE AND SHALL BE PROVIDED WITH FREEZE PROTECTION (HEAT TAPE & INSULATION) WHERE SUBJECT TO POSSIBLE FREEZING CONDITIONS.
- POTABLE WATER PIPING
  - WATER PIPING IN CEILING SPACE AND WITHIN WALLS MAY BE TYPE "L" COPPER OR PEX, INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE SHARK-BITE TRANSITIONS, OR APPROVED EQUALS.
  - BELOW GRADE: TYPE "K", ANNEALED TEMPERED COPPER TUBE FOR PIPE SIZES 2 INCHES AND SMALLER. BRAZE ALL JOINTS.
  - WHERE APPLICABLE, TRANSITIONS BETWEEN COPPER AND PLASTIC PIPE SHALL BE MADE BY SHARKBITE OR SIMILAR TRANSITIONS, RATED FOR USE WITH SUCH MATERIALS AS ARE BEING USED.
- PIPING OF DISSIMILAR METALS MUST BE DI-ELECTRICALLY SEPARATED.
- INSULATE ALL HOT WATER, COLD WATER AND CONDENSATE PIPING WITH 1" THICK (K=0.23 @ 75°F) PIPE INSULATION WITH AN ALL SERVICE JACKET TO MEET LOCAL CODES AND UL FLAME SPREAD AND SMOKE DEVELOPED RATINGS. OWENS-CORNING OR EQUAL.
- INSULATE THE TRAP, SANITARY AND SUPPLY PIPES UNDER LAVATORY WITH 1/2" ARMSTRONG "ARMAFLEX" PIPING INSULATION OR TRUEBRO MODEL 102W "HANDI LAV GUARD" INSULATION KIT.
- INSTALL AIR CHAMBER SHOCK ABSORBERS IN BOTH HOT AND COLD LINES OF PIPING SYSTEM TO PREVENT NOISE AND DAMAGE DUE TO WATER HAMMER. J.R. SMITH 5000 SERIES ALL STAINLESS STEEL "HYDROTROLS" OR EQUAL, INSTALLED IN AN UPRIGHT POSITION.
- ALL BRANCH PIPING SYSTEMS SHALL HAVE ACCESSIBLE SERVICE VALVE. PROVIDE SHUT OFF VALVES IN THE SUPPLY PIPING TO EVERY FIXTURE. PROVIDE ACCESS DOORS WHERE NECESSARY.
- INSTALL ALL NECESSARY PIPE HANGERS, SADDLES AND CARRIERS TO PROPERLY SUPPORT ALL PIPING AND FIXTURES. HANGERS SHALL SUIT TYPE OF PIPING AND SEISMIC BRACING WHERE REQUIRED BY CODES.
- STERILIZE WATER SYSTEM IN ACCORDANCE WITH LOCAL CODES.
- CLEAN-OUTS AND FLOOR DRAINS SHALL BE INSTALLED PER LOCAL CODES.
- ESCUTCHEONS SHALL BE CHROME PLATED, SIZE AS REQUIRED AND PLACE AT ALL PIPE PENETRATIONS AT WALL, FLOORS AND CEILINGS IN FINISHED AREAS.
- LEAKAGE TESTS SHALL BE PER LOCAL CODES.
- FLASHING SHALL BE SEALED WATERTIGHT AND PERFORMED IN ACCORDANCE TO THE LANDLORD'S CRITERIA. USE LANDLORD APPROVED ROOFING CONTRACTOR WHERE APPLICABLE.
- NOT USED.
- GAS PIPING
  - PROVIDE A COMPLETE GAS PIPING SYSTEM IF APPLICABLE. REFER TO PLANS TO DETERMINE IF A GAS SYSTEM IS REQUIRED.
  - GAS LINES SHALL BE BLACK STEEL, SCHEDULE 40, ASTM A-120, WITH MALLEABLE THREADED FITTINGS FOR 2" AND SMALLER, AND WITH WELDED JOINTS FOR 2 1/2" AND LARGER.
  - PROVIDE A GAS COCK, DIRT LEG, AND UNION CONNECTION TO EACH PIECE OF EQUIPMENT.
  - PITCH PIPING AT A UNIFORM GRADE OF 1/4" IN 15 FEET UPWARD IN DIRECTION OF FLOOR. SUPPORT PIPING EVERY 6 FEET. SUPPORT AS REQUIRED BY LANDLORD CRITERIA, AS DETAILED ON DRAWINGS, OR BY STANDARD INDUSTRY PRACTICE, WHICHEVER IS MORE STRINGENT.
  - GAS PIPING EXPOSED ON ROOF MUST BE PAINTED WITH RUST-INHIBITING PAINT.
  - GAS PIPING INSTALLED IN RETURN AIR PLENUMS SHALL BE SLEEVED AND VENTED OR WELDED IN ACCORDANCE WITH THE LOCAL GAS COMPANY, LOCAL CODE AND APPLICABLE NFPA 54 CODES.
  - TESTING AND PURGING OF GAS PIPING SHALL BE DONE PER THE REQUIREMENTS OF THE LOCAL GAS COMPANY, LOCAL CODES AND APPLICABLE NFPA 54 CODES.
  - CONTACT AND COORDINATION GAS SERVICE AND METER REQUIREMENTS WITH THE LOCAL GAS COMPANY AND THE MALL'S OPERATIONS MANAGER PRIOR TO BID. INCLUDE INSTALLATION OF GAS METER COSTS IN BID.

- PROVIDE A COMPLETE GAS PIPING SYSTEM IF APPLICABLE. REFER TO PLANS TO DETERMINE IF A GAS SYSTEM IS REQUIRED.
- GAS LINES SHALL BE BLACK STEEL, SCHEDULE 40, ASTM A-120, WITH MALLEABLE THREADED FITTINGS FOR 2" AND SMALLER, AND WITH WELDED JOINTS FOR 2 1/2" AND LARGER.
- PROVIDE A GAS COCK, DIRT LEG, AND UNION CONNECTION TO EACH PIECE OF EQUIPMENT.
- PITCH PIPING AT A UNIFORM GRADE OF 1/4" IN 15 FEET UPWARD IN DIRECTION OF FLOOR. SUPPORT PIPING EVERY 6 FEET. SUPPORT AS REQUIRED BY LANDLORD CRITERIA, AS DETAILED ON DRAWINGS, OR BY STANDARD INDUSTRY PRACTICE, WHICHEVER IS MORE STRINGENT.
- GAS PIPING EXPOSED ON ROOF MUST BE PAINTED WITH RUST-INHIBITING PAINT.
- GAS PIPING INSTALLED IN RETURN AIR PLENUMS SHALL BE SLEEVED AND VENTED OR WELDED IN ACCORDANCE WITH THE LOCAL GAS COMPANY, LOCAL CODE AND APPLICABLE NFPA 54 CODES.
- TESTING AND PURGING OF GAS PIPING SHALL BE DONE PER THE REQUIREMENTS OF THE LOCAL GAS COMPANY, LOCAL CODES AND APPLICABLE NFPA 54 CODES.
- CONTACT AND COORDINATION GAS SERVICE AND METER REQUIREMENTS WITH THE LOCAL GAS COMPANY AND THE MALL'S OPERATIONS MANAGER PRIOR TO BID. INCLUDE INSTALLATION OF GAS METER COSTS IN BID.

## MECHANICAL SPECIFICATIONS

### SECTION 15-C - HEATING, VENTILATION, AIR CONDITIONING

#### 15C-01 GENERAL:

- ALL WORK SHALL CONFORM TO THE LANDLORD'S CRITERIA, THE STATE, COUNTY, CITY CODES AND ORDINANCES, SAFETY AND HEALTH CODES NFPA CODES, ENERGY CODES AND ALL OTHER APPLICABLE CODES AND REQUIREMENTS. INCORPORATE ALL REQUIREMENTS INTO THIS WORK, WHETHER SPECIFICALLY INDICATED ON PLANS OR NOT. ADVISE ARCHITECT IF REQUIREMENTS CONTRADICT THESE PLANS. IT IS INTENDED THAT THE CONTRACTOR SHALL PROVIDE A COMPLETE AND FUNCTIONAL SYSTEM.
- THIS CONTRACTOR SHALL OBTAIN AND PAY FOR ALL LICENSES, PERMITS, INSPECTIONS, AND FEES REQUIRED OR

RELATED TO HIS WORK.

- ALL MATERIALS SHALL BE NEW AND SHALL FIT THE SPACE AVAILABLE. VERIFY ALL DIMENSIONS AT THE SITE.
- ALL VALVES, DAMPERS, ETC., SHALL BE SO LOCATED AND INSTALLED TO PERMIT ACCESS FOR SERVICE WITHOUT DAMAGE TO BUILDING OR FINISHED MATERIALS.
- ALL EQUIPMENT AND WORK SHALL BE GUARANTEED FOR ONE YEAR AFTER FINAL ACCEPTANCE BY LANDLORD AND TENANT.
- LABEL ALL RTUS WITH RTU# AND TENANT'S NAME.

#### 15C-02 MATERIALS:

- REFER TO PLANS FOR SCHEDULES OF EQUIPMENT. ALL EQUIPMENT SHALL BE COMPLETE IN EVERY RESPECT WITH ALL DEVICES, APPURTENANCES, AND ACCESSORIES PROVIDED TO MEET THE DESIGN INTENT AND OPERATION OF THE SYSTEMS SHOWN ON THE DRAWINGS AND SPECIFIED HEREIN. EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. ALL AIR CONDITIONING EQUIPMENT MUST BE TRAPPED IN ACCORDANCE WITH MANUFACTURERS DATA.

- BASE BID SHALL BE FOR FIBERGLAS DUCTBOARD, PROVIDE ALTERNATE BID FOR METAL DUCTWORK.

- FABRICATE AND INSTALL RECTANGULAR AND ROUND DUCTWORK IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS" OF THE LATEST EDITION.
- INSTALL TURNING VANES IN ALL RIGHT ANGLE ELBOWS OF 1200 CFM OR MORE.
- INSTALL RIGID ROUND AND RECTANGULAR WITH SUPPORT SYSTEMS INDICATED IN SMACNA STANDARDS. PROVIDE SWAY AND SEISMIC BRACING AS REQUIRED BY STATE AND LOCAL CODES OR BY LANDLORD.
- ALL JOINTS AND SEAMS SHALL BE SEALED. TOTAL LEAKAGE SHALL NOT EXCEED 5% FOR THE SYSTEM.
- ALL DUCTWORK SHALL BE INSTALLED WITH INSIDE CLEAR DIMENSIONS AS NOTED ON DRAWINGS. WHERE DUCTWORK SIZE IN LARGER THAN CONNECTED DEVICE SMOOTH DUCT TRANSITIONS ARE TO TAKE PLACE JUST PRIOR TO DEVICE CONNECTIONS.

- FLEXIBLE COLLARS AT EQUIPMENT SHALL BE PROVIDED IN ALL CONNECTIONS BETWEEN VIBRATING EQUIPMENT AND DUCTS OR CASINGS. FLEXIBLE CONNECTIONS SHALL BE CONSTRUCTED OF NEOPRENE-COATED FLAMEPROOF FABRIC. PROVIDE ADEQUATE JOINT FLEXIBILITY TO ALLOW FOR MOVEMENT AND PREVENT THE TRANSMISSION OF VIBRATION.

- CALIFORNIA PROHIBITS FLEXIBLE DUCTWORK IN COMMERCIAL APPLICATIONS. ELSEWHERE FLEXIBLE AIR DUCT AT AIR DEVICES SHALL BE 1" INSULATED CLASS 1 AND RATED FOR THE OPERATING PRESSURE OF THE SYSTEM. DUCT CONSTRUCTION MATERIAL MUST ADHERE TO LOCAL CODES AND LANDLORD'S REQUIREMENTS.

- PROVIDE MANUAL LOCKING QUADRANT VOLUME CONTROL DAMPERS WITH HANDLE OPERATORS IN EACH BRANCH DUCT AND AS SHOWN ON PLANS TO FACILITATE AIR BALANCING. ALL RECTANGULAR DAMPERS IN OUTSIDE AIR, RELIEF AIR, EXHAUST OR RETURN AIR DUCTS ARE TO BE OF OPPOSED BLADE TYPE.

- PROVIDE PRIMARY FIRE DAMPERS WHERE INDICATED OR REQUIRED BY CODES. FIRE DAMPERS SHALL BE UL LABELED. FIRE DAMPERS SHALL HAVE THE BLADES OUT OF THE AIRSTREAM AND A 165°F FUSIBLE LINK, TYPE B, AS MINIMUM.

#### G. DUCTWORK INSULATION

- INSTALL INSULATION PRODUCTS IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS AND IN ACCORDANCE WITH RECOGNIZED INDUSTRY PRACTICES. INSULATION MUST COMPLY WITH NFPA 80A.
- DUCT SIZES SHOWN ON DRAWINGS ARE INSIDE CLEAR DIMENSIONS. ALL SUPPLY AND RETURN AIR RECTANGULAR DUCTWORK SHALL BE INTERNALLY INSULATED WITH 1" THICK, 1 1/2" LB. DENSITY LINER (C=0.28 @ 75°F.). LINER IS TO HAVE A COATED SURFACE EXPOSED TO AIRSTREAM TO PREVENT EROSION. APPLY ADHESIVES AND MECHANICAL FASTENERS AS RECOMMENDED BY SMACNA AND THE MANUFACTURER TO PREVENT LINER SEPARATION FROM THE DUCT. ALL TRANSVERSE EDGES TO BE COATED WITH ADHESIVE.
- ALL ROUND AND OUTSIDE AIR DUCTWORK SHALL BE EXTERNALLY INSULATED WITH A MINIMUM OF 1 1/2" THICK, #1 DENSITY (P=5.6) DUCT WRAP WITH VAPOR BARRIER. VAPOR BARRIER IS TO BE MAINTAINED THROUGHOUT DUCT SYSTEM. ALL JOINTS MUST BE TAPED TO THAT NO INSULATION FIBER IS VISIBLE. EXTEND DUCTWORK INSULATION WITHOUT INTERRUPTION THROUGH WALLS, FLOORS, AND SIMILAR PENETRATIONS.
- ALL INSULATION SHALL HAVE A FLAME SPREAD RATING OF NOTE MORE THAN 25 AND A SMOKE DEVELOPED RATING OF NO HIGHER THAN 50 WHEN TESTED IN ACCORDANCE WITH ASTM C 411, OR AS REQUIRED BY LOCAL CODES.

#### H. TESTING, ADJUSTING AND BALANCING:

- TESTING, ADJUSTING AND BALANCING OF ALL WORK SHALL BE MADE BY AN INDEPENDENT CONTRACTOR WHO IS CURRENTLY LICENSED AS A MECHANICAL CONTRACTOR (HARD) OR NATIONAL ENVIRONMENTAL BALANCE BUREAU (NEBB) BALANCING CONTRACTOR. ALL BALANCING WORK MUST BE COMPLETE AND DONE IN ACCORDANCE WITH THE MOST RECENT STANDARDS OF THEIR SOCIETY. PAYMENT OF ALL COSTS FOR TESTING AND BALANCING SHALL BE INCLUDED IN THE BID.

- BALANCE AIR AND WATER QUANTITIES TO WITHIN +/- 5% OF THAT INDICATED ON THE DRAWINGS. ANY REQUIRED CHANGES IN SHEAVES, BELTS, PULLEYS OR THE ADDITION OF DAMPERS REQUIRED TO ACHIEVE SPECIFIED FLOW RATES SHALL BE PERFORMED BY THE HVAC CONTRACTOR WITH NO ADDITIONAL COST TO THE TENANT.

- FOUR COPIES OF THE BALANCE REPORT SHALL BE SUBMITTED TO TENANT AND LANDLORD FOR APPROVAL.

#### I. RECORD DRAWINGS:

- AT THE END OF THE PROJECT THIS CONTRACTOR SHALL SUBMIT 4 COPIES OF RECORD DRAWINGS SHOWING EXACT LOCATIONS OF UNITS, DUCTS, DIFFUSERS, ETC.

#### J. ECONOMIZER:

- GENERALLY, AN ECONOMIZER IS REQUIRED BY THE LATEST VERSIONS OF IECC IN ALL JURISDICTIONS EXCEPT SOUTH FLORIDA (CLIMATE ZONE 1). THE MECHANICAL CONTRACTOR SHALL ORDER ALL SPLIT SYSTEMS, FAN COIL UNITS, WATER SOURCE HEAT PUMPS, OR OTHER MECHANICAL UNITS THAT ARE TO BE OPERATED MORE THAN 20 HOURS PER WEEK WITH ECONOMIZERS, FACTORY INSTALLED WHERE POSSIBLE OR WITH CAPABILITY FOR ECONOMIZER WHERE CONTROLS ARE TO BE FIELD INSTALLED, AND TO INSTALL ALL COMPONENTS -- SUCH AS OUTSIDE AIR DUCTS AND DUAL ENTHALPHY SENSORS, CONTROLS, ETC. ON SPLIT SYSTEMS A NECESSARY TO MEET LOCAL CODE. THE CONTRACTOR SHALL VERIFY WITH THE LOCAL INSPECTOR WHAT VERSION OF ENERGY CODE IS ENFORCED IN THE JURISDICTION OF THE PROJECT AND FOR UNITS OTHER THAN PACKAGED ROOFTOP UNITS MAY OMIT THE ECONOMIZER PACKAGE WHERE THE AHJ DOES NOT REQUIRE IT.

### ROOFTOP UNIT SEQUENCE OF OPERATION -- CO2 SENSOR & ECONOMIZER

FAN CONTROL:  
THE SUPPLY FAN IS TO RUN CONTINUOUSLY DURING THE OCCUPIED MODE AND CYCLE ON AND OFF DURING THE UNOCCUPIED MODE BASED ON A CALL FOR HEATING OR COOLING. THE UNOCCUPIED SET POINT FOR COOLING WILL BE 85° FAHRENHEIT AND 80° FAHRENHEIT FOR HEATING.

THERMOSTAT:  
THE ADJUSTABLE ROOM THERMOSTAT WITH AUTOMATIC HEATING/COOLING CHANGEOVER SHALL CONTROL THE SPACE TEMPERATURE BASED ON SET POINT. THE CONTROL OF THE OCCUPIED/UNOCCUPIED SETBACK MODE SHALL BE THROUGH THE LIGHT SENSING FUNCTION OF THE THERMOSTAT. PROVIDE 24/7 CONTROLLABLE TYPE. THERMOSTATS SHALL HAVE AUTOMATIC CHANGEOVER, 5 DEGREE DEADBAND (TEMPERATURE SET-POINT OVERLAP) RESTRICTIONS) AND SHALL ALLOW AUTOMATIC RESTART AND TEMPORARY OPERATION AS REQUIRED FOR MAINTENANCE, PER ENERGY CODE.

SAFETIES:  
THE UNIT SHALL BE TOTALLY DISABLED WHEN THE DUCT MOUNTED SMOKE DETECTOR IS ACTIVATED. PROVIDE REMOTE TEST STATION/ALARM WHEN REQUIRED BY CODE. PROVIDE LANDLORD REQUIRED SEQUENCE OR INTERFACE AS REQUIRED.

COOLING CONTROL:  
UPON A CALL FOR COOLING, THE FIRST STAGE OF COOLING WILL BE ENABLED AND WILL OPERATE UNTIL THE SPACE TEMPERATURE IS SATISFIED. IF THE SPACE TEMPERATURE CONTINUES TO INCREASE THEN THE SECOND STAGE OF COOLING WILL BE ENABLED (IF APPLICABLE.)

HEATING CONTROL:  
UPON A CALL FOR HEATING, THE FIRST STAGE OF HEATING WILL BE ENABLED AND WILL OPERATE UNTIL THE SPACE TEMPERATURE IS SATISFIED. IF THE SPACE TEMPERATURE CONTINUES TO DECREASE THEN THE SECOND STAGE OF HEATING WILL BE ENABLED (IF APPLICABLE.)

VENTILATION/ECONOMIZER CONTROL:  
(WHERE REQUIRED BY A.H.J, OR WHERE CALLED FOR ELSEWHERE IN THE DRAWING SET):

THE OUTSIDE AIR DAMPER SHALL BE OPEN DURING THE OCCUPIED HEATING AND COOLING MODES FOR CODE REQUIRED MINIMUM OUTSIDE AIR VENTILATION AND SHALL REMAIN CLOSED DURING THE UNOCCUPIED MODE. IN THE OCCUPIED MODE THE CO2 SENSOR SHALL MODULATE THE OUTSIDE AIR DAMPER WHEN THE UNIT OPERATING IN THE MINIMUM OUTSIDE AIR MODE.

THE ECONOMIZER MODE IS ENTHALPHY CONTROLLED AND WILL BE OPERATIONAL WHENEVER COOLING IS REQUIRED AND THE OUTSIDE AIR ENTHALPHY IS AT OR BELOW THE RETURN AIR ENTHALPHY. THE POWER EXHAUST WILL OPERATE WHENEVER THE OUTSIDE AIR DAMPER IS OPEN MORE THAN 60%.

## FIRE PROTECTION SYSTEM

- SPRINKLER SYSTEM TO BE NFPA 13 AND SPRINKLER MONITORED WITH OCCUPANCY NOTIFICATION COMPLYING WITH H.C. AMENDMENTS -- 903.4.
- FIRE SPRINKLER AND FIRE ALARM WORK SHALL BE DONE UNDER A SEPARATE PERMIT (DESIGN/BUILD) BY LICENSED FIRE SPRINKLER AND FIRE ALARM CONTRACTORS.

### 16270 FIRE ALARM SYSTEM

- FURNISH AND INSTALL FIRE ALARM POWER BOOSTER TO EXISTING BUILDING FIRE ALARM PANEL AS INDICATED ON DRAWINGS. THE FIRE ALARM SYSTEM NEW DEVICES SHALL BE FORMALLY PLANNED BY A LICENSED FIRE ALARM CONTRACTOR WHO SHALL SUBMIT SIGNED AND SEALED DRAWINGS, IF REQUIRED FOR PERMIT, AND SHALL SUPERVISE AND CERTIFY THE INSTALLATION. FIRE ALARM SYSTEM CONTRACTOR SHALL REVIEW THE MECHANICAL DRAWINGS AND PROVIDE AND INSTALL DUCT SMOKE DETECTORS AS REQUIRED IN THE STANDARD MECHANICAL CODE AND BY THE LOCAL FIRE MARSHALL. DESIGN SHALL COMPLY WITH NFPA 72. PROVIDE VOICE EVACUATION MODULES WITH ALL NECESSARY APPURTENANCES.

- REMOTE ANNUNCIATOR  
PROVIDE AN ALPHANUMERIC ANNUNCIATOR WITH INTEGRAL ALPHANUMERIC DISPLAY, SYSTEM CONTROL/TEST SWITCHES, KEY OPERATED ENABLED SWITCH AND BACK BOX. COORDINATE LOCATION WITH AUTHORITY HAVING JURISDICTION PRIOR TO ROUGH-IN.

- MANUAL STATIONS  
PROVIDE ANALOG ADDRESSABLE MANUAL STATIONS WITH PROTECTIVE COVERS (WITH INTEGRAL HORN AND 9V BATTERY) AS SHOWN ON THE PLANS.

- SYSTEM SMOKE DETECTORS  
PROVIDE ANALOG ADDRESSABLE PHOTOELECTRIC SMOKE DETECTORS WITH BASES AS SHOWN.

- DUCT MOUNTED SMOKE DETECTORS  
PROVIDE DUCT MOUNTED ANALOG ADDRESSABLE PHOTOELECTRIC SMOKE DETECTORS WITH SAMPLING TUBES AND ADDRESSABLE CONTROL RELAYS AS SHOWN ON THE PLANS AND AS REQUIRED TO COMPLY WITH THE MECHANICAL CODE. WHERE --IN-DUCT SMOKE DETECTORS ARE INSTALLED IN CONCEALED LOCATIONS MORE THEN 10 FEET ABOVE THE FINISHED FLOOR OR IN ARRANGEMENT WHERE THE DETECTORS ALARM OR SUPERVISORY INDICATOR IS NOT VISIBLE TO RESPONDING PERSONNEL, THE DETECTOR SHALL BE PROVIDED WITH REMOTE ALARM OR SUPERVISORY INDICATION IN A LOCATION ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION. ADDITIONALLY, LABEL REMOTE ALARMS TO INDICATE BOTH THEIR FUNCTION AND THE AIR HANDLING UNITS(S) ASSOCIATED WITH EACH DETECTOR.

- ADDRESSABLE MONITOR MODULES  
PROVIDE ADDRESSABLE MONITOR MODULES AS SHOWN ON THE PLANS TO MONITOR SPRINKLER FLOW SWITCHES, SPRINKLER VALVES, SUPERVISORY SWITCHES AND SPRINKLER FIRE PUMP (AS REQUIRED)

- ADDRESSABLE CONTROL MODULES  
PROVIDE ADDRESSABLE CONTROL MODULES AS REQUIRED FOR INTERFACE WITH THE ELEVATOR CONTROLS, ELEVATOR POWER CONTROLS AND HVAC CONTROLS (AS REQUIRED)

- ALARM SIGNALS  
PROVIDE 15/75--WW SPEAKER/STROBE ALARM SIGNALS AS SHOWN ON THE PLANS FOR ALL PUBLIC AREAS. PROVIDE 15/75--WW STROBE VISUAL ALARM SIGNALS FOR ALL STROBE ONLY LOCATIONS AS SHOWN ON THE PLANS, 110 CANDELA.

- WIRING  
WIRING SHALL BE CONCEALED IN CONDUIT. PROVIDE WIRING AND CONDUIT AS DIRECTED BY THE MANUFACTURER'S AUTHORIZED DISTRIBUTOR.

- APPLICABLE CODES AND STANDARDS  
ALL EQUIPMENT SHALL BE UL LISTED FOR ITS INTENDED USE.

ALL RACEWAYS AND WIRING SHALL BE INSTALLED IN COMPLIANCE WITH NFPA STANDARD 70 (NATIONAL ELECTRIC CODE)

NFPA STANDS 71 AND 72

NFPA 101 (LIFE SAFETY CODE)

AMERICANS WITH DISABILITIES ACT (ADA)

STANDARD BUILDING CODE (SBC)

APPLICABLE LOCAL AND NATIONAL CODES AND AUTHORITIES HAVING JURISDICTION

- SYSTEM OPERATION  
ACTUATION OF ANY FIRE ALARM INITIATING DEVICE SHALL IMMEDIATELY CAUSE THE FOLLOWING ACTIONS TO BE INITIATED

- IDENTIFY THE TYPE OF ALARM, SPECIFIC DEVICE AND LOCATION ON THE BACK LIT LCD DISPLAY AT THE BUILDING FIRE ALARM CONTROL PANEL AND AT THE REMOTE ANNUNCIATORS
- CAUSE THE SYSTEM ALARM LED TO FLASH AT THE FIRE ALARM CONTROL PANEL
- CAUSE ALL SYSTEM HORNS TO SOUND
- CAUSE ALL VISUAL ALARMS SIGNALS TO FLASH
- ACTIVATE THE DIGITAL COMMUNICATOR TO REPORT THE TYPE OF ALARM AND LOCATION TO THE REMOTE CENTRAL MONITORING STATION. COORDINATE CONNECTIONS WITH OWNER'S REPRESENTATIVE.
- ACTIVATE SIGNALS TO THE BUILDING DOOR LOCK CONTROLS TO DEACTIVATE LOCKS
- ACTIVATE SIGNALS TO THE HVAC CONTROLS TO INITIATE SHUT DOWN OR REROUTING OF AIR HANDLING SYSTEMS

- ACTIVATION OF ANY SPRINKLER VALVE SUPERVISORY SWITCH SHALL AUTOMATICALLY
  - CAUSE THE SYSTEM SUPERVISORY LED TO FLASH AND AN AUDIBLE INDICATOR TO SOUND AT THE CONTROL PANEL AND REMOTE ANNUNCIATOR.
  - IDENTIFY THE SUPERVISORY CONDITION, SPECIFIC DEVICE AND LOCATION ON THE BACK LIT LCD DISPLAY AT THE SYSTEM CONTROL PANEL AND THE REMOTE ANNUNCIATOR.

## ADDITIONAL FIRE PROTECTION NOTES:

### DANVILLE, CA NOTE

THIS BUILDING IS SPRINKLERED AND HAS A BUILDING FIRE ALARM SYSTEM. FIRE PROTECTION DRAWINGS TO MODIFY EXISTING SYSTEMS WILL BE SUBMITTED SEPARATELY FOR SEPARATE PERMIT BY LICENSED FIRE SPRINKLER/FIRE ALARM CONTRACTOR.

DRAWING INFORMATION IS DISTRIBUTED THROUGHOUT THE DOCUMENT SET. CONTRACTORS SHALL THOROUGHLY REVIEW ALL SHEETS AND SHALL NOTIFY CONSTRUCTION MANAGER FOR DIRECTION IF DISCREPANCIES ARE FOUND.

REQUIRED CONTRACTORS:  
NO REQUIRED CONTRACTORS.

RECOMMENDED CONTRACTORS:  
GP FIRE PROTECTION: 925-467-0985

GH A

Architecture / Development  
14901 Quorum Drive  
Suite 300  
Dallas Texas 75254


Ph: (972) 239-8884  
Fax: (972) 239-5054



BISHOPS -- TENANT FINISHOUT  
DANVILLE SQUARE  
39 RAILROAD AVE  
DANVILLE, CA 94526


DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS--NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION

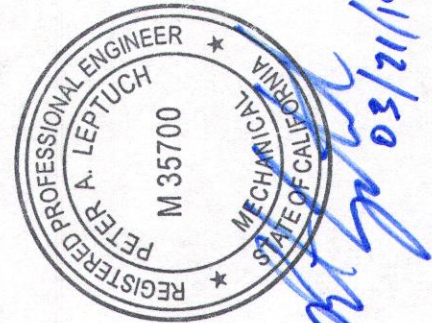

ISSUE

Peter A. Leptuch, P.E.  
CA-M35700/CA-E19072  
1236 Golden Eagle Ct.  
Aubrey, TX 76227  
(940) 735-5127

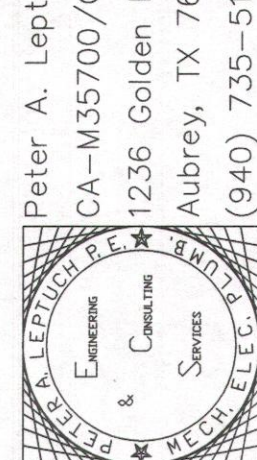

PROJECT NUMBER  
C170445

SHEET NUMBER

MEP1.0

SPECIFICATIONS

DATE OF THIS PRINTING -- 03/21/18



## PLUMBING FIXTURE SCHEDULE

MARK	FIXTURE	CW	HW	W	V	ADA	DESCRIPTION
WC	WATER CLOSET	1"	---	4"	2"	YES	FIXTURES: SLOAN WETS 2020.1001-1.28 MANUAL SLOAN ROYAL 111-1.28 HET FLUSHOMETER AND ADA COMPLIANT HET WATER CLOSET (SUPPLY LINES 1") COLOR: TBD SEAT: CHAMPION #5325.010 (DISTRIBUTION LINES: 1-1/4")
LAV	LAVATORY	1/2"	1/2"	2"	1-1/2"	YES	FIXTURE: AMERICAN STANDARD "LUCERNE" WALL-HUNG LAVATORY, WITH VITREOUS CHINA. FAUCET: AMERICAN STANDARD "MONTEREY" MODEL #8114.114 SINGLE CONTROL CENTERSET FAUCET. CAST BRASS BODY LESS POP-UP DRAIN, ROD AND HOLE. MIXING VALVES: POWERS #LM495-1; ASSE 1070, SET AT 110°F, 0.35 GPM, VANDAL-RESISTANT, PRESSURE COMPENSATING MULTI-LAMINAR SPRAY.
SS	SERVICE SINK	1/2"	1/2"	3"	1-1/2"	YES	FIXTURES: FLOOR MOUNTED MOP SINK 24"x24", MODEL -FIAT MSB2424. PROVIDE LOW FLOW AERATOR FAUCET: MOEN #8232 W/ ADA LEVER HANDLES. SS DOME STRAINER AND LINT BASKET.
FD	FLOOR DRAIN	---	---	3"	1-1/2"	---	3" CAST IRON FLOOR DRAIN WITH POLISHED NICKEL BRONZE TOP. ZURN Z-415-J (SQUARE) J.R. SMITH NO 2005Y-A, JOSAM3000-S OR APPROVED EQUAL. ADJUSTABLE STRAINER WITH FLASHING CLAMP DEVICE, PROVIDE TRAP PRIMER CONNECTION PER LL REQUIREMENTS.
LB	WASHING MACHINE BOX	VARIES	VARIES	2"	1-1/2"	---	FIXTURE: OATEY #38747 WITH INTEGRAL SHOCK ARRESTERS OR EQUAL
TP	TRAP PRIMER	---	---	---	---	---	FIXTURE: PPP PR-500 / SUPPLIES: McGuire #2165CC.
SB	SHAMPOO BOWL	3/4"	3/4"	2"	1-1/2"	YES	COLLINS SQUARE PORCELAIN BOWL, CB80, WHITE, WITH JEFFCO 570 SINGLE HANDLE FAUCET, SPRAY HOSE, VACUUM BREAKER, DRAIN ASSEMBLY, AND MOUNTING BRACKET. 19"W x 20"D x 10"H. TRADITIONAL SIDEWASH BOWL. PROVIDE HAIR TRAP (MARBLE 1701) REQUIRED VENDOR AND CONTACT: COSMOPROF - GREG MCCLELLAN, SALON DESIGNS AND SALES, (425) 457-2844, GMcClellan@CosmoProfBeauty.com MIXING VALVES: POWERS #LM495-1; ASSE 1070, SET AT 110°F.
HS	DROP-IN SINK	1/2"	1/2"	2"	1-1/2"	YES	PROVIDED BY OWNER, INSTALLED BY G.C. HAIR TRAP (MARBLE 1701) AND MIXING VALVE (POWERS #LM495-1; ASSE 1070) TO BE FURNISHED AND INSTALLED BY G.C.
RP	RECIRCULATION PUMP	---	1"	---	---	---	GRUNDFOS UP10-16 BU SERIES. 20A/1P POWER, PROVIDE WITH AQUASTAT AND TIMER. 36"-203" SERVICE. 2.2 GPM. 3.9 TOTAL HEAD FT. 115 VOLTS.
WH	WATER HEATER (ELECTRIC)	1"	1"	---	---	---	AO SMITH DEL-60, OR EQUAL. TWO 3.0 KW STAGES. 24.00" DIAMETER. 30" DRAIN PAN. MAX OPERATING WEIGHT APPROXIMATELY 480 LBS. 208 VOLT, 3 PHASE. 60 STORAGE GALLONS, 6KW. GLASS LINING. EXPANSION TANK: WATTS NO. DELTA-12, 5-GALLON TANK VOLUME, 2.3-GALLON ACCEPTANCE VOLUME, 14" HEIGHT, 10" DIAMETER.
DF	DRINKING FOUNTAIN	1/2"	---	2"	1-1/2"	YES	ELKAY - EZSTLWSLK BARRIER FREE BI-LEVEL DRINKING FOUNTAIN WITH ELKAY - EZH2O BOTTLE FILLING STATION. REFER TO ELKAY TEMPLATE FOR WATER ROUGH-IN HEIGHT, CANE APRON, APPROX. 19" AFF. PROVIDE APRON LKAPREZL, INSTALL PER ADA.

- NOTES:
1. ALL FIXTURES MAY BE SUBSTITUTED FOR APPROVED EQUALS.
  2. NOT ALL FIXTURES USED ON ALL JOBS.
  3. ALL FIXTURES - PROVIDE TRAP PRIMERS WHERE REQUIRED BY LOCAL CODES AND/OR AHJ.

### PLUMBING GENERAL NOTES

1. CONTRACTORS AND SUB CONTRACTORS SHALL CAREFULLY REVIEW THE CONSTRUCTION DOCUMENTS. INFORMATION REGARDING THE COMPLETE WORK IS DISPERSED THROUGHOUT THE DOCUMENT SET AND CANNOT BE ACCURATELY DETERMINED WITHOUT REFERENCING THE COMPLETE DOCUMENT SET.
2. COORDINATE WITH THE WORK OF OTHER SECTIONS, EQUIPMENT FURNISHED BY OTHERS, REQUIREMENTS OF THE OWNER AND CONSTRAINTS OF THE EXISTING CONDITIONS OF THE PROJECT SITE.
3. ALL ROOFING WORK (CUTS, REPAIRS, SPUD WORK, ETC.) SHALL BE PERFORMED BY THE LANDLORD'S APPROVED ROOFING CONTRACTOR.
4. DRAWINGS FOR THE PLUMBING WORK ARE DIAGRAMMATIC SHOWING THE GENERAL LOCATION, EQUIPMENT TYPE AND LAYOUT, THE DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENT. REFER TO MANUFACTURERS STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE PLUMBING, CONNECTIONS, OFFSETS, ACCESSORIES AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.
5. ALL WORK SHALL COMPLY WITH STATE AND LOCAL CODE REQUIREMENTS AS APPROVED AND AMENDED BY THE AUTHORITY HAVING JURISDICTION INCLUDING APPLICABLE LOCAL, STATE AND NATIONAL CODES AT THE TIME OF THE PROPOSAL. PURCHASE ALL PERMITS ASSOCIATED WITH THE WORK AND OBTAIN ALL INSPECTIONS REQUIRED BY CODE.
6. WASTE PIPING SHALL BE INSET FROM PERIMETER WALLS EXCEPT AT FIXTURE CONNECTIONS TO AVOID STRUCTURAL ELEMENTS AND ALLOW FOR REPAIRS WITHOUT TEARING OUT A DEMISING WALL, ETC.
7. TRENCHING OF EXISTING REINFORCED CONCRETE FLOOR SLAB IS TO BE KEPT TO A MINIMUM QUANTITY AND WIDTH. WHERE CODES PERMIT, GROUP UNDER FLOOR UTILITIES IN SINGLE TRENCHES. THE MINIMUM TRENCH WIDTH IS TO BE TWELVE INCHES (12"). DOWEL NEW SLAB INFILLS INTO EXISTING SLAB EDGES. PROVIDE SLAB INFILL STEEL REINFORCING TO MATCH EXISTING. COAT SAWCUT SLAB EDGES WITH HIGH-STRENGTH BONDING AGENT. LAY IN NEW UNDERSLAB VAPOR BARRIER, LAP AND SEAL TO EXISTING VAPOR BARRIER.
8. TENANT IS NOT TO SUSPEND ANY ITEMS FROM THE BOTTOM OF THE ROOF DECK. TENANT IS NOT TO SUSPEND ANY ITEMS FROM THE BOTTOM ROOF JOIST OR JOIST GIRDER CHORDS, WITHOUT WRITTEN APPROVAL OF THE BUILDING SHELL STRUCTURAL ENGINEER OF RECORD. TENANT IS TO SUBMIT PROPOSED DETAILS, FOR ITEMS SUSPENDED FROM THE ROOF STRUCTURE, FOR REVIEW BY SHELL STRUCTURAL ENGINEER.
9. IN GENERAL, NO DUCTWORK, CONDUITS, PIPES, BANNERS, SIGNAGE, OR CURTAIN/SUSPENDED FURR-DOWNS OR WALL ARE TO BE SUSPENDED FROM THE BOTTOM OF THE ROOF STRUCTURE, WITHOUT APPROVAL. NO TENANT FINISHOUT WORK IS TO BE SUSPENDED FROM ANY WORK BY ANOTHER TRADE, FROM JOIST BRIDGING OR FROM X-BRACING OR FROM THE BOTTOM OF THE ROOF DECK. SUSPENDED TEE GRID CEILINGS AND LIGHT FIXTURES MAY BE SUSPENDED FROM THE BOTTOM ROOF JOIST AND BOTTOM ROOF JOIST GIRDER CHORDS IN MAXIMUM WEIGHTS OF SEVENTY-FIVE (75) POUNDS AT BOTTOM CHORD JOIST PANEL POINTS, WITHOUT ADDED STEEL ANGLE REINFORCING UP TO TOP JOIST CHORDS. SUSPENDED CEILINGS AND LIGHT FIXTURES ARE NOT TO BE SUSPENDED FROM THE BOTTOM OF THE ROOF DECK.
10. SET MAXIMUM TEMPERATURE AT HAND SINKS AT 110°F.
11. PROVIDE HEAT TRACE ON ALL PIPES INSTALLED IN AREAS SUBJECT TO FREEZING. INSTALL PIPING ON CONDITIONED SIDE OF BUILDING INSULATION.
12. PROVIDE CUTOFF ABOVE CEILING, IN ADDITION TO AT FIXTURE WHERE REQUIRED BY A.H.J.
13. LABEL ALL ABOVE CEILING VALVES AND OR EQUIPMENT ON T-BAR GRID, ON ACCESS PANELS SERVING SUCH EQUIPMENT. USE 1/2" TEXT ON WHITE PEEL AND STICK LABELS.

### PLUMBING LEGEND

HW	HOT WATER SUPPLY LINE
CW	COLD WATER SUPPLY LINE
X" SAN	SANITARY WASTE LINE
○	PIPE DROP
---	RISER VENT (DASHED)
TP	TRAP PRIMER
→	CONTINUATION
—	END CAP
✕	ISOLATION / SHUT-OFF VALVE
▨	EXTENT OF SAWCUTTING/ TRENCHING
M	WATER SUBMETER, BETWEEN VALVE AND 1ST FIXTURE.
R	REMOTE READOUT FOR SUBMETER, +54" VERIFY LOCATION WITH OWNER'S REP.
●	CONNECTION OF NEW TO EXISTING.
RPZ	REDUCED PRESSURE ZONE BACK FLOW ASSEMBLY.
↔	CHECK VALVE
RP	RECIRCULATION PUMP.
WCO	WALL CLEAN OUT
FCO	FLOOR CLEAN OUT
VTR	VENT THRU ROOF
(EX.)	EXISTING PIPING
X"V	VENT

#### CALIFORNIA NOTE:

ALL PLUMBING FIXTURES AND FITTINGS SHALL MEET THE STANDARDS REFERENCED IN TABLE 1401.1 OF THE 2018 CPC AND CGSBC CHAPTER 6. CGSBC SECTION 5.303.6

ALL PLUMBING AND ELECTRICAL SHALL BE CONCEALED WITHIN WALLS OR ABOVE CEILING. SOME LINES MAY BE OFFSET TO SHOW DIAGRAMMATIC CONNECTIONS.

#### BISHOPS TYPICAL:

MINIMUM WATER SIZE WITH FLUSH VALVE TOILETS SHALL BE 1-1/4". MINIMUM WATER LINE SIZE WITH FLUSH TANK TOILETS MAY BE 3/4" OR 1" DEPENDING ON SITE CONDITIONS.

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ARCHITECT, LANDLORD OR TENANT OF ANY DISCREPANCIES ENCOUNTERED ON THE PLANS OR IN EXISTING CONDITIONS PRIOR TO COMMENCEMENT OF WORK. BIDDERS ARE TO VISIT THE SITE AND FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS AND SATISFY THEMSELVES AS TO THE NATURE AND SCOPE OF WORK. THE BASE BID SHALL REFLECT MODIFICATIONS TO SYSTEMS AND DEVICES AS REQUIRED BY STATE AND LOCAL CODES WHETHER INDICATED OR NOT ON CONTRACT DOCUMENTS. THE SUBMISSIONS OF A BID WILL BE EVIDENCE THAT SUCH AN EXAMINATION AND COMPLIANCE WITH GOVERNING CODES / REQUIREMENTS HAS BEEN MADE. LATER CLAIMS FOR LABOR, EQUIPMENT, OR MATERIALS REQUIRED OR FOR DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN, HAD AN EXAMINATION AND CODE REVIEW BEEN MADE, WILL NOT BE ALLOWED.

DANVILLE, CA NOTE:  
PROVIDE HAIR TRAP (MARBLE 1701) UNDER EACH SINK.

#### CALIFORNIA NOTE:

ALL FIXTURES SHALL BE THE MINIMUM WATER EFFICIENCY RATES OF THE FOLLOWING FIXTURES PER CGSBC TABLE 5.303.2.2  
A. SHOWERHEADS - 2.0 GPM @ 80 PSI.  
B. LAVATORIES - 0.5 GPM @ 60 PSI.  
C. WATER CLOSETS - 1.28 GALLONS/FLUSH.  
D. URINALS (FLOOR MOUNTED) - 0.5 GALLONS/FLUSH.  
E. URINALS (WALL MOUNTED) - 0.125 GALLONS/FLUSH.

CONFIRM AT TIME OF ORDER AND IF THESE EFFICIENCIES ARE NOT MET, ORDER THE NEAREST EQUAL FIXTURE AVAILABLE FROM THE PLUMBING SUPPLY HOUSE THAT MEETS THE ABOVE FLOW REQUIREMENTS.

● = CONNECT NEW TO EXISTING

2" AND 3" SANITARY LINES SHALL HAVE 1-1/2" VENT RISERS, 4" SANITARY LINES SHALL HAVE 2" VENT RISERS. OVERHEAD HORIZONTAL VENTS SHALL BE 2". CONFORM TO THESE SIZES UNLESS OTHERWISE ALLOWED/ REQUIRED BY A.H.J..

VERIFY ALL CONDITIONS IN FIELD.

DANVILLE, CA NOTE (HOT WATER RECIRC. SYSTEM):

PER CALIFORNIA ENERGY EFFICIENCY STANDARD, SECTION 113(c)(5), THE PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL:

A) AN AIR RELEASE VALVE REQUIRED ON THE INLET SIDE OF THE RECIRCULATING PUMP, WITHIN 4' OF THE PUMP.

B) A CHECK VALVE REQUIRED BETWEEN THE RECIRCULATING PUMP AND THE WATER HEATING EQUIPMENT TO PREVENT THE HOT WATER FROM FLOWING BACKWARDS THROUGH THE RECIRCULATION LOOP.

C) A CHECK VALVE REQUIRED ON THE COLD WATER SUPPLY LINE BETWEEN THE HOT WATER SYSTEM AND THE NEXT CLOSEST TEE ON THE COLD WATER SUPPLY LINE. (SEE CPC 608.3 FOR EXPANSION TANK REQUIREMENTS)

## PLUMBING PLAN KEY NOTES


1. PROVIDE AND INSTALL TANK TYPE WATER HEATER, PER SCHEDULE, AND DETAIL 03 (SHEET M2.0).
2. POINT OF CONNECTION (DIAGRAMMATIC) TO WATER MAIN IN CEILING SPACE, VERIFY POINT OF CONNECTION. FROM POINT OF CONNECTION, ROUTE 1" C.W. PIPING IN JOIST SPACE.
3. PROVIDE TRAP PRIMERS/TRAP GUARDS ON ALL HUB/FLOOR DRAINS, WHERE REQUIRED. VERIFY EXACT LOCATION WITH OWNER'S REPRESENTATIVE.
4. DO NOT ROUTE LINES ABOVE ELECTRICAL GEAR, OR PROVIDE PROTECTION IF LINES ARE EXISTING, VIA WATERPROOF SLEEVE. WHERE IMPRACTICAL, ELECTRICAL CONTRACTOR SHALL PROVIDE NEMA 3R (OUTDOOR RATED) GEAR/EQUIPMENT.
5. PROVIDE WASHER BOX AT 36" AFF FOR HW, CW & SAN CONNECTIONS. WALL SHALL ALLOW FOR 4" DRYER VENT TO BE CONCEALED WITHIN WALL.

6. PROVIDE W.H.A. ON ALL FAST CLOSING VALVES, AND WHERE ELSE INDICATED AND WHERE NECESSARY.
7. B.F.P. SHALL BE ACCESSIBLE FOR INSPECTION AND TESTING. TYPICALLY ABOVE OR NEXT TO WATER HEATER. ROUTE DISCHARGE TO NEAREST APPROVED RECEPTOR. PROVIDE AND INSTALL HUB DRAIN WITH TRAP PRIMER AS NEEDED.
8. FURROUT WALLS AS NECESSARY FOR POWER, PLUMBING, AND DRYER VENT.
9. PROVIDE NEPTUNE E-CODER METER WITH ELECTRONIC OUTREADER (REMOTE READOUT REGISTER). VERIFY WITH OWNER'S REP FINAL PLACEMENT OF REMOTE READ OUT UNLESS WATER USAGE IS INCLUDED IN C.A.M CHARGES.

10. CONNECTION TO EXISTING SANITARY SEWER MAIN LOCATION SHOWN IS DIAGRAMMATIC, AT APPROXIMATELY THE LOCATION INDICATED. COORDINATE EXACT LOCATION IN FIELD. MINIMIZE NUMBER OF TIE IN POINTS. VERIFY LOCATION, INVERT, AND DIRECTION OF FLOW PRIOR TO CONNECTING.
11. SLOPE UNDERSLAB 4" SANITARY LINE AT 1/8" PER FOOT. VERIFY EXACT POINT OF CONNECTION IN FIELD.
12. COORDINATE ROUTING OF UNDERSLAB WASTE LINES IN FIELD WITH STRUCTURAL ELEMENTS.


FIELD VERIFY LOCATION OF PLUMBING VTR, INSTALL AFTER ALL HVAC UNITS ARE IN PLACE TO ENSURE NO VENT IS WITHIN 10'-0" OF ANY FRESH AIR INTAKE AND THAT NO EXTRA / UNNECESSARY ROOF PENETRATIONS ARE MADE.

PLUMBING CONTRACTOR SHALL MAKE ADJUSTMENTS WHERE NECESSARY TO KEEP PLUMBING VENTS A MINIMUM OF 10'-0" AWAY FROM ALL FRESH AIR INTAKES. WAIT FOR FINAL HVAC UNIT LOCATIONS PRIOR TO CUTTING ROOF PENETRATIONS.

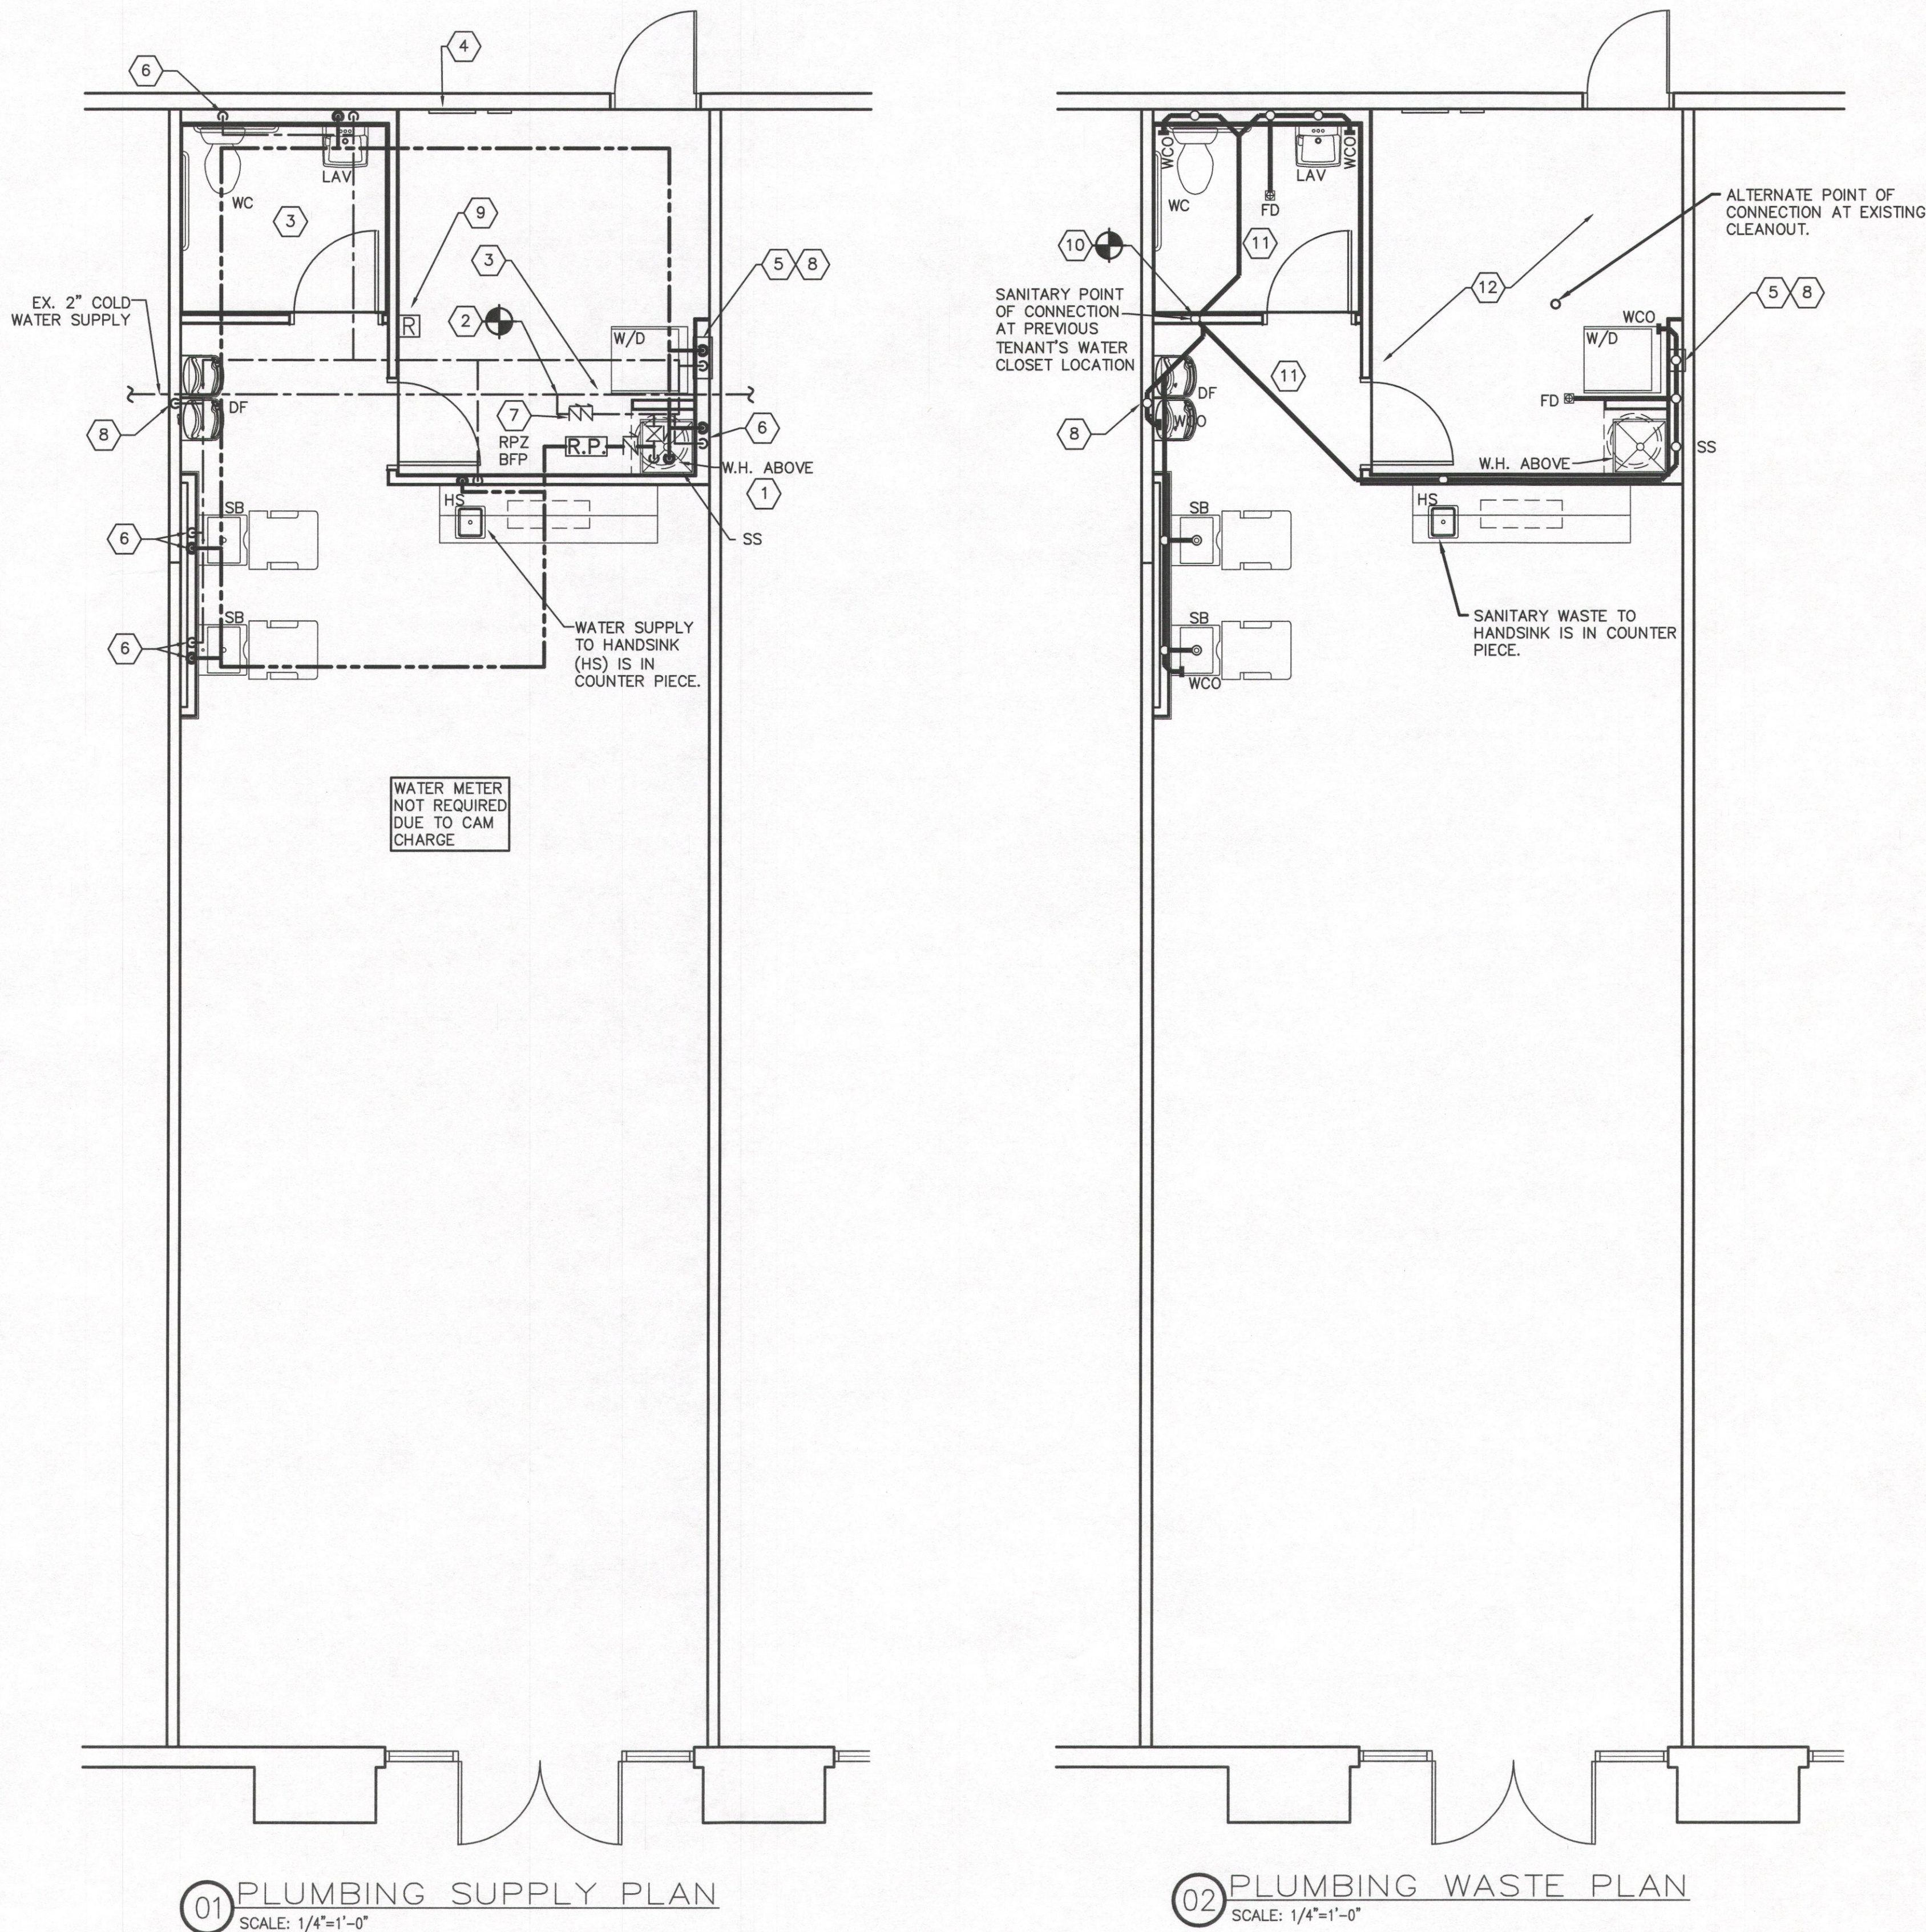

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION

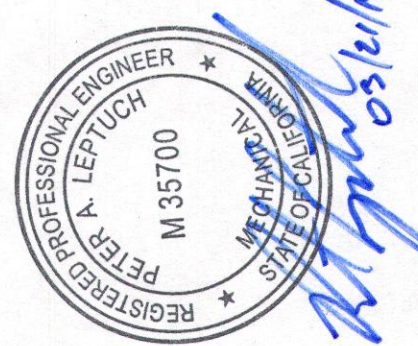

ISSUE

Peter A. Leptuch, P.E.  
CA-M35700/CA-E19072  
1236 Golden Eagle Ct.  
Aubrey, TX 76227  
(940) 735-5127

PROJECT NUMBER  
C170445

SHEET NUMBER

P1.0

PLUMBING PLANS  
DATE OF THIS PRINTING - 03/21/18

ISSUE FOR PERMIT 03/22/18



PLUMBING MATERIALS

- A. SANITARY PIPING:  
(WHERE NOT OTHERWISE SPECIFIED THROUGHOUT THE DRAWING SET, WASTE, DRAIN AND VENT PIPING SHALL BE PER LOCAL CODE AND AUTHORITY HAVING JURISDICTION.)
- UNDERSLAB DRAIN PIPING SHALL BE SCHEDULE 40 PVC.
  - VENT PIPING SHALL BE SCHEDULE 40 PVC. VENT PIPING ABOVE FLOOR 2" OR SMALLER MAY BE GALVANIZED STEEL.
  - CONDENSATE PIPING SHALL BE TYPE "L" HARD DRAWN COPPER TUBE WITH 95-5 TIN-ANTIMONY SOLDERED JOINTS AND WROUGHT COPPER FITTINGS WITH DIELECTRIC SEPARATION BETWEEN DISSIMILAR METALS. CONDENSATE PIPING BELOW ROOF DECK MAY BE PVC. PROVIDE SHARKBITE TRANSITION FROM PVC TO COPPER.
  - INSULATE ALL HORIZONTAL RUNS OF PIPING LOCATED IN CEILING SPACES OF TENANTS IN SPACES BELOW WHEN APPLICABLE. INSULATION TO BE AS SPECIFIED FOR WATER PIPING.
  - PROVIDE LINE-ITEM BID TO UTILIZE PVC, OBTAIN APPROVAL FROM INSPECTOR PRIOR TO INSTALLATION THAT PVC IS ALLOWED FOR THE SPECIFIC HVAC LAYOUT FOR THIS PROJECT.
- B. POTABLE WATER PIPING
- ALL HOT AND COLD WATER SUPPLY PIPING, WHERE ALLOWED BY A.H.J. AND OWNER SHALL BE CPVC OR PEX.
  - WATER PIPING IN CEILING SPACE AND WITHIN WALLS MAY BE TYPE "L" COPPER OR PEX, INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE SHARK-BITE TRANSITIONS, OR APPROVED EQUALS.
  - BELOW GRADE: TYPE "K", ANNEALED TEMPERED COPPER TUBE FOR PIPE SIZES 2 INCHES AND SMALLER. BRAZE ALL JOINTS.
  - WHERE APPLICABLE, TRANSITIONS BETWEEN COPPER AND PLASTIC PIPE SHALL BE MADE BY SHARKBITE OR SIMILAR TRANSITIONS, RATED FOR USE WITH SUCH MATERIALS AS ARE BEING USED.
- C. GAS PIPING
- GAS LINES SHALL BE BLACK STEEL, SCHEDULE 40, ASTM A-120, WITH MALLEABLE THREADED FITTINGS FOR 2" AND SMALLER, AND WITH WELDED JOINTS FOR 2-1/2" AND LARGER.
  - GAS PIPING EXPOSED ON ROOF MUST BE PAINTED WITH RUST-INHIBITING PAINT.
- \*\*THIS MATERIALS LIST REPRESENTS THE MINIMUM SPECIFICATIONS SET FORTH BY THE MEP ENGINEER. CONTACT LANDLORD'S REPRESENTATIVE PRIOR TO BEGINNING CONSTRUCTION TO VERIFY IF THERE ARE ANY ADDITIONAL OR MORE STRINGENT REQUIREMENTS BEYOND THESE.

PLUMBING RISER NOTES (SUPPLY & WASTE)

- PLUMBING CONTRACTOR SHALL REFER TO ARCHITECTURAL DRAWINGS, FOR PLACEMENT HOT AND COLD WATER SUPPLY, PRIOR TO INSTALLATION. WATER SUPPLY LOCATIONS ON THIS SHEET ARE DIAGRAMATIC.
- PLUMBING CONTRACTOR SHALL CONFIRM WASTE LINES FOUND IN FIELD AND SHALL VERIFY THAT TENANT'S SANITARY WASTE LINES ARE CONNECTED TO BUILDING SANITARY WASTE LINE, AND NOT INTO A BUILDING COMMON GREASE WASTE LINE.
- PROVIDE MINIMUM 6" AIR GAP AT DISCHARGE OF T&P AT WATER HEATER.

⊙ = CONNECT NEW TO EXISTING


2" AND 3" SANITARY LINES SHALL HAVE 1-1/2" VENT RISERS, 4" SANITARY LINES SHALL HAVE 2" VENT RISERS. OVERHEAD HORIZONTAL VENTS SHALL BE 2". CONFORM TO THESE SIZES UNLESS OTHERWISE ALLOWED/ REQUIRED BY A.H.J..

VERIFY ALL CONDITIONS IN FIELD.

DANVILLE, CA NOTE:

GAS PIPING SERVING RTU IS EXISTING. NO CHANGES ARE PLANNED.

MINIMIZE GAS PIPING VISIBLE TO VIEW, VERIFY REQUIREMENTS WITH LANDLORD.

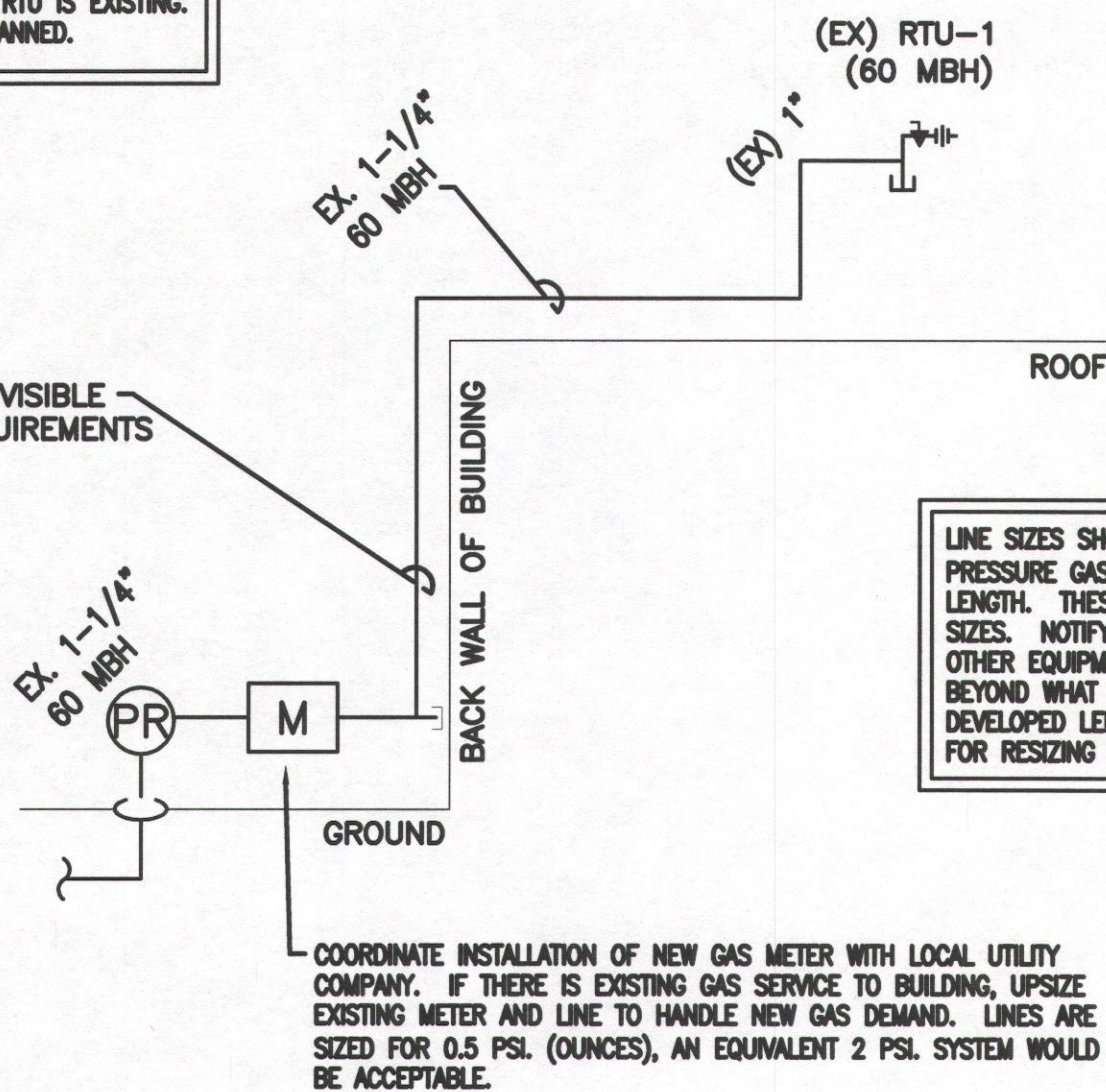


LINE SIZES SHOWN HERE ARE BASED ON LOW PRESSURE GAS PIPE AND 100' TOTAL DEVELOPED LENGTH. THESE SIZES REPRESENT MINIMUM LINE SIZES. NOTIFY ENGINEER FOR RESIZING IF ANY OTHER EQUIPMENT IS SERVED BY EXISTING LINES BEYOND WHAT IS SHOWN HERE, OR IF TOTAL DEVELOPED LENGTH EXCEEDS TDL SHOWN HERE FOR RESIZING OF LINES.

04 GAS RISER DIAGRAM

SCALE: NOT TO SCALE


ALL PLUMBING SUPPLY LINES SHALL BE 1/2" UNLESS INDICATED OTHERWISE.

PROVIDE TRAP PRIMERS ON ALL FIXTURES WHOSE TRAP SEALS ARE SUBJECT TO DRYING OUT.

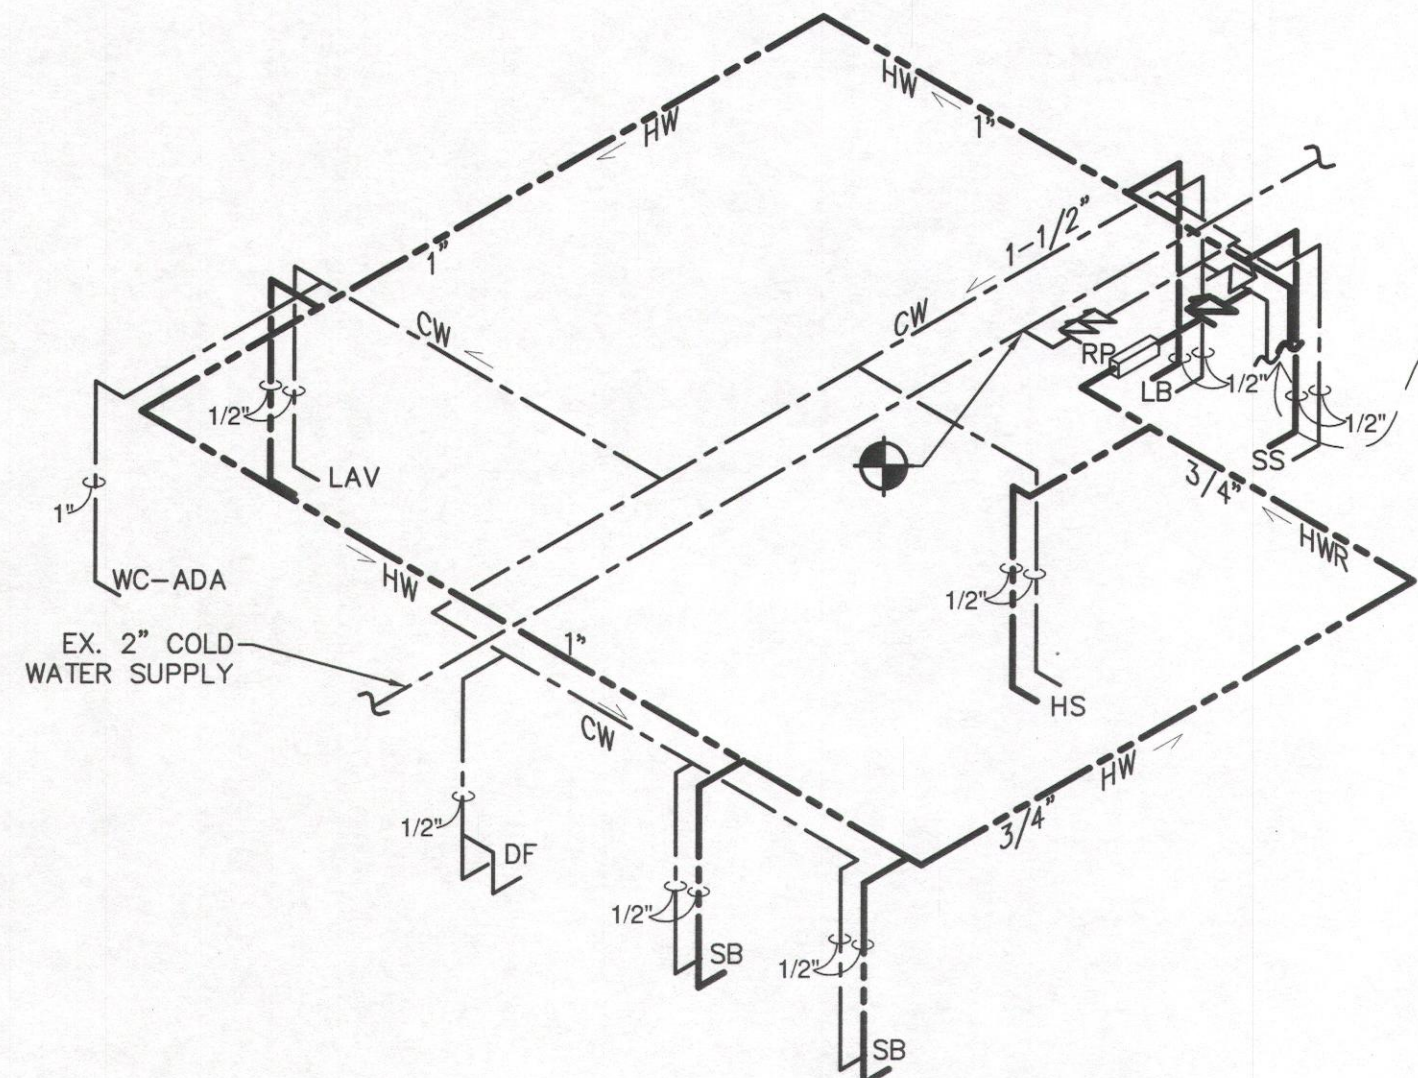

01 PLUMBING SUPPLY RISER

SCALE: NOT TO SCALE

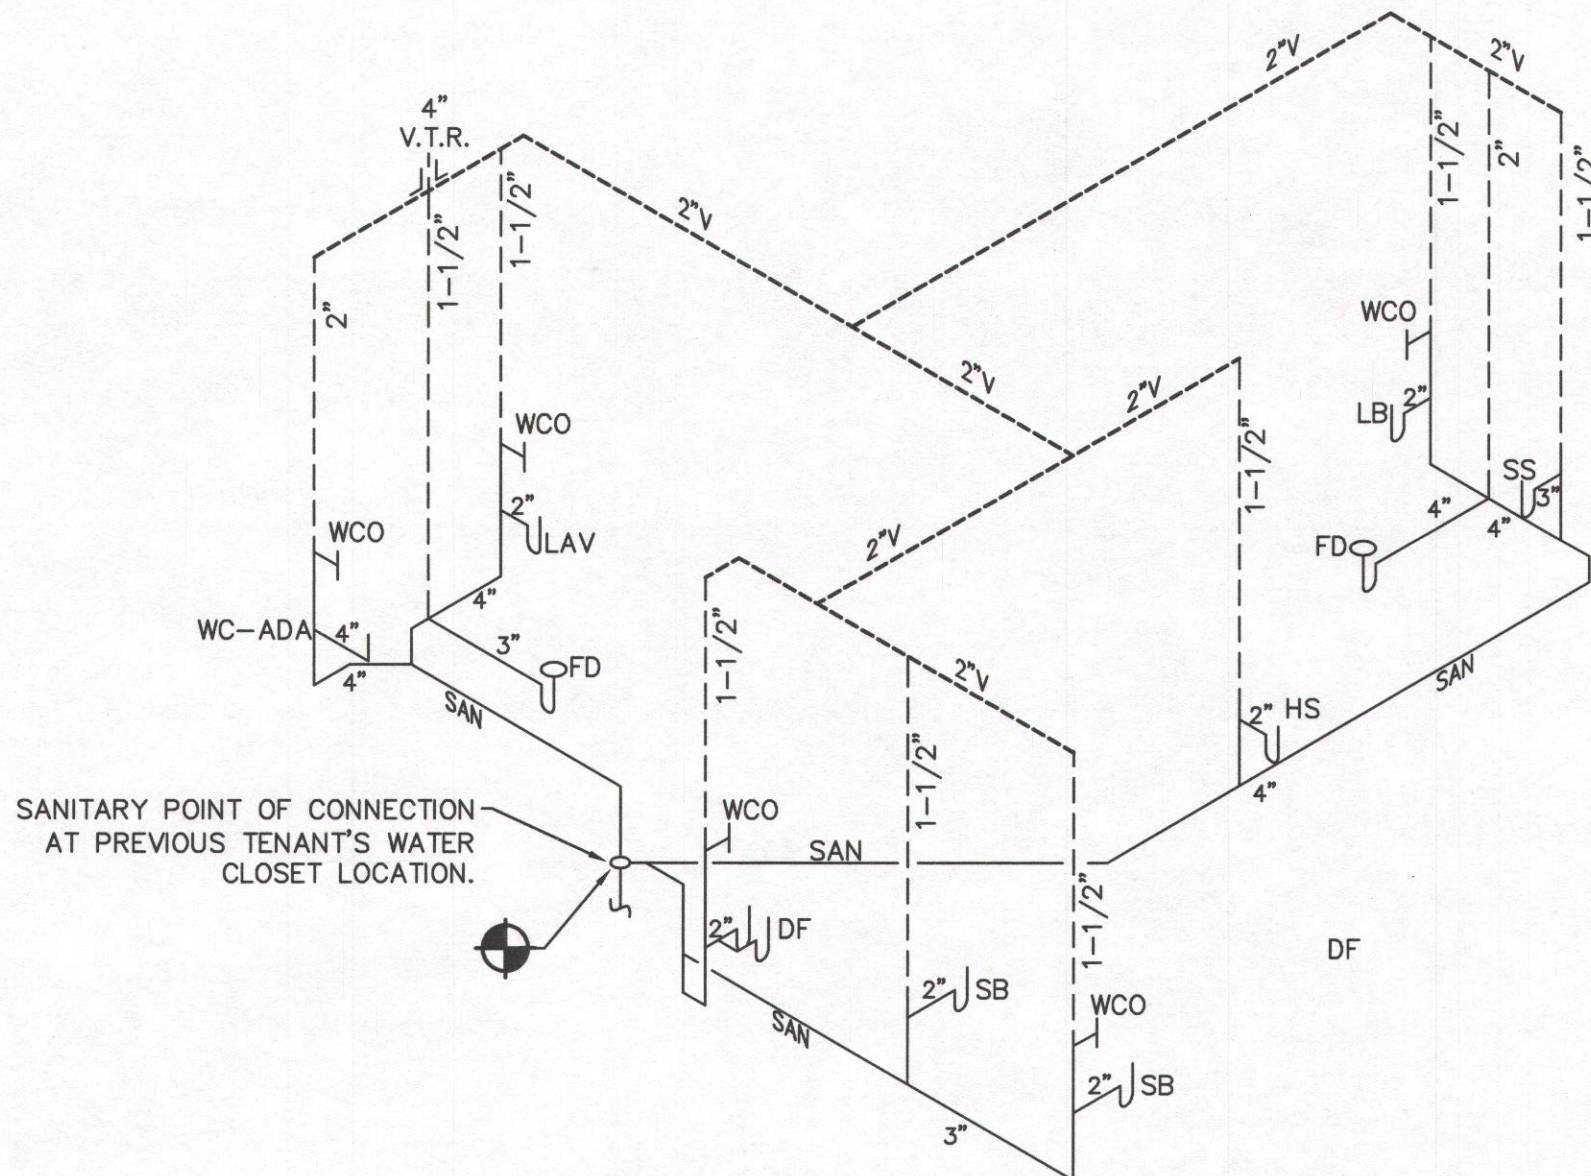

02 PLUMBING WASTE RISER

SCALE: NOT TO SCALE

Water Service Calculation - Barber Shop 3/7/2018  
F.U. = fixture Units (Chapter 6, Table 610.3)

Bishops - Danville, CA  
2016 CPC

	Quantity	Waste F.U. (per fixture)	Total Waste F.U.	Water Supply F.U. (per fixture)	Total Water Supply F.U.
Water Closet (Flush Valve)	1	6	6	varies	40
Lavatory / Handwash Sink	2	2	4	1	2
Sink (Hair)	2	2	4	2	4
Service Sink	1	4	4	3	3
Floor Drain	2	2	4	0	0
Clothes Washer	1	10	10	4	4
Drinking Fountain	1	1	1	0.5	0.5

Total Fixture Units: 33  
Waste: 33  
Supply: 53.5  
USE 4" WASTE LINE  
FOR FLUSH TANK - USE 1-1/2" DISTRIBUTION LINE  
FOR FLUSH VALVE - USE 2" DISTRIBUTION LINE

Pipe Sizes based on UPC

Misc:	1-1/4" trap	0
	1-1/2" trap	0
	2" trap	0
	3" trap	0
	4" trap	0

Sizing Table:

Pipe Size	1.25"	1.5"	2"	3"	4"	6"
Horizontal	1	2	16	48	256	1380
Vertical	1	1	8	35	216	720


Water Sizing:

ALL FIXTURES SHALL HAVE CLEANOUTS, WHETHER GRAPHICALLY INDICATED ON DRAWINGS OR NOT.

FIELD VERIFY LOCATION OF PLUMBING VTR, INSTALL AFTER ALL HVAC UNITS ARE IN PLACE TO ENSURE NO VENT IS WITHIN 10'-0" OF ANY FRESH AIR INTAKE AND THAT NO EXTRA UNNECESSARY ROOF PENETRATIONS ARE MADE.

PLUMBING CONTRACTOR SHALL MAKE ADJUSTMENTS WHERE NECESSARY TO KEEP PLUMBING VENTS A MINIMUM OF 10'-0" AWAY FROM ALL FRESH AIR INTAKES. WAIT FOR FINAL HVAC UNIT LOCATIONS PRIOR TO CUTTING ROOF PENETRATIONS.

CALIFORNIA NOTE:  
PROVIDE SEISMIC STRAPPING FOR NEW TANK WATER HEATER PER CPC 507.2. STRAPS ARE REQUIRED WITHIN BOTH THE UPPER AND LOWER THIRD, WITH LOWER STRAP 4" MINIMUM ABOVE WATER HEATER CONTROLS

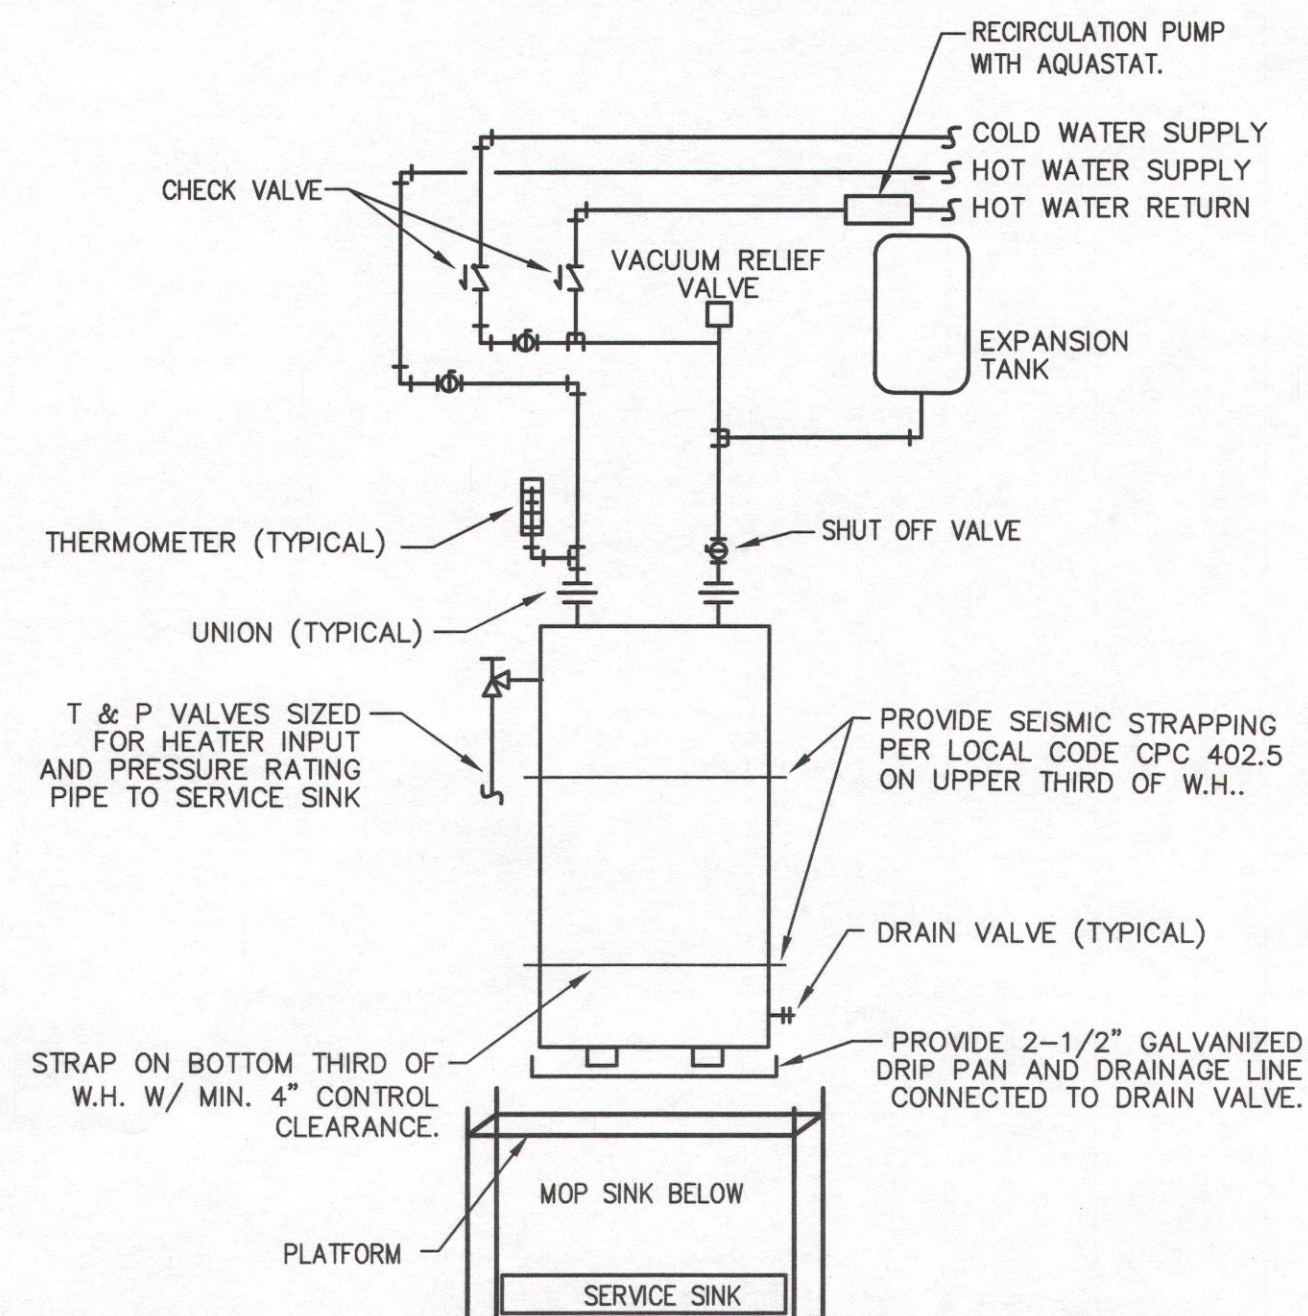

03 ELECTRIC WATER HEATER DETAIL

SCALE: NOT TO SCALE

Storage Tank Water Heater Sizing Calculator

Developed by the Plan Review Unit of the Environmental Health Services Section

Facility Name:		BISHOPS			
Address:		DANVILLE, CA			
EQUIPMENT				GPH CALCULATED	
Enter the description, and number and size of compartments for each sink below	Description	Number of compartments	(inches) Length Width Depth		Gallons Per Hour (GPH)
Largest Sink #1					0
Sink #2					0
Sinks are calculated at 75% capacity					Total 0
Enter type of prep sink and number of sink compartments for each sink below	Type of prep sink (vegetable, meat, seafood)	Number of compartments			Gallons Per Hour (GPH)
Prep sink #1					0
Prep sinks are calculated at 5 gallons per compartment					Total 0
Enter the quantity of equipment below	Quantity				Gallons Per Hour (GPH)
Hand sinks	2				10
Shampoo sinks	2				30
Mop sink	1				5
Clothes washer	1				6.8
Other Equipment					0
Enter a description and estimated gallon per hour (GPH) usage for other equipment below	Description	Estimated gallons per hour (GPH) usage			
Other Equipment					0
Hand sinks and mop sinks are calculated at 5 GPH each, showers at 15 GPH each.					
Hose reels are calculated at 5 GPH, clothes washers at 6.8 GPH, other equipment at the usage entered					Total 51.8
Enter the make, model and Final Rinse Usage (GPH) for dishmachines	Make	Model	Final Rinse Usage (GPH) Found in "Dishmachine Specs" sheet below or on manufacturer's spec sheet		Gallons Per Hour (GPH)
Dishmachine #1					0
Enter the quantity of pre-rinse units	Quantity				Gallons Per Hour (GPH)
Pre-rinse					0
Dishmachines are calculated at 70% of the final rinse usage specified by the manufacturer.					Total 0
Pre-rinse are calculated at 45 GPH					
Recovery Rate Needed (GPH):					52
Water Heater Input (BTU or kW) Needed:					
Gas Water Heater			Electric Water Heater		
45 ,000 BTU at 80°F rise			10 kW at 80°F rise		
51 ,000 BTU at 90°F rise			11 kW at 90°F rise		
57 ,000 BTU at 100°F rise			13 kW at 100°F rise		

GH A


Architecture / Development  
14901 Quorum Drive  
Suite 300  
Dallas Texas 75254

Ph: (972) 239-8884  
Fax: (972) 239-5054

BISHOPS - TENANT FINISHOUT  
DANVILLE SQUARE  
39 RAILROAD AVE  
DANVILLE, CA 94526

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION

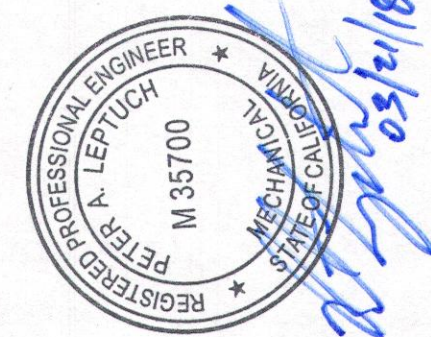

ISSUE

Peter A. Leptuch, P.E.  
CA-M35700/CA-E19072  
1236 Golden Eagle Ct.  
Aubrey, TX 76227  
(940) 735-5127

PROJECT NUMBER  
C170445

SHEET NUMBER

P2.0

PLUMBING PLANS  
DATE OF THIS PRINTING - 03/21/18



ELECTRICAL SYMBOL LEGEND		
SYMBOL	DESCRIPTION	HEIGHT (U.N.O.)
\$	SINGLE POLE SINGLE THROW TOGGLE SWITCH (NOTE L-1)	44"
\$ <sub>3/\$4</sub>	THREE-WAY TOGGLE SWITCH/FOUR-WAY TOGGLE SWITCH (NOTE L-1)	44"
\$ <sub>M</sub>	MOTOR RATED SWITCH	
\$ <sub>D</sub>	DIMMER SWITCH (NOTE L-1)	44"
Ⓛ/Ⓢ	DUPLEX / QUAD RECEPTACLE OUTLET (NOTE L-1)	15" (BOTTOM)
Ⓢ	OTHER RECEPTACLE, AS NOTED.	
Ⓛ/Ⓢ	DUPLEX RECEPTACLE OUTLET, CEILING MOUNTED/FLOOR MOUNTED	
(#)	THE NUMBER IN PARENTHESIS IS THE COMMENT OUTLET COUNT FOR THE CIRCUIT.	
Ⓛ/Ⓢ	JUNCTION BOX, CEILING / FLOOR MOUNTED	SEE PLAN
Ⓢ/Ⓢ	TELEPHONE OUTLET, WALL MOUNTED / FLOOR MOUNTED	SEE PLAN
Ⓢ/Ⓢ	DATA OUTLET, WALL MOUNTED/FLOOR MOUNTED	SEE PLAN
Ⓢ	CURRENT TRANSFORMER	
Ⓢ	POWER METER AND SOCKET	
—	RACEWAY/CABLE CONCEALED IN WALL AND/OR ABOVE CEILING	
—	GROUNDING CONNECTION (SYSTEM AND/OR EQUIPMENT)	
X-1,3,5	ARROWHEAD INDICATES HOMERUN. X-1,3,5 INDICATES HOMERUN TO PANEL X CIRCUIT NUMBERS 1,3, AND 5.	
Ⓢ	MOTOR	
Ⓢ	PANELBOARD - WALL MOUNTED (RECESSED/SURFACE MOUNTED)	
Ⓢ/Ⓢ	NONFUSIBLE DISCONNECT SWITCH, RATING/POLES/NEHA ENCLOSURE	
Ⓢ/Ⓢ/Ⓢ	FUSIBLE DISCONNECT SWITCH, RATING/FUSE RATING/POLES/NEHA ENCLOSURE	
Ⓢ	DUCT SMOKE DETECTOR	
Ⓢ	THERMAL DETECTOR, WALL MOUNTED	SEE PLAN
Ⓢ	THERMOSTAT, WALL MOUNTED	
Ⓢ	CONNECT NEW TO EXISTING	
N.L.C.	NOT IN CONTRACT	
Ⓢ	SECURITY CAMERA	

L-1 MOUNTING HEIGHTS NOTED ARE TO THE CENTER OF DEVICE ABOVE FINISHED FLOOR, UNLESS NOTED OTHERWISE (U.N.O.).  
L-2 FIRE ALARM VISUAL DEVICES SHALL BE WALL-MOUNTED 80" AFF OR 6" BELOW CEILING, WHICHEVER IS LOWER. AUDIBLE ONLY DEVICES SHALL BE WALL-MOUNTED AT NOT LESS THAN 90" AFF AND NOT LESS THAN 6" BELOW CEILING.

\* NOT ALL SYMBOLS USED ON ALL JOBS \*

RCP LEGEND	
Ⓢ	CEILING FLUSH MOUNT LIGHT: MANF: WAC LIGHTING MODEL #FM-4009-30-CH, 10W LED A120V
Ⓢ	WALL MOUNT LIGHT: MANF: CUSTOM LIGHT FIXTURE, 22W LED 120V. DAMP LABEL, MOUNT 8/0 3'-8" AFF (BY COS FULFILLMENT)
Ⓢ	WALL MOUNT LIGHT: MANF: GEORGE KOVACS MODEL #P5044-084-L, 20W A120V MOUNT ABOVE MIRROR AT 84" AFF
Ⓢ	RECESSED CAN LIGHT (DAMP LABEL COMPATIBLE) MANF: JUNG, 5" IC 900 LUMEN 13W LED DOWNLIGHT MODEL #SP2840363-27K-N-1
Ⓢ	LED EMERGENCY EGRESS LIGHTING/SIGNAGE COMBO WITH 90 MINUTE BATTERY BACKUP MANF: BARRON EXTRONIX, - VLED-EL90 SERIES, MODEL #GVLED-U-BL-EL90
Ⓢ	LED EMERGENCY EGRESS LIGHTING WITH 90 MINUTE BATTERY BACKUP MANF: BARRON EXTRONIX, - LED-EL90 SERIES, MODEL #LED-90-BL
Ⓢ	LED EMERGENCY EXIT SIGN WITH 90 MINUTE BATTERY BACKUP MANF: HUBBELL LIGHTING, - COMPASS SERIES, MODEL #CER
Ⓢ	LED EMERGENCY EXTERIOR EGRESS LIGHTING - CONNECTED TO EXIT SIGN BATTERY BACKUP MANF: HUBBELL LIGHTING, - COMPASS SERIES, MODEL #CERD
Ⓢ	2x4 RECESSED LED LUMINAIRE FIXTURE MANF: INDY LIGHTING MODEL #S2X4BL-39-30-U-WH-3
Ⓢ	DECORATIVE PENDANT LIGHT MANF: CUSTOM, AIRCRAFT CABLE SUSPENDED, 22W LED, 120/277V, DAMP LABEL, MOUNT SO 8/0 FIXTURE IS AT 9'-0" A.F.F. (BY COS FULFILLMENT)
Ⓢ	TRACK LIGHT SYSTEM MANF: JUNG, TRAC-MASTER TRACK, & TRAC-LITES FIXTURES MODEL #T 4 OR 8 FT TRACKS BL. SP28475-35-K-F-BL FIXTURE HEADS, PAR20 LED 8W-10W A120V, BOT OF TRACK AT 108" AFF, 3 HEADS PER STATION AND AS SHOWN (BY COS FULFILLMENT)

DANVILLE, CA NOTE:  
ALL ELECTRICAL OUTLET SWITCHES IN DEMISING WALL SHALL BE INSTALLED WITH FIRE RATED PUTTY, TO MAINTAIN FIRE RATING OF WALL, PER ARCHITECTURAL SHEETS. PUTTY SHALL BE HILTI OR EQUAL.

DANVILLE, CA NOTE:  
THIS SPACE IS AN EXISTING AS-IS TENANT LEASE SPACE.

DANVILLE, CA NOTE:  
THE WATTAGE IN THE DAYLIGHT ZONE IS LESS THAN 120W, SO DAYLIGHT SENSORS AREN'T REQUIRED.

CALIFORNIA NOTE:  
AT TIME OF ORDER, CONTRACTOR SHALL ENSURE LED FIXTURES ARE PROVIDED WITH IN-LINE CURRENT LIMITER IN TRACK. PROVIDE ALL DIMMABLE-TYPE LAMPS.

BISHOPS PROTOTYPICAL NOTE:  
IF DECK IS HIGHER THAN 17'-0", G.C. TO DROP J-BOXES FOR 'L1' FIXTURES TO 16'-0" OR LOWER.

GENERAL NOTES

- LIGHTING SHALL BE CIRCUITED EXACTLY AS SHOWN ON PLANS.
- SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATION AND QUANTITY OF LIGHTING FIXTURES.
- EMERGENCY AND EXIT LIGHTS SHALL BE INSTALLED AND CIRCUITED PER THE LATEST NATIONAL ELECTRICAL CODE AND ALL LOCAL CODES. ALL EMERGENCY AND EXIT FIXTURES SHALL BE DUAL VOLTAGE (120/277 VOLT INPUT) WITH 90 MINUTE BATTERY BACKUP.
- ELECTRICAL SUB-CONTRACTOR IS RESPONSIBLE FOR ALL REFLECTED CEILING PLAN NOTES ON ARCHITECTURAL DRAWINGS.
- ALL FLUORESCENT LIGHTING SHALL BE PROVIDED WITH INTEGRAL DISCONNECTING MEANS PER NEC.
- EXTERIOR LIGHTS ARE EXISTING BY LANDLORD, TO REMAIN.
- THE DIRECTION OF THE BUILDING OFFICIAL/QUANTITY, LOCATION AND TYPE OF EXIT/EGRESS LIGHTS REQUIRED SHALL TAKE PRECEDENCE OVER WHAT IS SHOWN IN THIS DOCUMENT SET.
- LIGHTS FURNISHED BY OWNER AND INSTALLED BY GC.
- EMERGENCY/EGRESS AND EXIT LIGHTS SHALL BE ON A NON-SWITCHED LEG OF CIRCUIT.
- PROVIDE CURRENT LIMITERS (IN-LINE) FOR TRACK LIGHTING AS NEEDED WHERE REQUIRED BY INSPECTOR TO ACHIEVE ENERGY CODE COMPLIANCE.
- TRACK AND SCONCES DO NOT PROVIDE GENERAL LIGHTING AND THEREFOR ARE NOT REQUIRED TO BE CONTROLLED BY DAYLIGHT SENSORS. (T-24/CALIFORNIA)
- DAYLIGHTING IS NOT REQUIRED WHEN A ZONE HAS LESS THAN 120 WATTS OF GENERAL LIGHTING, OR LESS THAN 24 SQ. FT. OF GLAZING. (T-24/CALIFORNIA)

## KEY NOTES BY SYMBOL 'O'

- EXISTING PANEL 'LA'. PANEL SHALL BE SURFACE-MOUNTED AND FACE OPEN INTO ROOM. FURROUT WALLS AS NECESSARY.
- EXISTING 2" CONDUIT TO EXISTING ELECTRICAL SERVICE/METERING EQUIPMENT IN LANDLORD'S ELECTRICAL ROOM, NO CHANGES TO BE MADE.
- ONE (1) EXISTING 1" CONDUIT TO EXISTING TELEPHONE BOARD. VERIFY EXACT PLACEMENT WITH OWNER'S REP. AND FIELD VERIFY POINT OF CONNECTION TO LANDLORD'S DMARK. ELECTRICAL ROOM IS +/-180" BEYOND DEMISING WALL.
- ELECTRIC DRYER. PROVIDE (2) #10, #10G., 3/4" C, 30/2 RECEPTACLE & WIRE.
- CONTRACTOR SHALL COORDINATE ALL REQUIREMENTS AND QUANTITY FOR ELECTRICAL AND BLOCKING/MOUNTING WITH SIGN PROVIDER AND PROVIDE AS NECESSARY PRIOR TO ROUGH-IN. CONTRACTOR SHALL FIELD VERIFY EXISTING SIGN CIRCUIT COMPLIES WITH ALL LOCAL AND NATIONAL CODES AND IS PROVIDED WITH ALL REQUIRED DISCONNECTING MEANS PER NEC. PROVIDE INTERIOR ACCESS PANELS FOR SIGN CIRCUIT AS NECESSARY.
- 42"x16"x3/4" 'AC' GRADE PLYWOOD TELEPHONE BOARD. PROVIDE GROUND PER NEC. RUN 3/4" CONDUIT TO LANDLORD'S TELEPHONE CONNECTION POINT.
- PROVIDE A REMOTE ANNUNCIATOR FOR DUCT SMOKE DETECTORS AT CEILING OF RECEPTION DESK. REMOTE ANNUNCIATOR SHALL BE EQUAL TO SYSTEM SENSOR RA100Z/RA100ZA WITH AUDIBLE AND VISUAL ANNUNCIATOR. LABEL EACH ANNUNCIATOR ACCORDING TO UNIT BEING MONITORED.
- CIRCUIT EXHAUST FAN TO RUN CONTINUOUSLY DURING OCCUPIED HOURS.
- IF EXISTING WATER LINES ARE LOCATED ABOVE ELECTRICAL PANEL LOCATIONS SHOWN HERE, FABRICATE A LEAK SHIELD AROUND PIPES TO DIVERT FLOW AWAY FROM DRIPPING ONTO PANELS. USE A 4" PVC SLEEVE THAT STICKS OUT 6" BEYOND EDGES OF ELECTRICAL GEAR. OR SIMILAR. SLEEVE SHALL BE SEaled LONGITUDINALLY TO PREVENT PRESSURIZED SPRAY FROM REACHING EQUIPMENT BELOW AND OPEN ONLY ON THE TWO ENDS.
- PROVIDE POWER CONNECTION TO SUB-METER/ REMOTE REGISTER WHERE REQUIRED BY LEASE/LANDLORD. OMIT IF WATER IS INCLUDED IN C.A.M. OR SIMILAR. FIELD COORDINATE LOCATION, SEE SHEET P1.0 FOR ADDITIONAL INFO.
- FURROUT WALLS FOR POWER AND PLUMBING (SUPPLY, WASTE, AND VENT) LINES AS NECESSARY.
- E.C. TO PROVIDE WHIP AT +24" AFF FOR QUAD OUTLET BOX SET INSIDE RECEPTION DESK. ROUTE CONDUIT UNDERSLAB AS NECESSARY TO NEAREST WALL, UP AND OVER TO PANEL. G.C. TO VERIFY OUTLET LOCATIONS AFTER MILLWORK INSTALL.
- PLACE RECIRCULATION PUMP OUTLET/J-BOX ABOVE WATER HEATER IN UTILITY ROOM WHERE SPACE ALLOWS.
- PROVIDE OCCUPANCY SENSOR PER SCHEDULE.
- EXIT LIGHT SHALL BE CIRCUITED TO UNSWITCHED LEG OF LOCAL LIGHT CIRCUIT. PROVIDE CHEVRONS AS NEEDED.
- EMERGENCY EGRESS LIGHT SHALL BE CIRCUITED TO UNSWITCHED LEG OF LOCAL LIGHT CIRCUIT.
- COMMON AREA LIGHT SHALL BE SWITCHED THROUGH LIGHTING CONTROL PANEL.
- LIGHTING CONTROL PANEL SHALL BE T-24 COMPLIANT (LEVITON EZ-MAX R08BD-000 8-SPACE), WHERE EXTERIOR SIGNAGE IS ON LANDLORD'S LIGHTING CONTROL PANEL. INSTALL A 4-POLE LIGHTING CONTROL PANEL (RE4BD-104).
- TV QUAD RECEPTACLE AND DATA. VERIFY LOCATION AND MOUNTING HEIGHT WITH OWNER'S REPRESENTATIVE.
- PROVIDE (2) EMPTY CONDUITS WITH PULL STRINGS AT CASH WRAP FOR SPEAKER WIRE AND CAT 5. ROUTE UNDERSLAB AS NECESSARY TO NEAREST WALL AT HEIGHT DETERMINED IN FIELD, UP AND OVER TO TELCOM POINT OF CONNECTION. FURROUT WALL AS NECESSARY, PAINT CONDUIT AS REQUIRED.
- THIS OUTLET SHALL BE ROUTED THROUGH LCP.
- LOCATION OF SECURITY CAMERA. POWER SUPPLIED BY CLG. MTD. CAT5 WIRE BACK TO DVR UNIT AT UTILITY RM. EXACT LOCATIONS TO BE COORDINATED IN FIELD.

BISHOPS PROTOTYPICAL NOTE:  
IF DECK IS HIGHER THAN 17'-0", G.C. TO DROP J-BOXES FOR 'L1' FIXTURES TO 16'-0" OR LOWER.


## CONTRACTOR NOTES:

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ARCHITECT, LANDLORD OR TENANT OF ANY DISCREPANCIES ENCOUNTERED ON THE PLANS OR IN EXISTING CONDITIONS PRIOR TO COMMENCEMENT OF WORK.


BIDDERS ARE TO VISIT THE SITE AND FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS AND SATISFY THEMSELVES AS TO THE NATURE AND SCOPE OF WORK. THE BASE BID SHALL REFLECT MODIFICATIONS TO SYSTEMS AND DEVICES AS REQUIRED BY STATE AND LOCAL CODES WHETHER INDICATED OR NOT ON CONTRACT DOCUMENTS. THE SUBMISSIONS OF A BID WILL BE EVIDENCE THAT SUCH AN EXAMINATION AND COMPLIANCE WITH GOVERNING CODES / REQUIREMENTS HAS BEEN MADE. LATER CLAIMS FOR LABOR, EQUIPMENT, OR MATERIALS REQUIRED OR FOR DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN, HAD AN EXAMINATION AND CODE REVIEW BEEN MADE, WILL NOT BE ALLOWED.

## GENERAL NOTES

- GENERAL RECEPTACLES INSTALLED AT +15" TO BOTTOM OF BOX A.F.F.
- VERIFY GFI REQUIREMENTS PRIOR TO BID. ALL RECEPTACLES WITHIN 6'-0" OF A SINK OR WASH BASIN SHALL BE GFI RATED.
- ALL COVER PLATES, OUTLETS AND SWITCHES IN THE PUBLIC AREA SHALL BE FACTORY BLACK. ALL OTHERS TO BE FACTORY BRIGHT WHITE.
- SMOKE DETECTORS, FIRE ALARM SYSTEM, STROBES, HORNS, SPRINKLERS, ETC. SHALL BE DESIGNED AND INSTALLED WHERE REQUIRED BY A LICENSED FIRE SPRINKLER / FIRE PROTECTION CONTRACTOR (DESIGN-BUILD) UNDER A SEPARATE PERMIT.
- HVAC CONVENIENCE OUTLET(S) AND DISCONNECT(S) SHALL BE PROVIDED AND INSTALLED BY ELECTRICAL CONTRACTOR, SIZE TO MATCH BREAKERS ON PANEL AND/OR NAMEPLATE.
- DISCONNECT SHALL BE RATED FOR VOLTAGE OF ORIGINATING PANEL.

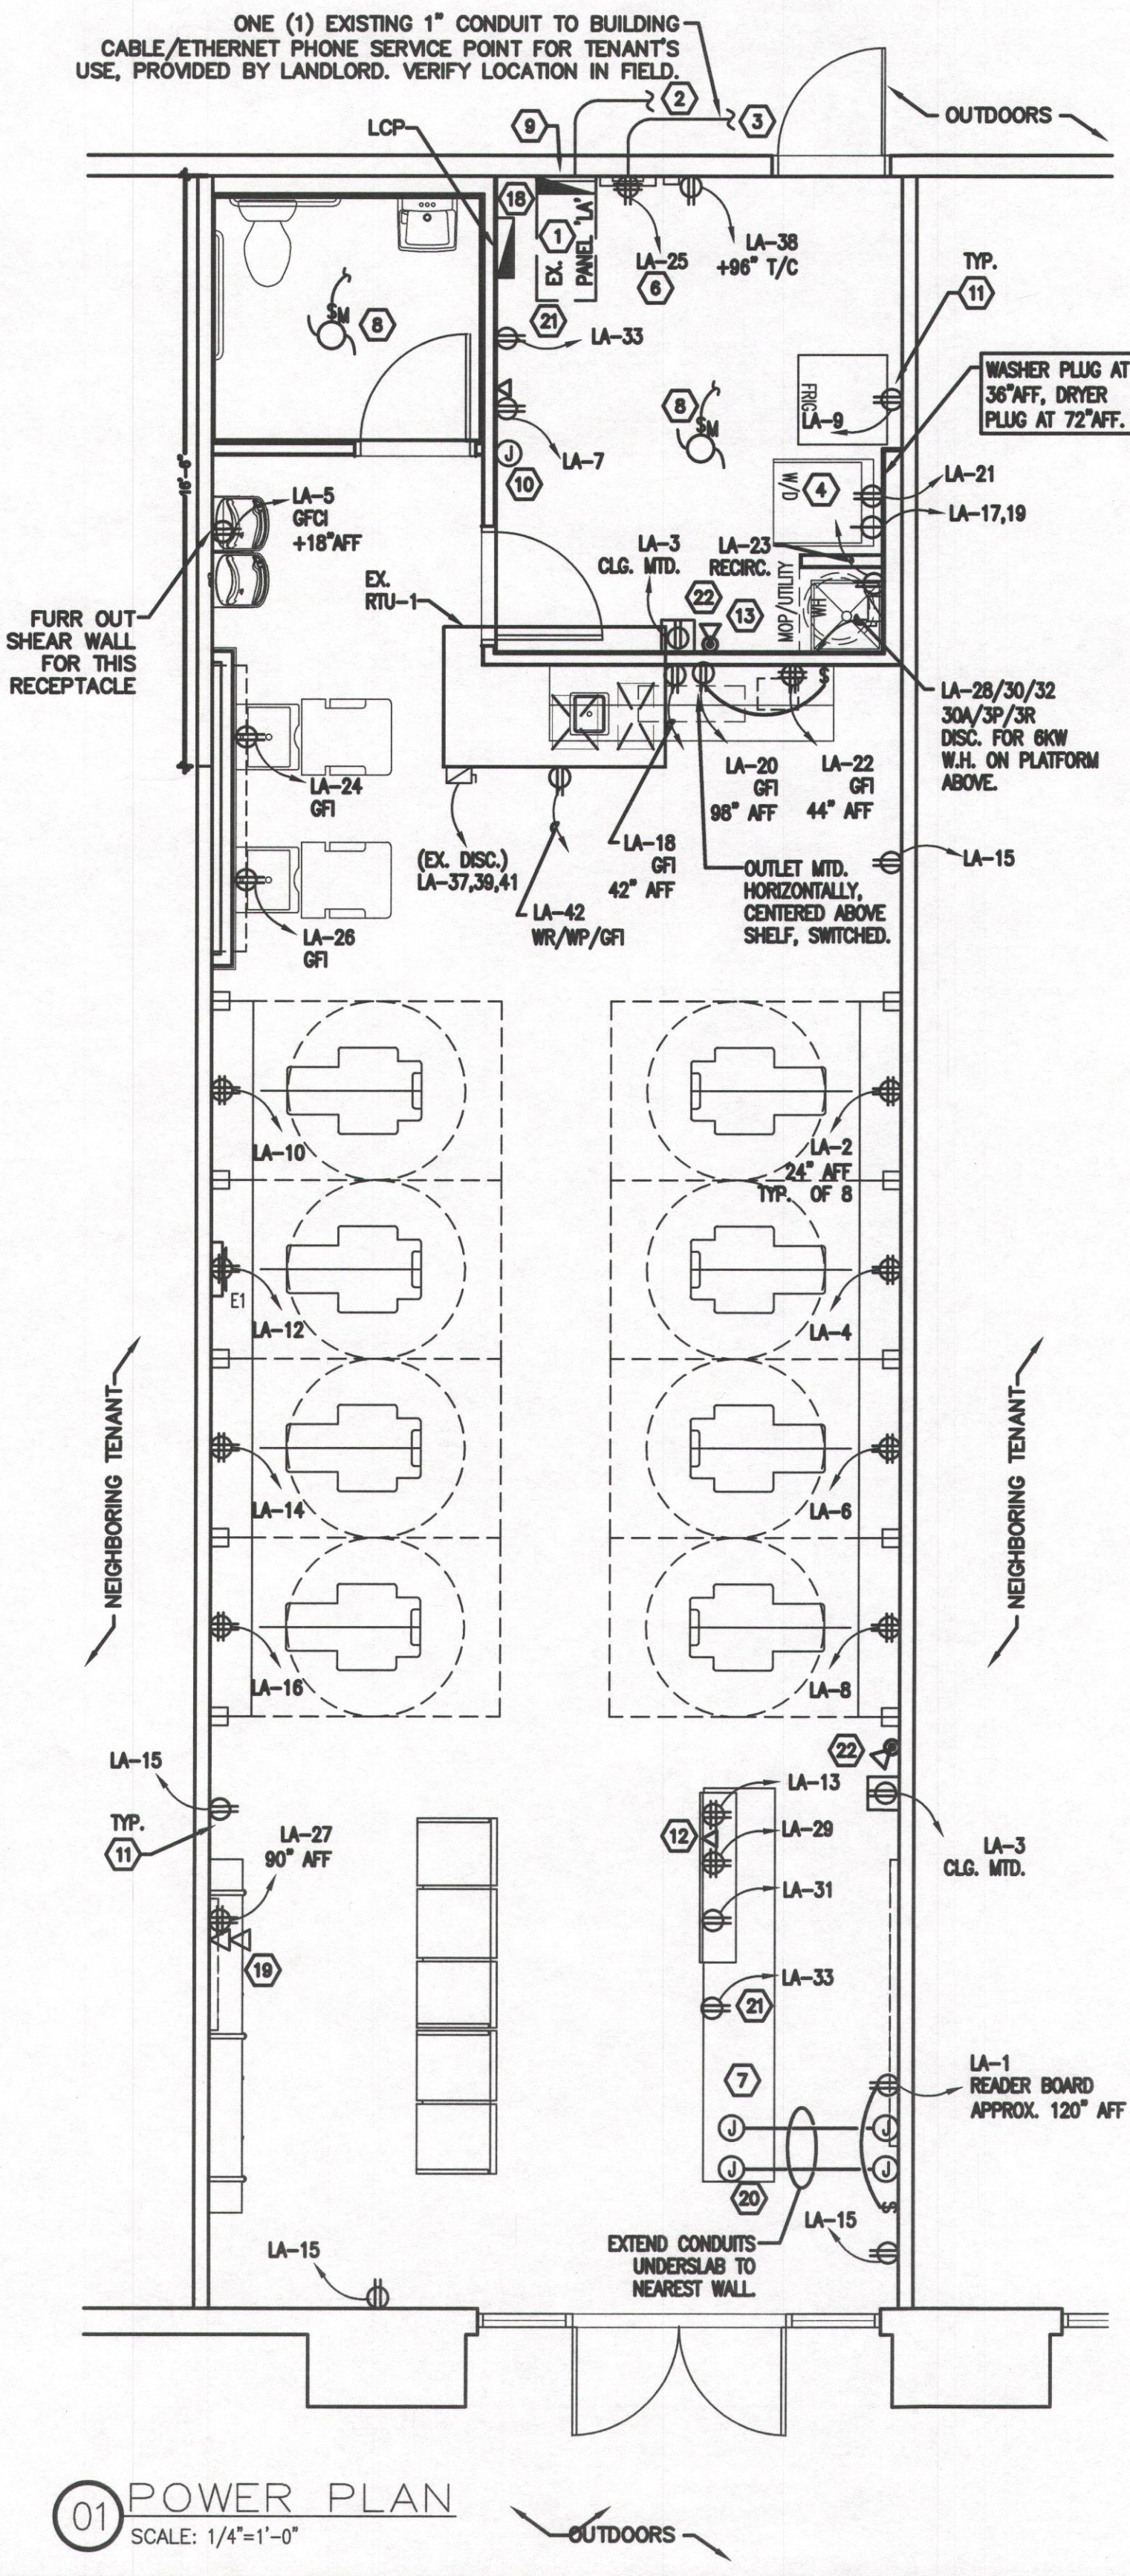

SENSOR/ACCESSORY SCHEDULE						
DESCRIPTION	SYMBOL	MODEL NUMBER	UNOBSTRUCTED RATED COVERAGE	MOUNTING	WATTAGE/VOLTAGE	TIME DELAY
PASSIVE INFRARED SWITCH	\$ <sub>IR</sub>	WATTSTOPPER DW-100 (OR EQUAL)	300 SF	WALL	800W/120V 1200W/277V	5/15/30 MIN
PROVAULT CEILING SENSOR	Ⓢ	LEVITON 06C04-IDW	---	CEILING	---	---
LOW VOLTAGE DIMMER	\$ <sub>D</sub>	LEVITON DSE 06-10Z	---	WALL	---	---
LINE VOLTAGE DIMMER	\$ <sub>D</sub>	LEVITON DSM 10-1LZ	---	WALL	---	---
NOTES: 1. SENSOR REQUIRES POWER PACK (INSTALL IN ACCESSIBLE LOCATION) 2. SWIVEL MOUNTING BRACKET INCLUDED.						

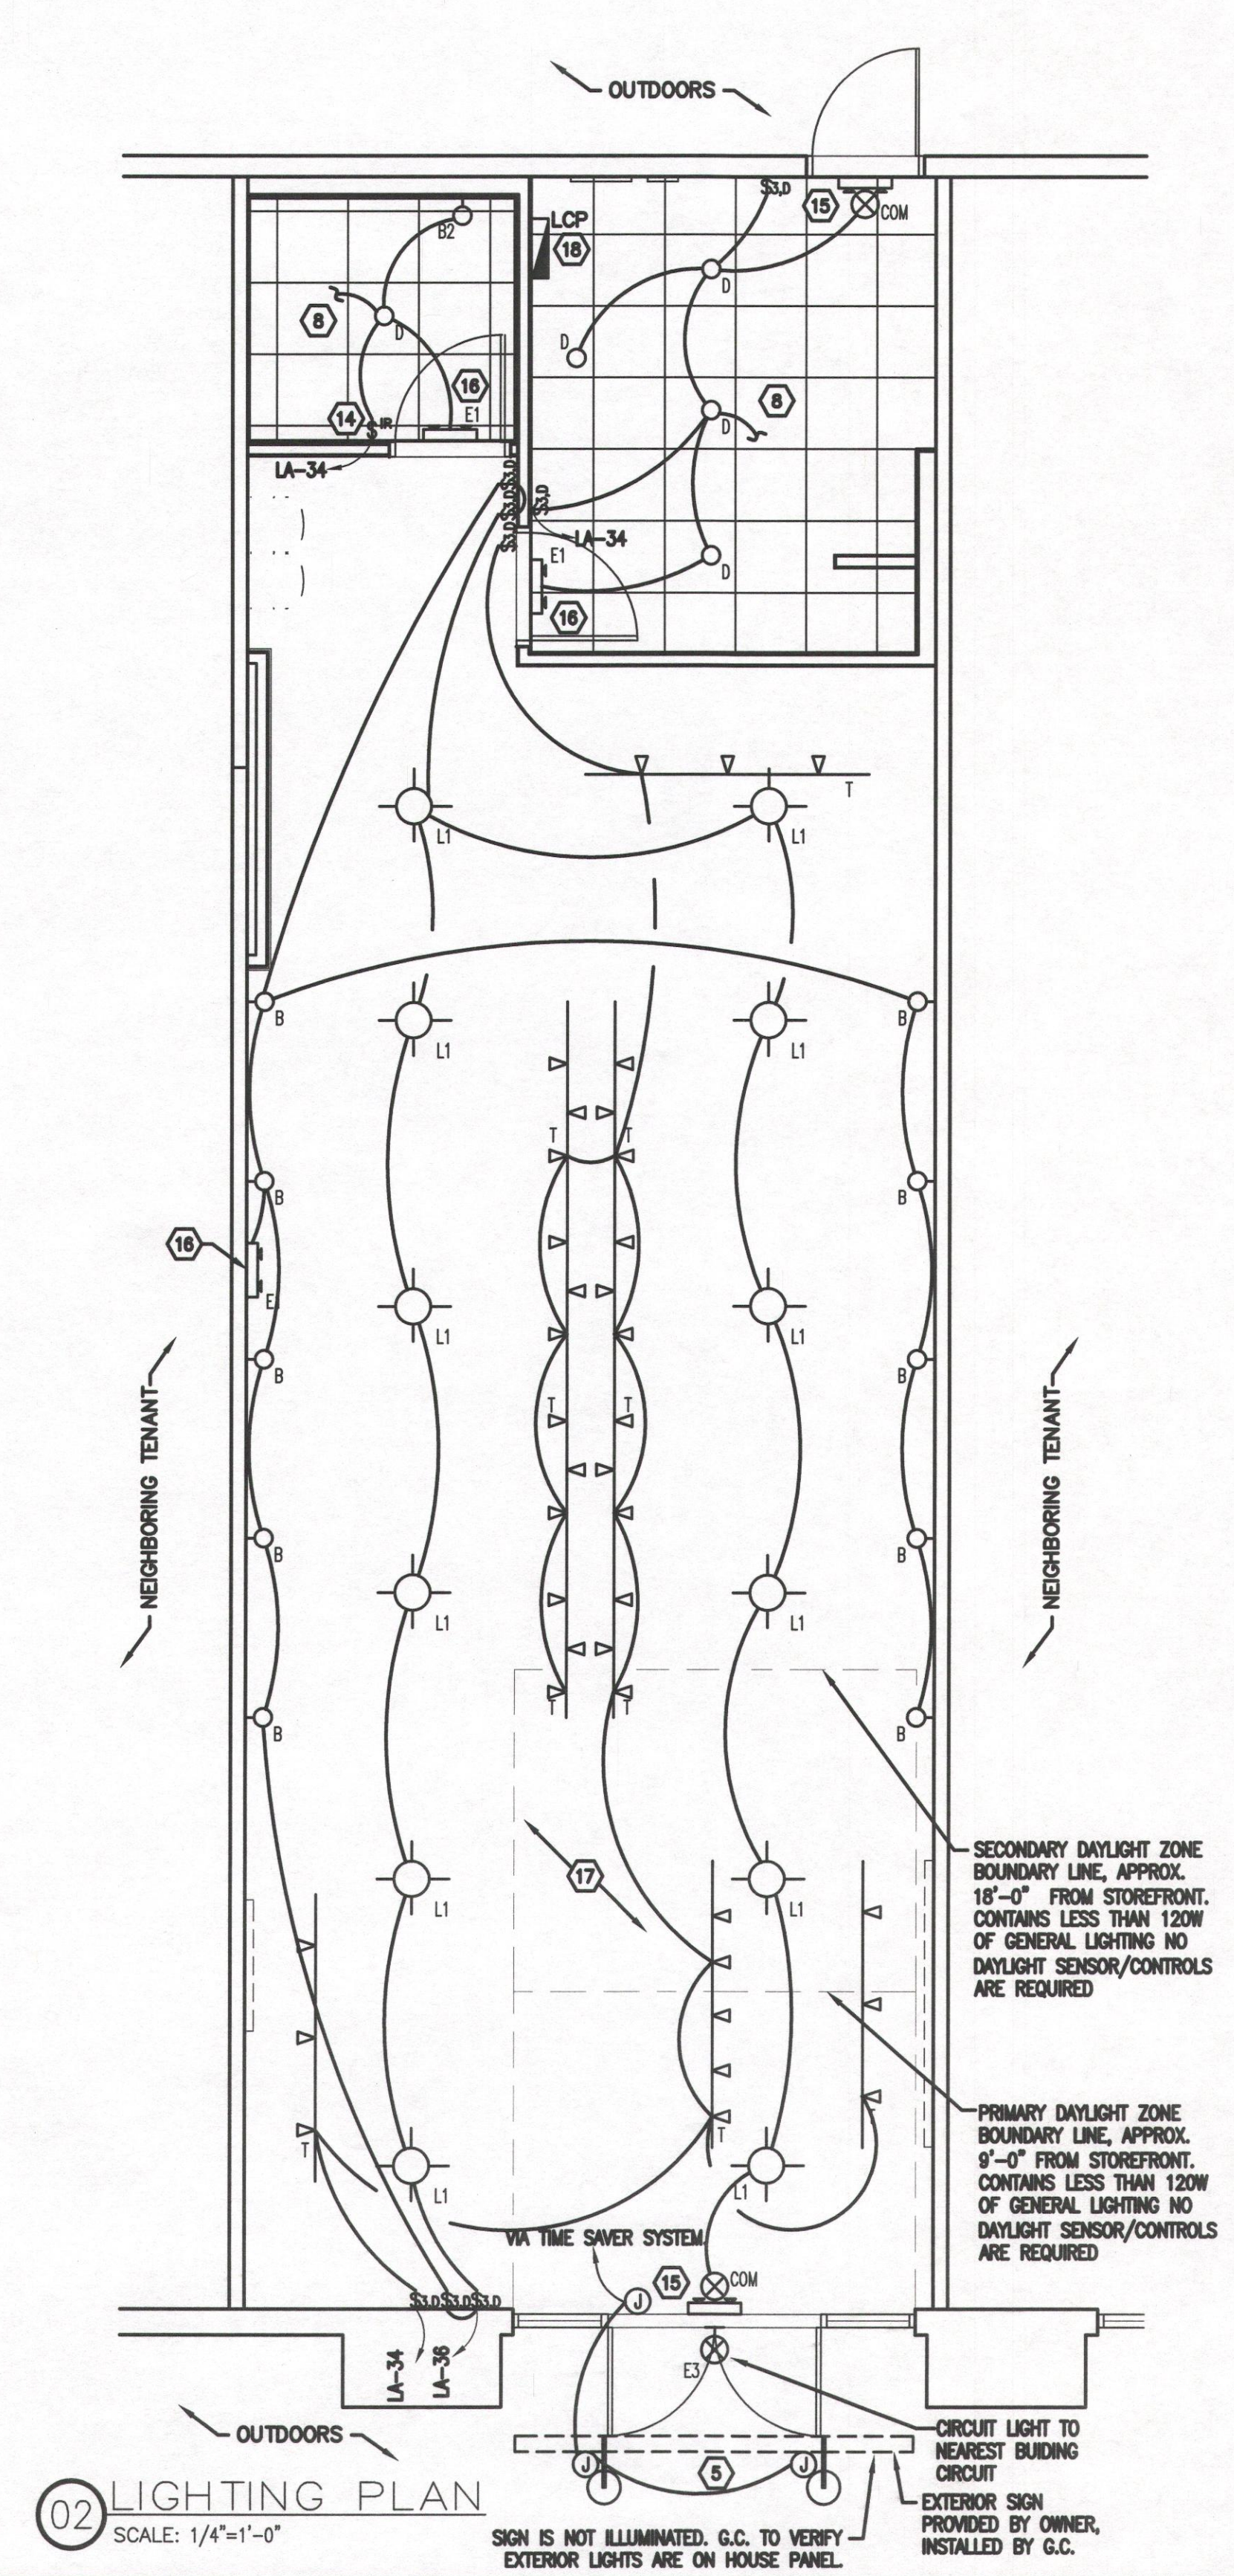

GH A

Architecture / Development  
14901 Quorum Drive  
Suite 300  
Dallas Texas 75254  
  
Ph: (972) 239-8884  
Fax: (972) 239-5054

BISHOPS

BISHOPS — TENANT FINISHOUT  
DANVILLE SQUARE  
39 RAILROAD AVE  
DANVILLE, CA 94526

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS—NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO REVISION

REGISTERED PROFESSIONAL ENGINEER  
PETER A. LEPTUCH  
E 19072  
RELAY A LEPTUCH  
E 19072  
REGISTERED PROFESSIONAL ENGINEER  
PETER A. LEPTUCH  
E 19072  
RELAY A LEPTUCH  
E 19072

ISSUE

PROJECT NUMBER  
C170445

SHEET NUMBER

E1.0  
ELECTRICAL  
PLANS  
DATE OF THIS PRINTING — 03/21/18



PANELBOARD SCHEDULE - 'LA' (EXISTING)																													
MAIN: 200A MCB				VOLTAGE: 208/120										PHASE: 3				WIRE: 4				MOUNTING: SURFACE				A/C: EX			
				LOAD (KVA)						PHASE				LOAD (KVA)															
CKT #	TRIP	POLE	DESCRIPTION	LTG	REC	MTR	A/C	HTG	KIT	MISC	A	B	C	LTG	REC	MTR	A/C	HTG	KIT	MISC	DESCRIPTION	TRIP	POLE	CKT #					
1	201		READER BOARD		0.2										0.4						WORKSTATION	201		2					
3	201		SECURITY		0.5										0.4						WORKSTATION	201		4					
5	201		DRINKING FOUNTAIN		0.5										0.4						WORKSTATION	201		6					
7	201		DESK RECEPTACLE		0.2										0.4						WORKSTATION	201		8					
9	201		REFRIGERATOR							0.5					0.4						WORKSTATION	201		10					
11	201		SPARE												0.4						WORKSTATION	201		12					
13	201		POS		0.4										0.4						WORKSTATION	201		14					
15	201		CONV. REC.		0.7										0.4						WORKSTATION	201		16					
17	302		DRYER (ELEC)							2.5					0.2						COUNTERTOP REC.	201		18					
19	-		-							2.5					0.2						BRANDED LIGHT BOX	201		20					
21	201		WASHING MACHINE							1.0					0.4						TOWEL WARMER	201		22					
23	201		RECIRC. PUMP		0.2										0.5						SHAMPOO STATION (GFI)	201		24					
25	201		PHONE BOARD		0.4										0.5						SHAMPOO STATION (GFI)	201		26					
27	201		TV RECEPTACLE		0.4															1.5	W/H - ELECT	300		28					
29	201		CASH WRAP (QUAD)		0.4															3.0	(NEW BREAKER)	-		30					
31	201		CASH WRAP (DUPEX)		0.2															1.5	-	-		32					
33	201		CONTROLLABLE OUTLET		0.4									1.3							LIGHTING, EF-1	201		34					
35	201		SPARE											1.3							LIGHTING	201		36					
37	303		RTU-1 (EX.)		2.5															0.2	TIME CLOCK	201		38					
39	-		(EX. BREAKER)		2.5																SPARE	201		40					
41	-		-		2.5										0.2						HVAC OUTLETS (WPAWR)	201		42					
LIGHTING (KVA):				2.6	0.0	11.9	0.0	0.0	0.0	0.0	6.5			2.6	4.8	0.0	0.0	0.0	0.0	6.2	CONNECTED LOAD (KVA):				32.0				
RECEPTACLES (KVA):				16.7																		DEMAND LOAD (KVA):				28.6			
MOTORS (KVA):				0.0										PHASE A	10	81.2						CONNECTED LOAD (AMPS):				88.7			
A/C (KVA):				0.0										PHASE B	10	85.4						DEMAND LOAD (AMPS):				79.4			
HEATING (KVA):				0.0										PHASE C	12	99.7													
KITCHEN (KVA):				0.0										KVA		AMPS													
MISCELLANEOUS (KVA):				12.7																		AMPACITY REQUIRED:				81.2			
NOTES: BREAKERS PROTECTING MULTI-WIRE BRANCH CIRCUITS SHALL BE EQUIPPED WITH A PAD-LOCK DEVICE SO THAT CIRCUITS CAN BE DISCONNECTED SIMULTANEOUSLY.																													
a - PROVIDE HACR TYPE CIRCUIT BREAKER																													

\*BALANCE ALL PANELS TO WITHIN 10%.

## 01 PANEL SCHEDULES

SCALE: NOT TO SCALE

BISHOPS PROTOTYPICAL NOTE:  
SEE SHEET M1.0 FOR POWER  
FOR ROOF-MOUNTED  
EQUIPMENT.

REVIEW AND APPROVAL BY  
THE A.H.J. SHALL NOT  
RELIEVE THE APPLICANT OF  
THE RESPONSIBILITY OF  
COMPLIANCE WITH ALL  
APPLICABLE CODES.  
INCLUDING ANY REQUESTS  
MADE BY INSPECTOR ON SITE  
FOR DEFICIENCIES THAT WERE  
NOT IDENTIFIED DURING PLAN  
CHECK REVIEW BY THE AHJ.

VERIFY SIGN LOCATION AND  
QUANTITY WITH SEPARATELY  
PERMITTED SIGN PACKAGE.

VERIFY WITH UTILITY CO.  
EXISTING LOAD  
SERVING NEIGHBORING  
TENANTS (IF PRESENT)  
PRIOR TO ENERGIZING  
SERVICE.

SIGNAGE SHALL COMPLY WITH PERMITTED SIGN  
PACKAGE. ADJUST WHAT IS SHOWN HERE  
(QUANTITY AND LOCATION) TO MATCH SIGNAGE  
SET, TYPICAL UNDER A SEPARATE PERMIT.

HOMERUNS AND BRANCH WIRING FOR 20 AMP CIRCUITS SHALL BE AS FOLLOWS:		
LENGTH	CIRCUIT WIRE SIZE	HOMERUN WIRE SIZE
1FT TO 50FT	NO.12 AWG	NO.12 AWG
51FT TO 75FT	NO.10 AWG	NO.10 AWG
76FT TO 120FT	NO.10 AWG	NO.8 AWG
121FT TO 200FT	NO.10 AWG	NO.6 AWG
201FT TO 300FT	NO.10 AWG	NO.4 AWG

EXISTING ELECTRICAL SERVICE:  
120/208V, 3 PH, 4 WIRE.

## ONE-LINE RISER NOTES:

- PROVIDE LOCK-ON BREAKERS FOR ALL NL/EM AND SECURITY/PHONE CIRCUITS, DUCT DETECTORS, AND TIME CLOCK.
- ALL WIRING, INSULATION, ETC. IN AN ENCLOSED PLENUM SPACE SHALL BE PLENUM RATED.
- USE THIN WIRE INSULATION, 75°C.
- PROVIDE POWER FOR ANCILLARY ITEMS AS NEEDED FOR A COMPLETE INSTALL, SUCH AS DUCT DETECTORS, FLUSH VALVES AND FAUCET SENSORS AS NEEDED.
- WHERE CONTRACTORS ARE ADDING SUB-PANELS TO A PROJECT, THE SUB-PANELS SHALL BE SCOR RATED AT 10 KAIC AND SAME MANUFACTURER AS THE EXISTING PANEL(S) AND SHALL BE FEED FROM A SERIES RATED BREAKER. OTHERWISE SUB-PANELS SHALL BE FULLY RATED WITH SAME SCOR AS ORIGINATING PANEL.
- ELECTRICAL CONTRACTOR SHALL VERIFY AVAILABLE FAULT WITH UTILITY CO. PRIOR TO ORDERING GEAR AND ENERGIZING SERVICE AND SHALL LABEL GEAR WITH SCOR RATING AND AVAILABLE FAULT AT EACH PIECE OF EQUIPMENT AND DATE CALCULATIONS WERE MADE.
- PROVIDE ARCLASH HAZARD WARNING LABELS ON ALL GEAR AS REQUIRED BY N.E.C.
- DISCONNECTS SHALL BE RATED AT VOLTAGE OF EQUIPMENT SERVED. CONFIRM VOLTAGE AVAILABLE ON SITE PRIOR TO ORDERING EQUIPMENT.
- ON 480V JOBS, AS NEEDED, PROVIDE SECONDARY DISCONNECT (FUSED) WITHIN 10' OF THE STEP DOWN TRANSFORMER WHERE SECONDARY CONDUCTOR DISTANCE IS >25' OR AS REQUIRED ELSEWHERE BY THE TAP RULE.


## AMPACITY REQD CALCS

LIGHTING	2.60	KVA X 125	%	=	3.3 KVA
RECEPTACLE TOTAL	16.69	KVA			
1ST	10.00	KVA X 100	%	=	10.0 KVA
REMAIN	6.69	KVA X 50	%	=	3.3 KVA
MOTORS	TOTAL	0.00	KVA X 100	%	
	LARGEST	KVA X 125	%	=	0.0 KVA
	REMAIN	0.00	KVA X 100	%	0.0 KVA
A/C	0.00	KVA X 100	%	=	0.0 KVA
HEATING	0.00	KVA X 100	%	=	0.0 KVA
LOCKED-OUT LOAD		KVA X 100	%	=	0.0 KVA
KITCHEN	0.00	KVA X 65	%	=	0.0 KVA
MISCELLANEOUS	12.66	KVA X 100	%	=	12.7 KVA
TOTAL				=	29.3 KVA



## 04 PHOTO OF PANEL WITHIN SPACE

SCALE: NOT TO SCALE

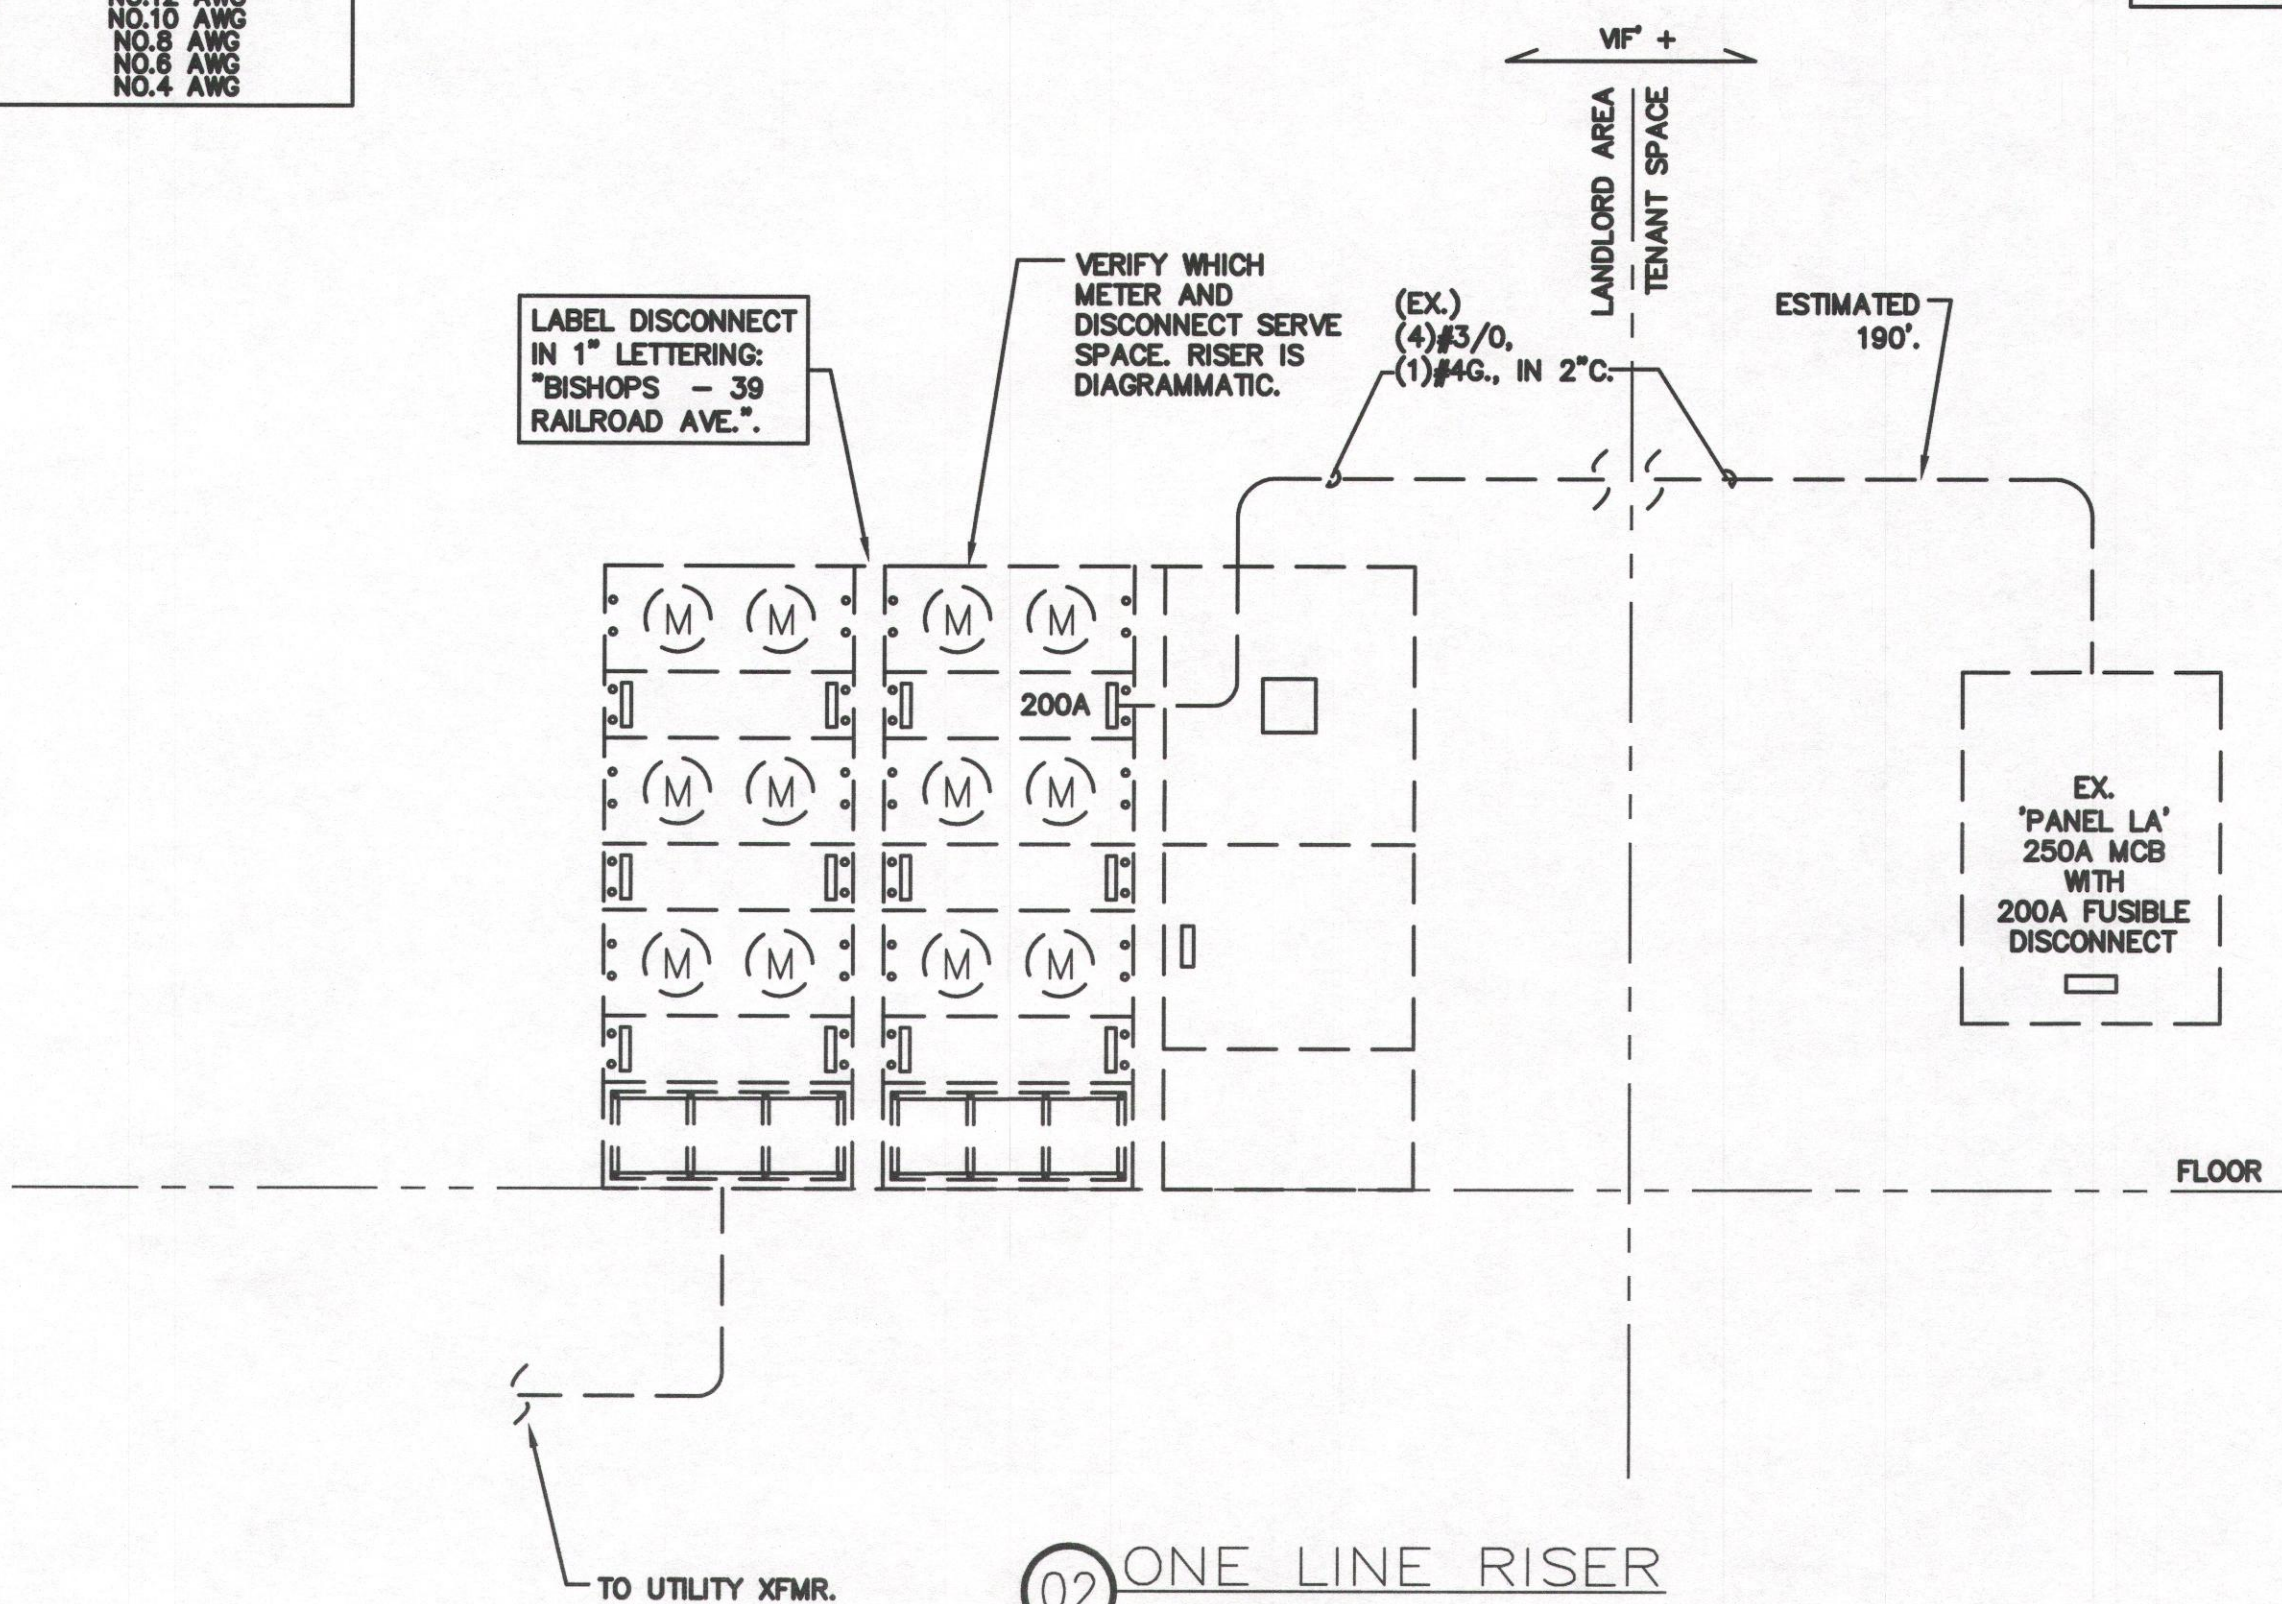

## 02 ONE LINE RISER

SCALE: NOT TO SCALE

## T-24 CONTROLLABLE OUTLET (LEVITON 5362-S2T) REQUIREMENT:

IN ALL BUILDINGS, BOTH CONTROLLED AND UNCONTROLLED 120V RECEPTACLES SHALL BE PROVIDED IN EACH PRIVATE OFFICE, OPEN OFFICE AREA, RECEPTION LOBBY, CONFERENCE ROOM, KITCHENETTE IN OFFICE SPACES, AND COPY ROOM. ADDITIONALLY, HOTEL/MOTEL GUEST ROOMS SHALL COMPLY WITH ITEM 5. CONTROLLED RECEPTACLES SHALL MEET THE FOLLOWINGS REQUIREMENTS, AS APPLICABLE:

- ELECTRIC CIRCUITS SERVING CONTROLLED RECEPTACLES SHALL BE EQUIPPED WITH AUTOMATIC SHUT-OFF CONTROLS FOLLOWING THE REQUIREMENTS PRESCRIBED IN SECTION 130.1(c)(1-5).
- AT LEAST ONE CONTROLLED RECEPTACLE SHALL BE INSTALLED WITHIN 6 FEET FROM EACH UNCONTROLLED RECEPTACLE OR A SPLITWIRE DUPLEX RECEPTACLE WITH ONE CONTROLLED AND ONE UNCONTROLLED RECEPTACLE SHALL BE INSTALLED.
- CONTROLLED RECEPTACLES SHALL HAVE A PERMANENT MARKING TO DIFFERENTIATE THEM FROM UNCONTROLLED RECEPTACLES.
- FOR OPEN OFFICE AREAS, CONTROLLED CIRCUITS SHALL BE PROVIDED AND MARKED TO SUPPORT INSTALLATION AND CONFIGURATION OF OFFICE FURNITURE WITH RECEPTACLES THAT COMPLY WITH SECTION 130.5(d).
- FOR HOTEL AND MOTEL GUEST ROOMS AT LEAST ONE-HALF OF THE 120V RECEPTACLES IN EACH GUEST ROOM SHALL BE CONTROLLED RECEPTACLES THAT COMPLY WITH SECTION 130.5(d)1, 2, AND 3. ELECTRIC CIRCUITS SERVING CONTROLLED RECEPTACLES SHALL HAVE CAPTIVE CARD KEY CONTROLS, OCCUPANCY SENSING CONTROLS, OR AUTOMATIC CONTROLS SUCH THAT, NO LONGER THAN 30 MINUTES AFTER THE GUEST ROOM HAS BEEN VACATED, POWER IS SWITCHED OFF.
- PLUG-IN STRIPS AND OTHER PLUG-IN DEVICES THAT INCORPORATE AN OCCUPANCY SENSOR SHALL NOT BE USED TO COMPLY WITH THIS REQUIREMENT.


BISHOPS PROTOTYPICAL NOTE:  
JURISDICTIONS VARY AS TO WHO CAN MAKE FINAL CONNECTION OF SIGN TO BUILDING POWER. SOME JURISDICTIONS REQUIRE SPECIAL SIGN PERMITS. THE ELECTRICAL CONTRACTOR SHALL PROVIDE AN ACCESSIBLE J-BOX AT BUILDING PERIMETER FOR EACH SIGN LOCATION ON ALL JOBS WITH MEANS OF DISCONNECT AND CONDUCTOR BACK TO THE PANEL, PER NEC. THE SIGN CONTRACTOR SHALL PROVIDE ALL SIGNS WITH A SINGLE WHIP POKING THROUGH THE BACK OF THE SIGN OR SIGN RACEWAY FOR EACH SIGN LOCATION. FINAL CONNECTION (INCLUDING ANY CONDUIT ABOVE METAL AWNING/ STRUCTURE OR OTHER SPECIAL 'GAP' SITE CONDITIONS) SHALL BE BY ELECTRICAL CONTRACTOR UNLESS THE A.H.J. REQUIRES THIS CONNECTION TO BE BY THE SIGN CONTRACTOR.

## LIGHTING CONTROL PANEL ZONES

- TRACK
- 100V SOURCES
- LOW VOLTAGE PENDANT/ MS
- CONTROLLABLE OUTLET
- SIGN
- SPARE
- SPARE
- SPARE

\*WHEN BUILDING SIGN USE IS ROUTED THROUGH LANDLORD'S CONTROL SYSTEM, AND THE CLIENT DOES NOT WANT ANY SPARE CIRCUITS ON THE CONTROL PANEL, THEN A 4-POLE LCP MAY BE USED (RE48D-104).

LIGHTING CONTROL PANEL SPECIFICATION:		
MANUF.	MODEL	NOTES
LEVITON	EZ-MAX RO8BD-000	8-SPACE, CONTROLS LOW AND LINE VOLTAGE CIRCUITS. LCP CONTAINS AN INTEGRAL TIME CLOCK

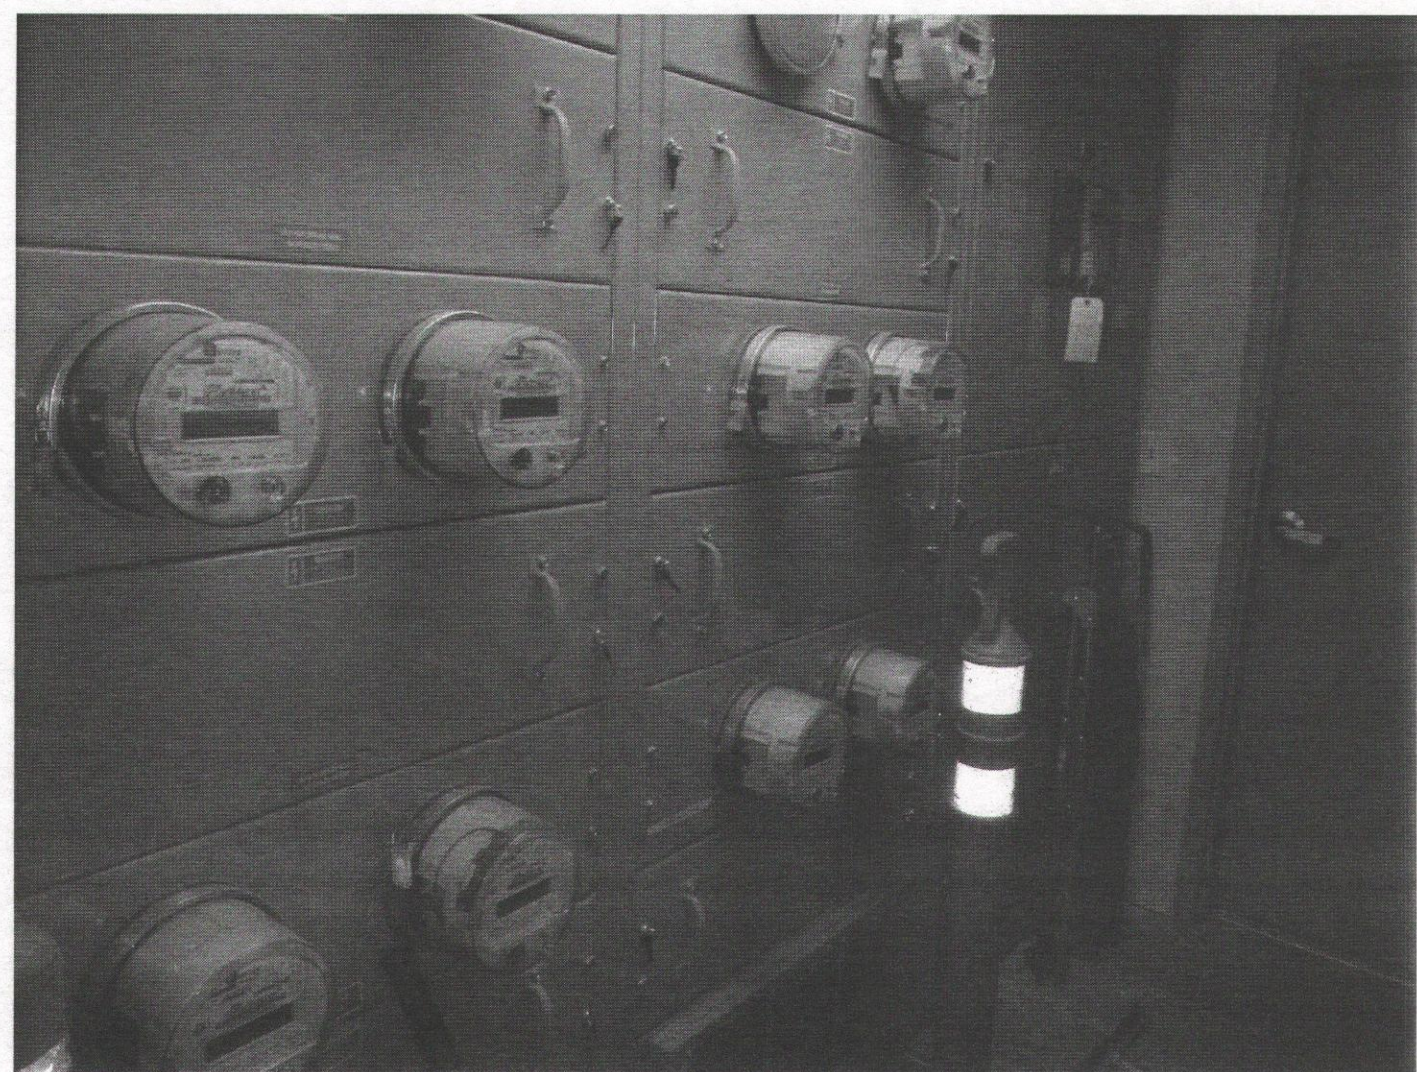

## 03 EXISTING CONDITION PHOTO

SCALE: NOT TO SCALE

## TITLE 24 NOTE:

INDOOR LIGHTING CONTROLS SHALL BE INSTALLED IN COMPLIANCE WITH TITLE 24, PART 6, SECTION 130.1.

A. ALL LUMINARIES SHALL BE FUNCTIONALLY CONTROLLED WITH MANUALLY SWITCHED ON AND OFF LIGHTING CONTROLS. CONTROLS SHALL BE READILY ACCESSIBLE, AND OPERATED WITH A MANUAL SWITCH THAT IS LOCATED IN THE SAME ROOM OR AREA WITH THE LIGHTING THAT IS CONTROLLED BY THAT LIGHTING CONTROL. DIMMING SWITCHES SHALL ALLOW A MANUAL ON-OFF FUNCTIONALITY AND AND IS CAPABLE OF MANUALLY CONTROLLING LIGHTING THROUGH ALL LIGHTING CONTROL STEPS THAT ARE REQUIRED IN SECTION 130.1(B).

B. MULTI-LEVEL LIGHTING CONTROLS. THE GENERAL LIGHTING OF ANY ENCLOSED AREA 100 SQ. FT. OR LARGER, WITH A CONNECTED LIGHTING LOAD THAT EXCEEDS 0.5 WATTS PER SQUARE FOOT SHALL MEET THE FOLLOWING REQUIREMENTS:

1. LIGHTING SHALL HAVE THE REQUIRED NUMBER OF CONTROL STEPS AND MEET THE UNIFORMITY REQUIREMENTS IN ACCORDANCE WITH TABLE 1301-A AND

2. MULTI-LEVEL LIGHTING CONTROLS SHALL NOT OVERRIDE THE FUNCTIONALITY OF OTHER LIGHTING CONTROLS REQUIRED FOR COMPLIANCE WITH SECTIONS 130.1(A), AND (C) THROUGH (E) AND

3. EACH LUMINAIRE SHALL BE CONTROLLED BY AT LEAST ONE OF THE FOLLOWING METHODS.

A. MANUAL DIMMING MEETING THE APPLICABLE REQUIREMENTS OF SECTION 130.1(A)

B. LUMEN MAINTENANCE AS DEFINED IN SECTION 100.1

C. TUNING AS DEFINED IN SECTION 100.1

D. AUTOMATIC DAYLIGHTING CONTROLS IN ACCORDANCE WITH SECTION 130.1(D)

E. DEMAND RESPONSIVE LIGHTING CONTROLS IN ACCORDANCE WITH SECTION 130.1(E)

4. IN ADDITIONAL TO LIGHTING CONTROLS INSTALLED TO COMPLY WITH SECTIONS 130.1(A) AND (B), ALL INSTALLED INDOOR LIGHTING SHALL BE EQUIPPED WITH CONTROLS THAT MEET THE FOLLOWING REQUIREMENTS:

- SHALL BE CONTROLLED WITH AN OCCUPANT SENSING CONTROL, AUTOMATIC TIME-SWITCH CONTROL, SIGNAL FROM ANOTHER BUILDING SYSTEM, OR OTHER CONTROL CAPABLE OF AUTOMATICALLY SHUTTING OFF ALL OF THE LIGHTING WHEN THE SPACE IS TYPICALLY UNOCCUPIED; AND
- SEPARATE-CONTROLS FOR THE LIGHTING ON EACH FLOOR; AND
- SEPARATE CONTROLS FOR A SPACE ENCLOSED BY A CEILING HEIGHT PARTITION NOT EXCEEDING 5000 SQ. FT. (MALLS 20,000 SQ. FT.), [EXCEPTIONS FOR 24/365 FACILITIES, EQUIPMENT ROOMS, ETC.]; AND
- SEPARATE CONTROLS FOR GENERAL, DISPLAY, ORNAMENTAL, AND DISPLAY CASE LIGHTING.

D. DAYLIGHT ZONES ARE REQUIRED. (SEE T-24 FOR ADDITIONAL INFORMATION)

E. DEMAND RESPONSIVE CONTROLS.

LIGHTING POWER IN BUILDINGS LARGER THAN 10,000 SQ. FT. SHALL BE CAPABLE OF BEING AUTOMATICALLY REDUCED IN RESPONSE TO A DEMAND RESPONSE SIGNAL; SO THAT THE BUILDING'S TOTAL LIGHTING POWER CAN BE LOWERED BY A MINIMUM OF 15 PERCENT BELOW THE TOTAL INSTALLED LIGHTING POWER. LIGHTING SHALL BE REDUCED IN A MANNER CONSISTENT WITH UNIFORM LEVEL OF ILLUMINATION REQUIREMENTS IN TABLE 130.1-A.

THE ABOVE REQUIRES AN AUTOMATED LIGHTING CONTROL SYSTEM IN WHICH ALL REQUIRED CIRCUITS ARE ROUTED THROUGH THE CONTROLLER.

AND... ALL LIGHT FIXTURES SHALL BE COMPATIBLE WITH SAID CONTROLLER.

A LIGHTING CONTROL SYSTEM SHALL BE AS SPECIFIED IN THE LIGHTING CONTROL PANEL SCHEDULE. IT IS RECOMMENDED THAT LIGHT FIXTURES AND LIGHTING CONTROL PANEL BE FROM A SINGLE VENDOR THAT VERIFIES COMPATIBILITY OF ALL COMPONENTS AND OFFERS COMMISSIONING OF THE BUILT SYSTEM.

GH A


Architecture / Development  
14901 Quorum Drive  
Suite 300  
Dallas Texas 75254

Ph: (972) 239-8884  
Fax: (972) 239-5054

BISHOPS - TENANT FINISHOUT  
DANVILLE SQUARE  
39 RAILROAD AVE  
DANVILLE, CA 94526

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION

NO | REVISION

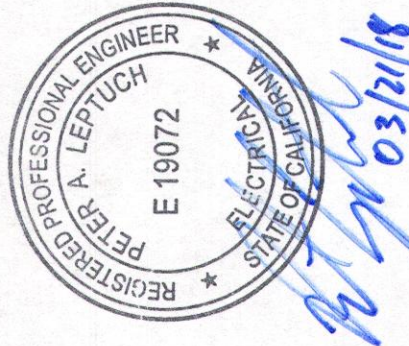

ISSUE

Peter A. Leptuch, P.E.  
California License No. E-19072  
1236 Golden Eagle Ct.  
Aubrey, TX 76227  
(940) 735-5127

PROJECT NUMBER  
C170445

SHEET NUMBER

E2.0  
ELECTRICAL PANELS  
AND RISER  
DATE OF THIS PRINTING - 03/21/18

ISSUE FOR PERMIT 03/22/18



STATE OF CALIFORNIA INDOOR LIGHTING CERTIFICATE OF COMPLIANCE NRCC-LTI-01-E (Page 1 of 6) Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

A. General Information Climate Zone: 12 Conditioned Floor Area: 1,136 Unconditioned Floor Area: 0 Building Type: Nonresidential High-Rise Residential Hotel/Motel Schools Relocatable Public Schools Conditioned Spaces Unconditioned Spaces Phase of Construction: New Construction Addition Alteration Method of Compliance: Complete Building Area Category Tailored Project Address: 39 Railroad Ave.

B. Lighting Compliance Documents (select yes for each document included) For detailed instructions on the use of this and all Energy Efficiency Standards compliance documents, refer to the Nonresidential Manual published by the California Energy Commission.

YES	NO	COMP. DOC.	TITLE
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-01-E	Certificate of Compliance. All Pages required on plans for all submittals.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-02-E	Lighting Controls, Certificate of Compliance, and PAF Calculation. All Pages required on plans for all submittals.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-03-E	Indoor Lighting Power Allowance
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-04-E	Tailored Method Worksheets
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-05-E	Line Voltage Track Lighting Worksheets
<input type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-06-E	Indoor Lighting Existing Conditions

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

April 2016

STATE OF CALIFORNIA INDOOR LIGHTING CERTIFICATE OF COMPLIANCE NRCC-LTI-01-E (Page 2 of 6) Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

C. Summary of Allowed Lighting Power Conditioned and Unconditioned space Lighting must not be combined for compliance.

Indoor Lighting Power for Conditioned Spaces			Indoor Lighting Power for Unconditioned Spaces		
	Installed Lighting	Watts		Installed Lighting	Watts
01	NRCC-LTI-01-F, Table H, page 5	1,469		NRCC-LTI-01-F, Table H, page 5	0
02	Portable Only for Offices NRCC-LTI-01-E, Table G, page 4	+			
03	Minus Lighting Control Credits NRCC-LTI-02-E, page 2	- 8		Minus Lighting Control Credits NRCC-LTI-02-E, page 2	- 0
04	Adjusted Installed Lighting Power (row 1 plus row 2 minus row 3)	= 1,461		Adjusted Installed Lighting Power (row 1 minus row 3)	= 0
Complies ONLY if Installed < Allowed (Box 04 < Box 05)			Complies ONLY if Installed < Allowed (Box 04 < Box 05)		
05	Allowed Lighting Power Conditioned NRCC-LTI-03-E, page 1	1,711	Allowed Lighting Power Unconditioned NRCC-LTI-03-E, page 1		
	Alterations with replacement luminaires that have at least 50/35% lower power compared to the original existing luminaires, may instead use the allowed wattage from NRCC-LTI-06, page 2		Alterations with replacement luminaires that have at least 50/35% lower power compared to the original existing luminaires, may instead use the allowed wattage from NRCC-LTI-06, page 2		

D. Declaration of Required Certificates of Installation Declare by selecting yes for all of the Certificates that will be submitted. (Retain copies and verify forms are completed and signed.)

YES	NO	Compliance Document/Title	
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-01-E - Must be submitted for all buildings.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-LTI-02-E - Must be submitted for a lighting control system, or for an Energy Management Control System (EMCS), to be recognized for compliance.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-LTI-03-E - Must be submitted for a line-voltage track lighting integral current limiter, or for a supplementary overcurrent protection panel used to energize only line-voltage track lighting, to be recognized for compliance.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-LTI-04-E - Must be submitted for two interlocked systems serving an auditorium, a convention center, a conference room, a multipurpose room, or a theater to be recognized for compliance.	<input type="checkbox"/> Field Inspector
<input checked="" type="checkbox"/>	<input type="checkbox"/>	NRCC-LTI-05-E - Must be submitted for a Power Adjustment Factor (PAF) to be recognized for compliance.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCC-LTI-06-E - Must be submitted for additional wattage installed in a video conferencing studio to be recognized for compliance.	<input type="checkbox"/> Field Inspector

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

April 2016

STATE OF CALIFORNIA INDOOR LIGHTING CERTIFICATE OF COMPLIANCE NRCC-LTI-01-E (Page 3 of 6) Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

E. Declaration of Required Certificates of Acceptance Declare by selecting yes for all of the Certificates that will be submitted. (Retain copies and verify forms are completed and signed.)

YES	NO	Compliance Document/Title	
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCA-LTI-02-A - Must be submitted for occupancy sensors and automatic time switch controls.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCA-LTI-03-A - Must be submitted for automatic daylight controls.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCA-LTI-04-A - Must be submitted for demand responsive lighting controls.	<input type="checkbox"/> Field Inspector
<input type="checkbox"/>	<input checked="" type="checkbox"/>	NRCA-LTI-05-A - Must be submitted for institutional tuning power adjustment factor (PAF).	<input type="checkbox"/> Field Inspector

A Separate Lighting Schedule Must Be Filled Out for Conditioned and Unconditioned Spaces. Installed Lighting Power listed on this Lighting Schedule is only for:

☐ CONDITIONED SPACE ☐ UNCONDITIONED SPACE

F. Indoor Lighting Schedule and Field Inspection Energy Checklist

☐ The actual indoor lighting power listed on the next 2 pages includes all installed permanent and planned portable lighting systems.

☐ When Complete Building Method is used for compliance, list each different type of luminaire on separate lines.

☐ When Area Category Method or Tailored Method is used for compliance, list each different type of luminaire by each different function area on separate lines

☐ Also include track lighting in schedule, and submit the track lighting compliance document (NRCC-LTI-05-E) when line-voltage track lighting is installed.

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

April 2016

STATE OF CALIFORNIA INDOOR LIGHTING CERTIFICATE OF COMPLIANCE NRCC-LTI-01-E (Page 4 of 6) Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

G. Installed Portable Luminaires in Offices - Exception to Section 140.6(a)

☐ This section shall be filled out ONLY for portable luminaires in offices (As defined in §100.1). All other planned portable luminaires shall be documented on next page of this compliance document.

☐ This section is used to determine if greater than 0.3 watts of portable lighting is planned for any office

☐ Fill out a separate line for each different office. Small offices that are typical (having the same general and portable lighting) may be grouped together. This allowance shall not be traded between offices having different lighting systems.

Office Portable Luminaire Schedule		Office Installed Portable Luminaire W/ft <sup>2</sup>						Office Location		Field Inspector	
1	2	3	4	5	6	7	8	9	10		
Complete Luminaire Description (i.e., LED, under cabinet, furniture mounted direct/indirect)	Watts per luminaire	Number of luminaires	Installed portable luminaire watts in this office (G02 x G03)	Square feet of this office (G04 x G05)	Watts per square foot (G04 / G05)	If G06 < 0.3, enter zero; If G06 > 0.3 (G06-0.3)	(G05 x G07)	Identify Office area in which these portable luminaires are installed	Pass	Fail	
									<input type="checkbox"/>	<input type="checkbox"/>	
									<input type="checkbox"/>	<input type="checkbox"/>	
									<input type="checkbox"/>	<input type="checkbox"/>	
									<input type="checkbox"/>	<input type="checkbox"/>	
									<input type="checkbox"/>	<input type="checkbox"/>	
Total installed portable luminaire watts that are greater than 0.3 W/ft <sup>2</sup> per office:									Enter sum total of all pages into NRCC-LTI-01-E, Page 1		

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

April 2016

STATE OF CALIFORNIA INDOOR LIGHTING CERTIFICATE OF COMPLIANCE NRCC-LTI-01-E (Page 5 of 6) Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

A Separate Lighting Schedule Must Be Filled Out for Conditioned and Unconditioned Spaces. Installed Lighting Power listed on this Lighting Schedule is only for:

☐ CONDITIONED SPACE ☐ UNCONDITIONED SPACE

H. Indoor Lighting Schedule and Field Inspection Energy Checklist

Luminaire Schedule		Installed Watts			Location		Field Inspector <sup>1</sup>		
01	02	03	04	05	06	07	08		
Name or Item Tag	Complete Luminaire Description (i.e., 3 lamp fluorescent troffer, F32T8, one dimmable electronic ballast)	Watts per luminaire	How wattage was determined CEC Default from MAS According to E19072	Number of luminaires	Total installed Watts in this area (H03 x H05)	Primary function area in which these luminaires are installed	Pass	Fail	
B	22W LED	22.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	10	220	Beauty Salon	<input type="checkbox"/>	<input type="checkbox"/>
B2	B2 - 20W LED	20.0	<input type="checkbox"/>	<input type="checkbox"/>	1	20	Janitors Closet/Utility	<input type="checkbox"/>	<input type="checkbox"/>
D	D - 13W LED	13.0	<input type="checkbox"/>	<input type="checkbox"/>	5	65	Janitors Closet/Utility	<input type="checkbox"/>	<input type="checkbox"/>
L1	L1 - 22W LED	22.0	<input type="checkbox"/>	<input type="checkbox"/>	12	264	Beauty Salon	<input type="checkbox"/>	<input type="checkbox"/>
T	12.5w per ft Track Light (with Current Limiter)	12.5	<input type="checkbox"/>	<input type="checkbox"/>	72	900	Beauty Salon	<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
INSTALLED WATTS PAGE TOTAL:					1,469	Enter sum total of all pages into NRCC-LTI-01-E, Page 2			

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

April 2016

STATE OF CALIFORNIA INDOOR LIGHTING CERTIFICATE OF COMPLIANCE NRCC-LTI-01-E (Page 6 of 6) Project Name: Bishops at Danville, CA Date Prepared: 3/8/2018

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Peter A. Leptuch

Signature Date: 3/8/2018

Address: 1236 Golden Eagle Court

City/State/Zip: Aubrey, TX 76227

Phone: (940) 735-5127

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Peter A. Leptuch

Signature Date: 3/8/2018

Address: 1236 Golden Eagle Court

City/State/Zip: Aubrey, TX 76227

Phone: (940) 735-5127

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance


April 2016

GH A Architecture / Development 14901 Quorum Drive Suite 300 Dallas Texas 75254 Ph: (972) 239-8884 Fax: (972) 239-5054

BISHOPS - TENANT FINISHOUT DANVILLE SQUARE 39 RAILROAD AVE DANVILLE, CA 94526

DO NOT SCALE DRAWINGS CONTRACTOR TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS-NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO BEGINNING CONSTRUCTION

NO REVISION

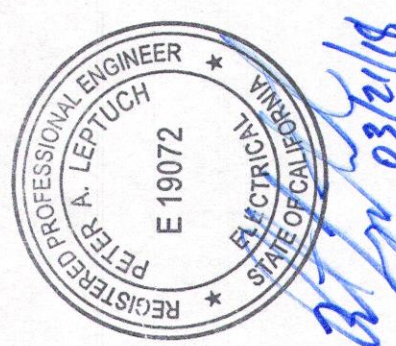

ISSUE

Peter A. Leptuch, P.E. CA-M35700/CA-E19072 1236 Golden Eagle Ct. Aubrey, TX 76227 (940) 735-5127


PROJECT NUMBER C170445

SHEET NUMBER


E3.0 ELECTRICAL TITLE 24 DATE OF THIS PRINTING - 03/21/18

ISSUE FOR PERMIT 03/22/18



STATE OF CALIFORNIA			
INDOOR LIGHTING – LIGHTING CONTROLS			
CEC-NRCC-LTI-02-E (Revised 01/16)		CALIFORNIA ENERGY COMMISSION	
CERTIFICATE OF COMPLIANCE		NRCC-LTI-02-E	
Indoor Lighting - Danville Controls		(Page 1 of 3)	
Project Name Bishops at Danville, CA		Date Prepared 3/8/2018	

A. Mandatory Lighting Control Declaration Statements (Indicate if the measure applies by checking yes or no below.)		
YES	NO	Control Requirements
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Lighting shall be controlled by self-contained lighting control devices which are certified to the Energy Commission according to the Title 20 Appliance Efficiency Regulations in accordance with Section 110.9.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Lighting shall be controlled by a lighting control system or energy management control system in accordance with §110.9. An Installation Certificate shall be submitted in accordance with Section 130.4(b).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	One or more Track Lighting Integral Current Limiters shall be installed which have been certified to the Energy Commission in accordance with §110.9 and §130.0. Additionally, an Installation Certificate shall be submitted in accordance with Section 130.4(b).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	A Track Lighting Supplementary Overcurrent Protection Panel shall be installed in accordance with Section 110.9 and Section 130.0. Additionally, an Installation Certificate shall be installed in accordance with Section 130.4(b).
<input checked="" type="checkbox"/>	<input type="checkbox"/>	All lighting controls and equipment shall comply with the applicable requirements in §110.9 and shall be installed in accordance with the manufacturer's instructions in accordance with Section 130.1.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	All luminaires shall be functionally controlled with manually switched ON and OFF lighting controls in accordance with Section 130.1(a).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	General lighting shall be separately controlled from all other lighting systems in an area. Floor and wall display, window display, case display, ornamental, and special effects lighting shall each be separately controlled on circuits that are 20 amps or less. When track lighting is used, general, display, ornamental, and special effects lighting shall each be separately controlled; in accordance with Section 130.1(a4).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	The general lighting of any enclosed area 100 square feet or larger, with a connected lighting load that exceeds 0.5 watts per square foot shall meet the multi-level lighting control requirements in accordance with Section 130.1(b).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	All installed indoor lighting shall be equipped with controls that meet the applicable Shut-OFF control requirements in Section 130.1(c).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Lighting in all Daylit Zones shall be controlled in accordance with the requirements in Section 130.1(e) and daylit zones are shown on the plans.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Lighting power in buildings larger than 10,000 square feet shall be capable of being automatically reduced in response to a Demand Responsive Signal in accordance with Section 130.1(e).
<input checked="" type="checkbox"/>	<input type="checkbox"/>	Before an occupancy permit is granted for a newly constructed building or area, or a new lighting system serving a building, area, site or site operated for normal use, indoor lighting controls serving the building, area, or site shall be certified as meeting the Acceptance Requirements for Code Compliance in accordance with Section 130.4 (a). The controls required to meet the Acceptance Requirements include automatic daylight controls, automatic shut-off controls, and demand responsive controls.


STATE OF CALIFORNIA			
<b>INDOOR LIGHTING – LIGHTING CONTROLS</b> CEC-NRCC-LTI-02-E (Revised 01/16)			
CERTIFICATE OF COMPLIANCE		CALIFORNIA ENERGY COMMISSION	
Indoor Lighting – Lighting Controls		NRCC-LTI-02-E	
Project Name: Bishops at Danville, CA		(Page 2 of 3)	
		Date Prepared: 3/8/2018	

☐ A separate document must be filled out for Conditioned and Unconditioned Spaces. This page is used only for the following:  
☐ CONDITIONED SPACES      ☐ UNCONDITIONED SPACES

**B. Mandatory and Prescriptive Indoor Lighting Control Schedule, PAF Calculation, and Field Inspection Checklist**

Lighting Control Schedule		Standards Complying With <sup>1</sup> (* if all that apply, or enter "x" if Exempted)									PAF Credit Calculation <sup>2</sup>			✓ if Acceptance Test Required	Field Inspector
01	02	03	04	05	06	07	08	09	10	Watts of Controlled Lighting	PAF	Control Credit (x=1)			
Location in Building	Type/Description of Lighting Control (i.e.: occupancy sensor, automatic time switch, dimmer, automatic daylight, etc...)	# of Units	\$130.1(a)	\$130.0(b)	\$130.1(c)	\$130.1(d)	\$130.1(e)	\$130.1(f)	\$140.6(a)	\$140.6(d)					
Restroom & Utility Room	Occ Sensor - <= 125 sqft		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	20	0.40	8	<input checked="" type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>				<input type="checkbox"/>	<input type="checkbox"/>
Control Credit PAGE TOTAL (Sum of Column 13):											8				
IF MULTIPLE PAGES ARE USED, ENTER SUM TOTAL OF Control Credit for all pages HERE (Sum of all Column 13):											8			Enter Control Credit total into NIRCCT-L101-E; Page 1.	


<sup>1</sup> \$130.1(a) = Manual area controls; \$130.0(b) = Multi Level; \$130.1(c) = Auto Shut-Off; \$130.1(d) = Mandatory Daylight; \$130.1(e) = Demand Response; \$140.6(d) = Additional lighting controls installed to earn a PAF; \$140.6(f) = Prescriptive Secondary Sidebit Daylight Controls.  
<sup>2</sup> Check Table 140.6-A for correct Factor. PAFs shall not be traded between conditioned and unconditioned spaces. As a condition to earn a PAF, an installation Certificate is also required to be filled out, signed, and submitted.

STATE OF CALIFORNIA			
<b>INDOOR LIGHTING – LIGHTING CONTROLS</b> CE-CAN00CA-T402-E (Revised 01/15)			
CERTIFICATE OF COMPLIANCE		CALIFORNIA ENERGY COMMISSION	
Indoor Lighting - Lighting Controls		NRCC-LT-02-4	
Project Name: Bishops at Danville, CA		Date Prepared: 3/8/2018 (Page 3 of 3)	

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT	
<p>1. I certify that this Certificate of Compliance documentation is accurate and complete.</p>	
<p>Documentation Author Name: <b>Peter A. Leptuch</b></p>	<p>Documentation Author Signature: </p>
<p>Company: <b>Peter A. Leptuch, P.E.</b></p>	<p>Signature Date: <b>3/8/2018</b></p>
<p>Address: <b>1236 Golden Eagle Court</b></p>	<p>LEA Certification Identification (if applicable):</p>
<p>City/State/Zip: <b>Aubrey, TX 76227</b></p>	<p>Phone: <b>(840) 735-5127</b></p>

RESPONSIBLE PERSON'S DECLARATION STATEMENT	
<p>I certify the following under penalty of perjury, under the laws of the State of California:</p>	
<p>1. The information provided on this Certificate of Compliance is true and correct.</p>	
<p>2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).</p>	
<p>3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1, and Part 6 of the California Code of Regulations.</p>	
<p>4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.</p>	
<p>I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.</p>	
<p>Responsible Designer Name: <b>Peter A. Leptuch</b></p>	<p>Responsible Designer Signature: </p>
<p>Company: <b>Peter A. Leptuch, P.E.</b></p>	<p>Date Signed: <b>3/8/2018</b></p>
<p>Address: <b>1236 Golden Eagle Court</b></p>	<p>LEA ID: <b>E19072</b></p>
<p>City/State/Zip: <b>Aubrey, TX 76227</b></p>	<p>Phone: <b>(840) 735-5127</b></p>

STATE OF CALIFORNIA <b>INDOOR LIGHTING POWER ALLOWANCE</b> CEC-NRCC-LTI-03-E (Revised 04/18)		CALIFORNIA ENERGY COMMISSION 	
<b>CERTIFICATE OF COMPLIANCE</b>		NRCC-LTI-03-E	
Certificate of Compliance - Indoor Lighting Power Allowance		(Page 1 of 4)	
Project Name: Bishops at Danville, CA		Date Prepared: 3/8/2018	

A separate page must be filled out for Conditioned and Unconditioned Spaces. This page is only for:


☒ **CONDITIONED** spaces                      ☐ **UNCONDITIONED** spaces

A. SUMMARY TOTALS OF LIGHTING POWER ALLOWANCES		
<input type="checkbox"/> If using Complete Building Method for compliance, use only the total in column (a) as total allowed building watts.		
<input type="checkbox"/> If using Area Category Method, Tailored Method, or a combination of Area Category and Tailored Method for compliance, use only the total in column (b) as the total allowed building watts		
	(a)	(b)
01 Complete Building Method Allowed Watts. Documented in section B of NRCC-LTI-03-E (below on this page)		
02 Area Category Method Allowed Watts. Documented in section C-1 of NRCC-LTI-03-E (below on this page)		1,711
03 Tailored Method Allowed Watts. Documented in section A of NRCC-LTI-04-E		0
<b>TOTAL ALLOWED BUILDING WATTS. Enter number into correct cell on NRCC-LTI-01, Page 2, Row 1</b>		1,711
<input type="checkbox"/> Check here if building contains both conditioned and unconditioned areas		

<b>B. COMPLETE BUILDING METHOD LIGHTING POWER ALLOWANCE</b>					
<b>01</b>	<b>02</b>		<b>03</b>		<b>04</b>
<b>TYPE OF BUILDING (from §140.6 Table 140.6-B)</b>	<b>WATTS PER R<sup>2</sup></b>	<b>X</b>	<b>COMPLETE BLDG. AREA</b>	<b>=</b>	<b>ALLOWED WATTS</b>
	Total Area:				
Total Watts. Enter Total Watts into section A, row I (Above on this page)					

C-1 AREA CATEGORY METHOD TOTAL LIGHTING POWER ALLOWANCES	Watts
Total from section C-2	1,711
Total from section C-3	0
Total Watts. Enter Total Watts into section A, row 2 (Above on this page).	1,711


**For Alterations Only** – Reduced lighting power option (Total Allowed Watts x 0.85). Enter this value into section A, row 2 if using this option.

STATE OF CALIFORNIA <b>INDOOR LIGHTING POWER ALLOWANCE</b> CEC-NRCC-LT103-E (Revised 04/16)		CALIFORNIA ENERGY COMMISSION		
<b>CERTIFICATE OF COMPLIANCE</b>		NRCC-LT103-E		
Certificate of Compliance - Indoor Lighting Power Allowance		(Page 2 of 4)		
Project Name:	Bishops at Danville, CA	Date Prepared:	3/8/2018	

A separate page must be filled out for Conditioned and Unconditioned Spaces. This page is only for:

☒ **CONDITIONED** spaces                      ☐ **UNCONDITIONED** spaces

[illegible]



STATE OF CALIFORNIA			
<b>INDOOR LIGHTING POWER ALLOWANCE</b>			
CEC-NRCC-LTI-03-E (Revised 04/16)		CALIFORNIA ENERGY COMMISSION	
<b>CERTIFICATE OF COMPLIANCE</b>		NRCC-LTI-03-E	
Certificate of Compliance - Indoor Lighting Power Allowance		(Page 3 of 4)	
Project Name: Bishops at Danville, CA		Date Prepared: 3/8/2018	

A separate page must be filled out for Conditioned and Unconditioned Spaces. This page is only for:

☒ **CONDITIONED** spaces                      ☐ **UNCONDITIONED** spaces

[illegible]



CALIFORNIA STATE OF CALIFORNIA <b>BUILDING LIGHTING POWER ALLOWANCE</b> <small>(CALIFORNIA L.E.D.S. PLACES ACT)</small> <b>CERTIFICATE OF COMPLIANCE</b> Certificate of Compliance - Indoor Lighting Power Allowance		CALIFORNIA ENERGY COMMISSION  NREL/CIT-L-CEC (Page 4 of 4)
<b>Hospitals at Danville, CA</b>		Date Prepared: <b>3/8/2018</b>
<b>DOCUMENTATION AUTHOR'S DECLARATION STATEMENT</b>		
I, certify that this Certificate of Compliance documentation is accurate and complete. Documentation Author Name: <b>Peter A. Leptuch</b>		
Signature:	<b>Peter A. Leptuch, P.E.</b> 	Documentation Author Signature:
Address:	<b>1236 Golden Eagle Court</b> <b>Aubrey, TX 76227</b>	Signature Date: <b>3/8/2018</b>
City/Town/Village:		SEA Certification Identification (if applicable): _____
		Phone: <b>(940) 735-5127</b>
<b>RESPONSIBLE PERSON'S DECLARATION STATEMENT</b>		
I certify the following under penalty of perjury, under the laws of the State of California: 1. The information provided on this Certificate of Compliance is true and correct. 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer). 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations. 4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans, and specifications submitted to the enforcement agency for approval with this building permit application. 5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of the Certificate of Compliance is required to be included with the document(s) the builder provides to the building owner at occupancy.		
Responsible Designer Name:	<b>Peter A. Leptuch</b> 	
Company:	<b>Peter A. Leptuch, P.E.</b>	
Address:	<b>1236 Golden Eagle Court</b>	
City/Town/Village:	<b>Aubrey, TX 76227</b>	
	Responsible Designer Signature: _____ Date Signed: <b>3/8/2018</b> License#: <b>E19072</b> Phone: <b>(940) 735-5127</b>	

**DATE OF CALCULATION:**  
**LINE-VOLTAGE TRACK LIGHTING WORKSHEET**  
(SEE INSTRUCTIONS ON REVERSE SIDE)

**CERTIFICATE OF COMPLIANCE**  
 Indoor Lighting – Line-Voltage Track Lighting Worksheet  
(Page 1 of 2)

**Project Name:** Bishops at Danville, CA

**NRCCLT-45-E**  
(Page 1 of 2)

**Date Prepared:** 3/8/2018

There are four different methods available for determining how many watts of line-voltage track, or line-voltage busway, has been installed. One or more methods may be used to determine how many watts of line-voltage track, or line-voltage busway, has been installed. Use this worksheet to separately calculate the input wattage for each system.

Separately enter each row of this worksheet into the Luminaire Schedule in Section H of NRCCLT-41-E

Method 1 is the only option available for determining wattage for track or busway rated for more than 20 amperes

**□ A. METHOD 1 – VOLT-AMPERE (VA) RATING OF THE BRANCH CIRCUIT(S)**

01				02	
BRANCH CIRCUIT NAME OR ID				VOLT-AMPERE (VA) RATING OF THE BRANCH CIRCUIT	

**□ B. METHOD 2 – USE THE HIGHER OF 45 WATTS PER LINEAR FOOT OF TRACK OR TOTAL RATED WATTAGE OF ALL LUMINAIRES**

01	02	03	04	05	06
Track or Name #	Linear Feet of Track	(W)/F	802 x 808 (W)	Total Rated Wattage of All Luminaires	Larger of 804 or 808
		45			
		45			
		45			

**□ C. METHOD 3 – USE THE HIGHER OF: 12.5 WATTS / LINEAR FOOT OF TRACK – OR VA RATING OF INTEGRAL CURRENT LIMITER**

☐ Only integral current limiters which are certified to the Energy Commission shall be recognized by the Standards.  
☐ This method shall not be recognized if an Installation Certificate is not submitted.

01	02	03	04	05	06
Track or Name #	Linear Feet of Track	(W)/F	C02 x C03 (W)	VA Rating of Integral Current Limiter	Larger of C04 or C05
		12.5			
		12.5			
		12.5			

**□ D. METHOD 4 - DEDICATED TRACK LIGHTING SUPPLEMENTARY OVERCURRENT PROTECTION PANEL**

☐ This method shall not be recognized if an Installation Certificate is not submitted.  
☐ This method shall be used only for line-voltage track lighting, and shall not be recognized for any other lighting systems. If any other lighting systems or devices are installed, the supplementary overcurrent protection panel shall not be recognized for compliance with the Standards


01	02	03	04
Name or ID	Voltage of the Branch Circuit	Sum of the Ampere Rating of all Devices Installed in the Panel	Wattage = Sum of the Ampere Ratings of all of the Devices Times the Branch Circuit Voltage [002 x 003]

**DOCUMENTATION AUTHOR'S DECLARATION STATEMENT**

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

STATE OF CALIFORNIA LINE-VOLTAGE TRACK LIGHTING WORKSHEET		CALIFORNIA ENERGY COMMISSION	
CEC-NRCC-11-014, Revised 01/18		NRCC-1171-05-E	
CERTIFICATE OF COMPLIANCE		(Page 2 of 2)	
Indoor Lighting – Line-Voltage Track Lighting Worksheet			
Project Name: <b>Biophos at Danville, CA</b>		Date Permitted: <b>3/8/2018</b>	


I, <b>certify that this Certificate of Compliance documentation is accurate and complete.</b>			
Documentation Author Name: <b>Peter A. Leptuch</b>		Documentation Author Signature: 	
Company: <b>Peter A. Leptuch, P.E.</b>	Signature Date: <b>3/8/2018</b>	CEA Certification Identification (if applicable):	
Address: <b>1236 Golden Eagle Court</b>			
City/State/Zip: <b>Aubrey, TX 76227</b>	Phone: <b>(940) 735-5127</b>		

**RESPONSIBLE PERSON'S DECLARATION STATEMENT**

I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to ~~the building owner~~ the building owner's designated representative.

Responsible Designer Name: <b>Peter A. Leptuch</b>		Responsible Designer Signature: 	
Company: <b>Peter A. Leptuch, P.E.</b>	Date Signed: <b>3/8/2018</b>		
Address: <b>1236 Golden Eagle Court</b>	License: <b>E19072</b>		
City/State/Zip: <b>Aubrey, TX 76227</b>	Phone: <b>(940) 735-5127</b>		

STATE OF CALIFORNIA

**SIGN LIGHTING**

(RECALCULATED FOR SUBMITTAL 2018)

CERTIFICATE OF COMPLIANCE

Sign Lighting

Project Name: **Bishops at Danville, CA**

CALIFORNIA ENERGY COMMISSION

NRCC-15-01-01  
(Page 1 of 5)

Date Received: **3/6/2018**

**A. General Information**

Project Address: **39 Railroad Ave. Danville, CA 94526**

Location of Sign ☐ Outdoor Signs ☐ Indoor Signs

Phase of Sign Construction ☐ New Signs ☐ Sign Alterations

Type of Lighting Control ☒ New Lighting Controls ☐ Replaced Lighting Controls ☐ Not installing Lighting Controls

This Certificate of Compliance includes the following components (check all that apply):

☒ Mandatory Measures (Lighting Controls) ☐ Maximum Allowed Lighting Power ☐ Specific Lighting Sources

**1. Mandatory Sign Lighting Controls**

1. The same responsible person may install both the sign lighting power and the sign lighting controls, or a different responsible person may install the sign lighting controls than the responsible person installing the sign lighting power.

2. The *Mandatory Measures (sign lighting controls)* are required for compliance with the sign lighting Standards. If the person responsible for installing the sign lighting power is not also responsible for the sign lighting controls, then the owner of the sign, general contractor, or architect shall be responsible to have the sign lighting controls installed.

3. If more than one person has responsibility for compliance, each responsible person shall prepare and sign a Certificate of Compliance and an installation Certificate applicable to the portion of construction for which they are responsible; alternatively, the person with chief responsibility for construction shall prepare and sign the Certificate of Compliance Declaration Statement for the entire construction (e.g., a C-10 contractor may complete parts 1a and 1b on one compliance document and a C-45 contractor may complete parts 2a and 2b on a separate compliance document – the Responsible Designer shall submit the two compliance documents together for the same complete installation).

**I have responsibility for installing the sign lighting controls:**

☐ Yes, have responsibility for the sign lighting controls, and will complete parts 1a and 1b of this compliance document.
 ☐ No, I do not have responsibility for installing the sign lighting controls. Someone else will complete parts 1a and 1b of this compliance document.

**1a. Check Yes or No for all of the following statements:**

1 There are existing sign lighting controls that comply with the applicable provisions of §110.9 and §130.3

☐ Yes ☐ No

2 There are no existing sign lighting controls and I will be installing sign lighting controls that comply with the applicable provisions of §110.9 and §130.3

☐ Yes ☐ No

3 There are existing sign lighting controls that do not comply with the applicable provisions of §110.9 and §130.3 and I will be installing sign lighting controls that comply with the applicable provisions of §110.9 and §130.3

☐ Yes ☐ No

CAL Building Energy Efficiency Standards - 2016 Nonresidential Compliance

August 2018

STATE OF CALIFORNIA <b>SIGN LIGHTING</b> <small>2019-2020 (NRCCLTS-01-E) (Revised 2019)</small>		<small>7/20/2019</small> <b>CALIFORNIA ENERGY COMMISSION</b> (Page 2 of 3)	
<b>CERTIFICATE OF COMPLIANCE</b> Sign Lighting Project Name: <span style="border-bottom: 1px solid black; display: inline-block; width: 150px;"></span>			
Bishops at Danville, CA		Date Prepared: <b>3/6/2018</b>	
<b>1b. Mandatory Sign Lighting Controls</b> If the person signing the Certificate of Compliance Declaration Statement on this NRCCLTS-01-E is responsible for complying with the sign lighting control requirements, that person shall answer all of the following questions:			
If there are construction documents, indicate where on the building plans the mandatory measures (sign lighting control) note block can be located:			
1	<b>§130.3(a)(1). All indoor sign lighting is controlled with an automatic time-switch control or astronomical time-switch control.</b>	Y	N NA
2	<b>§130.3(a)(2A). All outdoor sign lighting is controlled with a photocontrol in addition to an automatic time-switch control, or an astronomical time-switch control.</b>	Y	N NA
3	<b>EXCEPTION TO SECTION 130.3(a)(2A):</b> Outdoor signs in tunnels, and signs in large permanently covered outdoor areas that are intended to be continuously lit 24 hours per day and 365 days per year.	Y	N NA
4	<b>§130.3(a)(2B).</b> All outdoor sign lighting that is ON both day and night is controlled with a dimmer that provides the ability to automatically reduce sign lighting power by a minimum of 65% during nighttime hours. Signs that are illuminated at night for more than 1 hour during day/night hours shall be considered ON both day and night.	Y	N NA
5	<b>EXCEPTION TO SECTION 130.3(a)(2B):</b> Outdoor signs in tunnels and large covered areas that are intended to be illuminated both day and night.	Y	N NA
6	<b>§130.3(a)(3). Demand Responsive Electronic Message Center Control.</b> An Electronic Message Center (EMC) having a new connected lighting power load greater than 15 kW has a control installed that is capable of reducing the lighting power by a minimum of 30% when receiving a demand response signal.	Y	N N/A
7	<b>EXCEPTION TO SECTION 130.3(a)(3):</b> Lighting for EMCs that is not permitted by a health or life safety statute, ordinance, or regulation to be reduced by 30%.	Y	N NA
Field Inspector Name: _____			

[illegible]

STATE OF CALIFORNIA  
**SIGN LIGHTING**  
California Electrical Code (CEC) (2019)

**CERTIFICATE OF COMPLIANCE**

Sign Lighting

Project Name: **Bishops at Danville, CA**

CALIFORNIA ENERGY COMMISSION

NRCC-145-01-8  
(Page 4 of 3)

Date: **3/8/2016**

**2b. Specific Lighting Source Method of Compliance**

Certificate of Compliance and Field Inspection Energy Checklist

Complete this part if there are signs using the Specific Lighting Source method of compliance. (Complete part 2 of this Certificate of Compliance if there are signs using the maximum allowed lighting power method of compliance)


A	B	C	D	E
Symbol	Description	OPTIONAL ENERGY VERIFIED label (see instructions below)	Specific lighting source for compliance Shall include only using technologies listed below (List all that apply)	Field Inspector Checks that Sign Complies <input checked="" type="checkbox"/>
		<input type="checkbox"/>		<input type="checkbox"/>
		<input type="checkbox"/>		<input type="checkbox"/>
		<input type="checkbox"/>		<input type="checkbox"/>
		<input type="checkbox"/>		<input type="checkbox"/>
<b>A</b>	Symbol or code used on the plans (when plans are required) and other documents.			
<b>B</b>	A narrative description of the sign, or location of sign on the building, and the location of sign on construction documents. Note: Check this box only if the sign has a permanent, pre-printed, factory-installed ENERGY VERIFIED label, confirming that this sign complies with the Section 140.8 of the California 2016 Title 24, Part 6 standards, using the Specific Lighting Source Method of Compliance. The sign must be marked with the recognized logo for this purpose: AN ENERGY VERIFIED Certification Marks authorized by Underwriters Laboratories (UL) for their Product Certification Body accredited to ISO/IEC Guide 65 by the American National Standards Institute in accordance with the ISO/IEC 17031. Surveillance by the Accredited Certification Body shall be an ongoing annual program performed by underwriters above a type A representative level in accordance with ISO/IEC 17021. For signs with such an ENERGY VERIFIED label, column D is not required to be filled out. Note: Using an ENERGY VERIFIED label is an optional method to validate compliance. An ENERGY VERIFIED label is not needed for compliance.			
	Specify Lighting Source Compliance Method. The sign(s) identified above use only the following lighting technologies:			
	Use all applicable numbers (1 through 9) that apply in column D above for each row.			
	1 High pressure sodium lamps			
	Metal halide lamps that are pulse start or ceramic started by a ballast that has a minimum efficiency of 88% or greater, or			
	2 Ballast efficiency: the measured output wattage to the lamp divided by the measured operating input wattage when tested according to ANSI C82-6-2005.			
	Metal halide lamps that are pulse start that are 320 watts or smaller, are not 250 W or 175 watts lamp, and are served by a ballast that has a minimum efficiency of 80%.			
	3 Ballast efficiency: the measured output wattage to the lamp divided by the measured operating input wattage when tested according to ANSI C82-6-2005.			
<b>D</b>	4 Neon or cold cathode lamps with transformer or power supply efficiency greater than or equal to a minimum efficiency of 75% when the transformer or power supply rated output current is 50 mA or greater. The ratio of the output wattage to the input wattage is at 100% tubing load.			
	5 Neon or cold cathode lamps with transformer or power supply efficiency greater than or equal to a minimum efficiency of 68% when the transformer or power supply rated output current is 50 mA or greater. The ratio of the output wattage to the input wattage is at 100% tubing load.			
	6 Fluorescent lighting systems meeting one of the following requirements: A) Use only lamps with a minimum color rendering index (CRI) of 80, or B) Use only electronic ballasts with a fundamental output frequency not less than 20 kHz.			
	7 Light emitting diodes (LEDs) with a power supply having an efficiency of 80% or greater.			
	8 Single voltage electronic power supplies that are designed to convert 120 volt AC input into lower voltage DC or AC output, and have a maximum output power less than or equal to 250 watts, shall comply with the applicable requirements of the Appliance Efficiency Regulations (Title 20).			
	9 Compact fluorescent lamps that do not contain a medium screw base sockets (E24/E26).			
<b>E</b>	This page should be a field inspection checklist:			
Field Inspector Notes:				

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance


August 2016

<b>STATE OF CALIFORNIA</b> <b>SIGN LIGHTING</b> <small>SEE INSTRUCTIONS ON REVERSE SIDE</small>		<small>CALIFORNIA ENERGY COMMISSION</small> <small>NRCC-LTS-01-E</small> <small>(Page 5 of 5)</small>	
<b>CERTIFICATE OF COMPLIANCE</b> <b>Sign Lighting</b>			
Jurisdiction: <b>Bishops at Danville, CA</b>		Date Prepared: <b>3/8/2018</b>	

<b>DOCUMENTATION BUILDER'S DECLARATION STATEMENT</b>	
I, <b>certify that this Certificate of Compliance documentation is accurate and complete.</b>	
Documentation Author Name: <b>Peter A. Leptuch</b>	Documentation Engineer Signature: 
Signature: <b>Peter A. Leptuch, P.E.</b>	Signature Date: <b>3/8/2018</b>
Address: <b>1238 Golden Eagle Court</b>	USA Certification Identification (if applicable):
City/State/Zip: <b>Aubrey, TX 76227</b>	Phone: <b>(840) 735-5127</b>

<b>RESPONSIBLE PERSON'S DECLARATION STATEMENT</b>	
I certify the following under penalty of perjury, under the laws of the State of California:	
1. The information provided on this Certificate of Compliance is true and correct.	
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).	
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 6 and Part 6 of the California Code of Regulations.	
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.	
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building center at occupancy.	
Responsible Designer Name: <b>Peter A. Leptuch</b>	Responsible Designer Signature: 
Company: <b>Peter A. Leptuch, P.E.</b>	Date Signed: <b>3/8/2018</b>
Address: <b>1235 Golden Eagle Court</b>	License: <b>E18072</b>
City/State/Zip: <b>Aubrey, TX 76227</b>	Phone: <b>(840) 735-5127</b>

CA Building Energy Efficiency Standards - 2016 Nonresidential Compliance

August 2018