

COMBO-SOLAR HEATER AND TANK SCHEDULE

SYMBOL	SERVICE	LOCATION	MFG'R	MODEL	CAPACITY	HTG. MBTUH		ELECT. CHART. @ 60HZ				WT. LBS	PANELS REQD.	SOLAR PANEL MAKE & MODEL	
						TOTAL	HTG. HW MODULE	V	#	PMP H.P.	EQ.				
SHW-1	DHW-HHW SYSTEM	MECH. ROOM	VERSA-HYDRO	PHE-199-119S	119 GAL.	199	135	120	1	(2) FRAC.	7.5	1,450	4	VERSA-HYDRO FP-40SC [4'x10' EACH']	MODULATING GAS VALVE, VENT TERMINATION KIT
ST-1	DHW-HHW SYS.-STOR.TANK	MECH. ROOM	VERSA-HYDRO	PHE-199-119S	119 GAL.										

- ① PROVIDE A COMPLETE TURN-KEY SYSTEM INCLUDING MASTER DDC CONTROL, VERSAHYDRO TOTAL CONTROL ② STAINLESS STEEL TANK ③ FACTORY MOUNTING RACK FOR 36 DEGREE MOUNTING ANGLE ④ PROVIDE VIBRATION ISOLATION & FLEX CONNECTIONS ⑤ PROVIDE PRE-APPROVED SEISMIC STRAP FOR ANCHORING

DWELLING HEATER SCHEDULE

SYMBOL	SERVICE	LOCATION	QTY.	MFG'R	MODEL	C.F.M.	EXT. S.F. H ₂ O	ENT. AIR °F		AMB. AIR °F	HTG. CAP MBH		ELECT. DATA 115V, 1φ @ 60 HZ.			O.S.A. INFILT.	WT. LBS.	
								D.B.	W.B.		GPM	MBH	WATTS					
HTR-1	COMFORT HEATING	KICKSPACE	SEE PLANS	MYSON	WH-III 9000	124	0.0"	80.0	63.8	40	3	5.6	40			15	20	① ②
HTR-2	COMFORT HEATING	WALL	SEE PLANS	MYSON	LO-LINE 14-10	124	0.0"	80.0	63.8	40	3	10.2	40			15	40	① ②

- ① INCLUDE REMOTE DIGITAL THERMOSTAT W/ TIME-OFF OCCUP. SENSOR ② ALL HEATERS SHALL BE PROVIDED WITH FLOW-DESIGN TYPE FD PRESSURE INDEPENDENT FLOW CONTROL VALVES, S.O.V.'S & S/S HIGH PRESS. FLEX CONN.

FAN SCHEDULE

SYM	SERVICE	LOCATION	QTY.	MFG'R	MODEL	TYPE	C.F.M.	TOTAL S.P. H ₂ O	MAX TIP SPD.	DRIVE	FAN R.P.M.	MOTOR 60 HZ.			SONES	WT. LBS.	REMARKS
												H.P.	V.	β			
TE-1	UNISEX TOILETS 108,110	CEILING	2	BROAN	744	FAN-LIGHT	70	0.10"	-	DIRECT	1100	34 WATTS	120	1	1.5	10	W/SOLID STATE SPEED CONTROL, B.D.D., OCC. SENS. & WALL CAP
EF-1 TE-2	LAUNDRY & DWELLING	CEILING	10	BROAN	ZB110HL	FAN-LIGHT-HUMIDITY SENSING	110-HI 40-CONT	0.25"	-	DIRECT	1100	120 WATTS	120	1	0.3	14	FAN-LIGHT-HUMIDITY CONTROL, W/BUILT-IN SPEED CONTROL, B.D.D. & WALL CAP
EF-2	WORKSHOPS STOR. 1ST FLR	CEILING SUSP.	2	BROAN	L300MG	CABINET	310	0.125"	-	DIRECT	1145	232 WATTS			3.0	25	W/ELEC. SPEED CONTROL, B.D.D., 8 HR. TIME SWITCH, EPOXY-COATED METAL GRILLE & WALL CAP
EF-3	MAIN WORKSHOP	CEILING SUSP.	1	BROAN	L500MG	CABINET	450	0.25"	-	DIRECT	1145	232 WATTS			3.2	32	W/ELEC. SPEED CONTROL, B.D.D., 8 HR. TIME SWITCH, EPOXY-COATED METAL GRILLE & WALL CAP
EF-5	ELECT./ROOM	CEILING	1	BROAN	GC-420	CABINET	260	0.25"	-	DIRECT	1100	170 WATTS			3.4	75	W/ELEC. SPEED CONTROL, B.D.D., HONEYWELL LINE VOLT.T'STAT, EPOXY-COATED METAL GRILLE & WALL CAP

TE-2, TYP. ALL (376 SF) DWELLING UNITS-TO EXCEED WHOLE HOUSE VENT'N. REQUIREMENTS. FAN SHALL RUN IN HIGH SPEED UPON RISE IN HUMIDITY OVER SETPOINT.

CAL GREEN NOTES

- CGC 5.410.4. DEVELOP A WRITTEN PLAN OF PROCEDURES FOR TESTING AND ADJUSTING SYSTEMS, INCLUDING:
 - HVAC SYSTEMS AND CONTROLS
 - WATER HEATING SYSTEMS
 - RENEWABLE ENERGY SYSTEMS
- CGC 5.410.4.3 PERFORM HVAC SYSTEM TESTING AND ADJUSTING PER AABC OR NEBB STANDARDS BY AN INDEPENDENT TESTING AGENCY.
- CGC 5.410.4.4 REPORTING: AFTER COMPLETION OF T&BM PROVIDE A FINAL REPORT OF TESTING SIGNED BY THE RESPONSIBLE PERSON.
- CGC 5.410.4.5 O&M MANUAL: PROVIDE THE BLDG. OWNER OR REP WITH DETAILED OPER & MAINTENANCE INSTRUCTIONS & COPIES OF WARRANTIES FOR EACH SYSTEM.
- CGC 5.410.4.5.1 INSPECTIONS & REPORTS: INCLUDE A COPY OF ALL INSPECTION VERIFICATIONS & REPORTS REQUIRED BY THE ENFORCING AGENCY.
- THE AIR AND WATER BALANCE WORK AS DESCRIBED IN SPECIFICATION SHALL BE CONTRACTED DIRECTLY BY THE GENERAL CONTRACTOR AND COORDINATED BY THIS CONTRACTOR.
- IN ADDITION, THE AIR & WATER BALANCE WORK SHALL ALSO CONSIST OF THE FOLLOWING:
 - BALANCE THE INDIVIDUAL AIR OUTLETS TO DESIGN QUANTITIES. MEASURE & DOCUMENT THE ACTUAL COOLING SUPPLY AIR TEMPERATURE DURING AIR BALANCING & THE OUTSIDE AIR TEMPERATURE.
 - MAKE INSPECTION FOR INSTALLATION DURING CONSTRUCTION DEFICIENCIES SHALL BE NOTED AND REPORTED TO THE MECHANICAL CONTRACTOR.
 - VERIFY & DOCUMENT ACTUAL MOTOR AMPERAGES, RPM, AS WELL AS AIR PRESSURE ON ALL SUPPLY AND EXHAUST FANS.

SPECIAL NOTES

- CONTRACTOR SHALL OBTAIN THE ENTIRE CONTRACT DOCUMENTS INCLUDING BUT NOT LIMITED TO ARCHITECTURAL DRAWINGS AND SPECIFICATIONS, ELECTRICAL DRAWINGS AND SPECIFICATIONS, STRUCTURAL DRAWINGS AND SPECIFICATIONS, AND PRIOR TO BIDDING CAREFULLY STUDY AND REVIEW THE ENTIRE SCOPE OF WORK OF THE PROJECT.
- ENGINEER DRAWINGS ARE DIAGRAMATIC. THEY ARE MEANT TO DESCRIBE THE INTEND OF THE REQUIRED WORK AND DO NOT SHOW THE OFFSET AND EXACT LOCATION OF DUCTWORKS, PIPINGS AND EQUIPMENT. PRIOR TO BIDDING, CONTRACTOR SHALL CAREFULLY EXAMINE ALL THE CEILING HEIGHT REQUIREMENTS INDICATED ON ARCHITECTURAL DRAWINGS AND WEATHER SHOWN ON THE DRAWINGS OR NOT. CONTRACTOR SHALL INCLUDE IN HIS BID ALL THE WORK NECESSARY TO RELOCATE THE EXISTING PIPINGS, DUCTWORKS AND EQUIPMENTS TO ACHIEVE THE REQUIRED CEILING HEIGHTS. NO CHANGE ORDERS RELATED TO RELOCATION OF DUCTWORKS, PIPINGS AND EQUIPMENTS TO MEET THE INTENT OF THE CONTRACT DOCUMENT WILL BE APPROVED.

GENERAL NOTES

- PLATFORMS, CURBS & FLASHINGS FOR MECHANICAL EQUIPMENT SHALL BE FURNISHED & INSTALLED BY THE GENERAL CONTRACTOR, UNLESS NOTED OTHERWISE.
- THE MECHANICAL CONTRACTOR MUST VERIFY & COORDINATE ALL FLOORS, WALL & ROOF OPENINGS W/GENERAL CONTRACTOR PRIOR TO INSTALLATION OF EQUIPMENT & DUCTWORK. (SEE STRUCTURAL DRAWINGS)
- REFER TO ARCHITECTURAL PLAN DRAWINGS FOR EXACT LOCATIONS OF AIR DISTRIBUTION DEVICES.
- INSIDE OF PLENUMS, DUCTS ETC., BEHIND ALL AIR DISTRIBUTION DEVICES SHALL BE PAINTED FLAT BLACK
- DESIGN CRITERIA, SANTA BARBARA C.O. (City Offices), CALIFORNIA:

SUMMER: OUTSIDE: 90 DEG. FDB 70 DEG. FWB WINTER: OUTSIDE: 42 DEG. FDB 65 DEG. FDB
 INSIDE: 78 DEG. FDB 30-80% + RH INSIDE: 65 DEG. FDB
- ALL LOW VOLTAGE (24 V.) WIRING BY CONTROL CONTRACTOR. ALL LOW VOLTAGE WIRING SHALL BE IN CONDUIT. ALL CONDUIT BY ELECTRIC CONTRACTOR.
- THE AIR CONDITIONING CONTRACTOR SHALL BE RESPONSIBLE FOR THE ACQUISITION & PAYMENT OF ALL PERMITS & INSPECTIONS REQUIRED & RELATED FEES FOR THIS INSTALLATION. ALL WORK SHALL COMPLY WITH STATE AND LOCAL CODES. (2001 CALIFORNIA MECHANICAL CODE-C.M.C.)
- SPIRAL SEAM G.I. ROUND DUCTWORK MAY BE INTERCHANGED WITH THE SQ. OR RECT. DUCTWORK (IN CONCEALED SPACES ONLY) AT CONTRACTOR'S OPTION, SPACE PERMITTING.
- PROVIDE A 3/4" MIN. PRIMARY & SECONDARY CONDENSATE DRAIN FROM EACH FAN COIL UNIT TO A CITY APPROVED RECEPTOR.
- CODE APPROVED (WITH SCRIM CLOTH) FLEXIBLE DUCT MAY BE USED IN CONCEALED SPACES FOR PLENUM AND DIFFUSER CONNECTIONS WITH ENGINEERS APPROVAL. MAXIMUM 7'-0" LONG.
- ALL CONNECTIONS BETWEEN A.C. UNITS/FANS AND DUCTWORK, OR PUMPS AND PIPING, SHALL HAVE FIREPROOF, HEAVY DUTY FLEX-CONNECTIONS (CITY APPROVED) WITH 3" MIN. CLEARANCE & METAL SUNSHIELD FOR ALL WEATHER EXPOSED CONNECTIONS. ISOLATE ALL H.V.A.C. UNITS/FANS & EQUIPMENT FROM STRUCTURE WITH APPROVED ISOLATION MOUNTS.
- ALL WEATHER EXPOSED EQUIPMENT, ETC., SHALL BE COMPLETELY WEATHERPROOFED.
- MANUAL VOLUME DAMPER SHALL BE PROVIDED IN ALL DUCT TAKE-OFFS TO INDIVIDUAL CEILING DIFFUSERS, REGISTERS AND GRILLES. ALL MANUAL VOLUME DAMPERS SHALL BE ACCESSIBLE, OR PROVIDED WITH A REMOTE OPERATING DEVICE
- S.E.E.R., H.S.P.F., & C.O.P. & A.F.U.E. RATING OF EACH H.V.A.C. UNIT SHALL COMPLY WITH CALIFORNIA ENERGY COMMISSION (C.E.C.) STANDARDS.
- ALL S.A. & R.A. DUCTS, AS INDICATED ON THE DRAWINGS, SHALL BE LINED WITH 1"(R-4.2) OR 2"(R-8.0)THICK, 1-1/2 LB. DENSITY FIBERGLASS WITH VINYL FACE TO AIR STREAM. SEAL ALL RAW EDGES. ALL OTHER S.A. & R.A. DUCTS SHALL BE WRAPPED WITH 1 LB. DENSITY FIBERGLASS INSULATION 1-1/2" THICK S.A. & R.A. WIRED IN PLACE. PROVIDE VAPOR BARRIER ON INSULATION.
- FURNISH COMPLETE MAINTENANCE INFORMATION. REQUIRED ROUTINE MAINTENANCE ACTIONS SHALL BE CLEARLY STATED & INCORPORATED ON A READILY ACCESSIBLE LABEL.
- GAS BURNING APPLIANCES TO BE EQUIPPED WITH STATE APPROVED I.I.D.
- GAS BURNING APPLIANCES TO BE INSTALLED IN ACCORDANCE WITH THE AGA APPROVED CONDITIONS & MANUFACTURER'S INSTALLATION REQUIREMENTS.
- .
- .
- ALL O.S.A. INTAKES AND EXHAUST FANS TO BE PROVIDED WITH BACK DRAFT DAMPERS.
- TRANSVERSE JOINTS ON DUCTWORK SHALL BE SEALED WITH "CASCOATE", OR AN APPROVED EQUAL.
- EACH NEW A.C. SYSTEM SHALL BE CONTROLLED BY A TIME SWITCH, AS PER C.E.C.
- NOT USED.
- ALL DUCTWORK SHALL COMPLY WITH CHAPTER 6 C.M.C.
- ALL DUCT INSULATION SHALL BE AS PER TABLE 6-4 C.M.C.
- FIRE DAMPERS SHALL BE AS PER SECTION 606, C.M.C.
- DUCT SMOKE DETECTORS SHALL BE PROVIDED PER SECTION 609, C.M.C. MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL DUCT SMOKE DETECTORS, ELECTRICAL TO PROVIDE POWER WIRING TO DETECTOR. EXCEPTION FOR FULL COVERAGE SMOKE DETECTION SYSTEM.
- CONTRACTOR SHALL SUBMIT FOR APPROVAL ANY EQUIPMENT OR MATERIALS THAT DEVIATE FROM THE CONTRACT DOCUMENTS.
- SPECIFICATIONS ARE A PART OF THIS CONTRACT. CONTRACTOR SHALL REQUEST SPECIFICATIONS IF NONE ARE PROVIDED PRIOR TO BID.
- CONTRACTOR SHALL VISIT THE JOB-SITE & EXAMINE EXISTING CONDITIONS PRIOR TO COMPLETION OF BID.
- PROVIDE CLEAR PLASTIC LOCKING COVERS FOR ALL THERMOSTATS.

TITLE 24 NOTES-2008 BUILDING ENERGY EFFICIENCY STANDARDS TITLE 24 PART 1 AND 6

- ALL HVAC SYSTEMS AND EQUIPMENT SHALL COMPLY WITH SECTION 112 TITLE 24 PART 6.
- OUTSIDE AIR VENTILATION SHALL BE PROVIDED PER SECTION 121 TITLE 24 PART 6.
- SPACE CONDITIONING EQUIPMENT CONTROLS SHALL COMPLY WITH SECTION 122 TITLE 24 PART 6.
- PIPING INSULATION SHALL BE PROVIDED PER SECTION 123 TITLE 24 PART 6.
- AIR DUCT DISTRIBUTION SYSTEMS SHALL MEET THE REQUIREMENTS OF SECTION 124 TITLE 24 PART 6.
- MECHANICAL SYSTEMS ACCEPTANCE DOCUMENTATION SHALL BE PROVIDED BY THE CONTRACTOR PER SECTION 125 TITLE 24 PART 6.
- CONTRACTOR SHALL REVIEW ALL TITLE 24 COMPLIANCE DOCUMENTATION FOR ANY THIRD PARTY VERIFICATION REQUIREMENTS THAT MAY BE APPLICABLE TO THIS PROJECT.

THE 2008 CALIFORNIA ENERGY CONSERVATION STANDARDS HAVE BEEN REVIEWED AND THE DESIGN COMPLIES WITH THESE STANDARDS.

SHEET METAL DUCT & FITTING GAUGES

MAX. DIA. OR WIDTH OF DUCT & FITTING	G.I. SHEET METAL GAUGES	1 1/2" WIDE DUCT HANGER
12" & SMALLER	26	18 GA. MIN. @ MAX. 10FT. O.C.
13" THRU 30"	24	18 GA. MIN. @ MAX. 10FT. O.C.
31" THRU 54"	22	18 GA. MIN. @ MAX. 10FT. O.C.

LEGEND

SYMBOL	ABBREV.	DESCRIPTION
	22 x 12 (L)	ACOUSTICALLY LINED DUCTWORK OR PLENUM; SIZES GIVEN ARE SHEET METAL
	22 x 10	DUCT DIMENSIONS: FIRST DIM. IS PLAN VIEWED AND/OR HORIZONTAL, SECOND DIM. IS DEPTH AND/OR VERTICAL
	B.D.D.	BACKDRAFT DAMPER
	M.V.D.	MANUAL VOLUME DAMPER
	F.D.	FIRE DAMPER
	F.S.D.	FIRE SMOKE DAMPER
	TRANS.	TRANSITION
	FLEX.CONN.	RETURN LOOKING AWAY FROM VIEWER
	9"TH.	SUPPLY LOOKING AWAY FROM VIEWER
	P.O.C.	FLEXIBLE CONNECTION
	C.D.	SUPPLY DUCT LOOKING TOWARD VIEWER
	C.R.	SUPPLY DUCT LOOKING AWAY FROM VIEWER
	T.R.	INCLINED RISE OR DROP IN DIRECTION OF AIR FLOW
	B.R.	BREAK IN DUCT RUN FOR DRAWING CLARIFICATION
	T.V.	THROAT SIZE, NET.
	C.F.M.	POINT OF CONNECTION
	S.A.	SUPPLY DIFFUSER (ARROW INDICATES DIRECTION OF AIR FLOW)
	O.S.A.	EXHAUST OR RETURN REGISTER (C.G.-GRILLE)
	M.A.	TOP REGISTER W/ EXTRACTER (T.G.-GRILLE)
	A.P.	BOTTOM REGISTER W/ EXTRACTER (B.G.-GRILLE)
	EXH.	MITERED ELBOW W/ DOUBLE THICKNESS AIRFLOW TYPE TURNING VANES
	A.D.	CUBIC FEET PER MINUTE
	L.D.	SUPPLY AIR
	U.C.	RETURN AIR
	D.L.	OUTSIDE AIR
	S.D.	MIXED AIR
	T'STAT	ACCESS PANEL (CEILING)
	U.N.O.	EXHAUST DUCT (IN SECTION)
	1	RETURN DUCT (IN SECTION)
	2	ACCESS DOOR
	3	STRIP TYPE DIFFUSERS (ARROWS INDICATE DIRECTION OF AIR FLOW) (PLENUM SHOWN SOLID)
	4	EXHAUST, RETURN, OR TRANSFER AIR
	5	ROUND CEILING DIFFUSER
	6	UNDERCUT OR LOUVER
	7	DOOR LOUVER W/ GROSS AREA
	8	SMOKE DETECTOR
	9	THERMOSTAT
	10	UNLESS NOTED OTHERWISE
	11	EQUIPMENT REFERENCE
	12	SECTION REFERENCE
	13	AIR DISTRIBUTION DEVICE

MECHANICAL ABBREVIATIONS

ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION
ABV.	ABOVE	HDR.	HEADER
BEL.	BELOW	@	AT
DN.	DOWN	W/	WITH
FR.	FROM	CONN.	CONNECT. CONNECTION
X.	EXISTING	LBS.	POUNDS
FLR.	FLOOR	POC	POINT OF CONNECTION
CLG.	CEILING	FIN.	FINISH
N.I.C.	NOT IN CONTRACT	DBL.	DOUBLE
EL./ELEV.	ELEVATION	ASSY.	ASSEMBLY
CL	CENTERLINE	CONT.	CONTINUATION
CONTR.	CONTRACTOR	VTR	VENT THRU ROOF
TYP.	TYPICAL	GRD	GRADE
S.P.	STATIC PRESSURE	PRESS	PRESSURE
GPM	GALLONS PER MINUTE	MAX./MIN.	MAXIMUM/MINIMUM
AP	ACCESS PANEL	O.C.	ON CENTER
WT.	WEIGHT	F.S.	FLOOR SINK
O.B.D.	OPPOSED BLADE DAMPER	F.A.	FREE AREA


AIR DISTRIBUTION TYPE SCHEDULE

SYMBOL	TYPE & DESCRIPTION	MAKE & MODEL
SEE KEY NOTES	4 INCH ROUND ALUMINUM VENT LOUVER W/ STAINLESS STEEL INSECT SCREEN" (STANDARD CLEAR SATIN ANODIZED)	SEIHO #SFX4-N
SEE KEY NOTES	8 INCH ROUND ALUMINUM VENT LOUVER W/ STAINLESS STEEL INSECT SCREEN" (STANDARD CLEAR SATIN ANODIZED)	SEIHO #SFX8-N
SEE KEY NOTES	4 INCH ROUND ALUMINUM DRYER VENT CAP W/ INTEGRAL DAMPER (STANDARD CLEAR SATIN FINISH)	SEIHO #SFZC-4

NOTE: ALL AIR DISTRIBUTION DEVICE FINISHES SHALL BE AS DIRECTED BY ARCHITECT

315 Linden Street
 San Francisco, CA 94102
 Tel 415 551 7630
 Fax 415 551 7601
 www.macyarchitecture.com

**M A C Y
 A R C H
 I T E C
 T U R E**

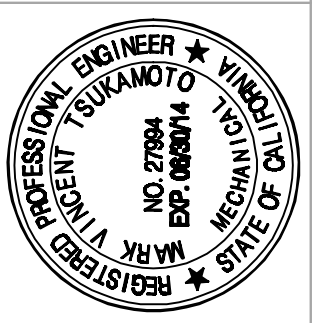

CONSULTANTS
 Doza & Assoc.
 26123 Singer Pl.
 Stevenson Ranch, CA
 91381
 T.661.993.3343

PROJECT
 SANTA BARBARA CENTER FOR
 ART, SCIENCE & TECHNOLOGY
 515 GARDEN STREET
 SANTA BARBARA, CA 93101

ISSUES / REVISIONS
 •

SHEET TITLE
 MECHANICAL LEGEND,
 SCHEDULES, NOTES
 DATE 04/10/14
 PHASE ISSUE FOR BID
 SCALE NONE
 FULL SIZE

SHEET
 M1.0

PERFORMANCE CERTIFICATE: Residential (Part 1 of 5) **CF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

Project Address: 512 Garden Street Santa Barbara California Energy Climate Zone: CA Climate Zone 06 Total Cond. Floor Area: 3,888 Addition: n/a # of Stories: 3

FIELD INSPECTION ENERGY CHECKLIST

Yes No HERS Measures -- If Yes, A CF-4R must be provided per Part 2 of 5 of this form.

Yes No Special Features -- If Yes, see Part 2 of 5 of this form for details.

INSULATION

Construction Type	Cavity	Area (ft ²)	Special Features (see Part 2 of 5)	Status
Wall	Wood Framed	R-19	7,128	New
Roof	Wood Framed Attic	R-30	3,888 Cool Roof	New

FENESTRATION

Orientation	Area(ft ²)	U-Factor	SHGC	Overhang	Sidelines	Exterior Shades	Status
Front (N)	432.0	0.710	0.73	none	none	Bug Screen	New
Left (E)	72.0	0.710	0.73	none	none	Bug Screen	New
Right (W)	360.0	0.710	0.73	none	none	Bug Screen	New

HVAC SYSTEMS

Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status
1	Combined Hydronic	see DHW	No Cooling	13.0 SEER	Setback	New
8	Combined Hydronic	see DHW	No Cooling	13.0 SEER	Setback	New

HVAC DISTRIBUTION

Location	Heating	Cooling	Duct Location	Duct R-Value	Status
System 1	Ducted	Ducted	Attic, Ceiling Ins, vented	8.0	New
System 2	Ducted	Ducted	Attic, Ceiling Ins, vented	8.0	New

WATER HEATING

Qty.	Type	Gallons	Min. Eff	Distribution	Status
1	Large Gas	119	0.84	Kitchen Pipe Ins	New

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 1 of 8

PERFORMANCE CERTIFICATE: Residential (Part 2 of 5) **CF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/1/2013

SPECIAL FEATURES INSPECTION CHECKLIST

The enforcement agency should pay special attention to the items specified in this checklist. These items require special written justification and documentation, and special verification to be used with the performance approach. The enforcement agency determines the adequacy of the justification, and may reject a building or design that otherwise complies based on the adequacy of the special justification and documentation submitted.

Multiple Dwelling Units are served by a common water heater. Verify DHW details.

The DHW System VersaHydro includes a Solar Savings Fraction (69.0%) for solar thermal water heating as calculated from the equations in Residential ACM Appendix RG section RG 3.4. See also section 6.3 of the Residential ACM.

The DHW System VersaHydro is a non-NHECA large storage gas water heater. Verify DHW details.

The HVAC System Heating Only - No Cooling does not include a cooling system. Field verification is not necessary.

The HVAC System System 1 is a Combined Hydronic System that uses a Boiler for DHW and Space Heating. System details are on Part 5 of the CF-1R.

The HVAC System Heating Only - No Cooling does not include a cooling system. Field verification is not necessary.

The HVAC System System 2 is a Combined Hydronic System that uses a Boiler for DHW and Space Heating. System details are on Part 5 of the CF-1R.

The Roof R-30 Roof Attic Reflectance = 0.30, Emittance = 0.75 shall be noted and labeled by the Cool Roof Rating Council in accordance with Section 19-113 of the standards.

HERS REQUIRED VERIFICATION

Items in this section require field testing and/or verification by a certified HERS Rater. The inspector must receive a completed CF-4R form for each of the measures listed below for final to be given.

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 2 of 8

PERFORMANCE CERTIFICATE: Residential (Part 3 of 5) **CF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

ANNUAL ENERGY USE SUMMARY

TDV (kBtu/ft ² -yr)	Standard	Proposed	Margin
Space Heating	10.81	10.25	0.26
Space Cooling	5.46	12.18	-6.72
Fans	3.43	5.27	-1.84
Domestic Hot Water	37.27	11.80	25.47
Pumps	6.87	6.87	0.00
Totals	63.84	46.58	17.16

Percent Better Than Standard: 27.3 %

BUILDING COMPLIES - NO HERS VERIFICATION REQUIRED

Building Front Orientation:	(N) 0 deg	(W)	Ext. Walls/Roof	Wall Area	Fenestration Area
Number of Dwelling Units:	9.00	(W)	4,752	432	
Fuel Available at Site:	Natural Gas	(#)	1,620	72	
Raised Floor Area:	0	(S)	0	0	
Slab on Grade Area:	0	(W)	1,620	360	
Average Ceiling Height:	10.0	Roof		864	0
Fenestration Average U-Factor:	0.71				
Average SHGC:	0.73				
					Fenestration/CFA Ratio: 22.2 %

REMARKS

STATEMENT OF COMPLIANCE

This certificate of compliance lists the building features and specifications needed to comply with Title 24, Parts 1 The Administrative Regulations and Part 6 The Efficiency Standards of the California Code of Regulations.

The documentation author hereby certifies that the documentation is accurate and complete.

Documentation Authority for L. Dozal Associates

Company: 2Flow Engineering for L. Dozal Associates
Address: 26123 Singer Place
City/State/Zip: Stevenson Ranch, CA
Name: Luis Dozal
Phone: 661-993-6630
Signature: [Signature]
Date: 8/01/2013

The individual with overall design responsibility hereby certifies that the proposed building design represented in this set of construction documents is consistent with the other compliance forms and worksheets, with the specifications, and with any other calculations submitted with this permit application, and recognizes that compliance using duct design, duct sealing, verification of refrigerant charge, insulation installation quality, and building envelope sealing require installer testing and certification and field verification by an approved HERS rater.

Designer or Owner (per Business & Professions Code)

Company: Macy Architecture
Address: 315 Union Street
City/State/Zip: San Francisco, CA 94102
Name: Mark Macy
Phone: 415-551-7630
Signature: [Signature]
Lic. No: 20541
Date: 8/01/2013

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 3 of 8

CERTIFICATE OF COMPLIANCE: Residential (Part 4 of 5) **CF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

OPAQUE SURFACE DETAILS

Surface Type	Area	U-Factor	SHGC	Insulation	Interior Frame	Exterior Frame	Aczm	Tilt	Status	Joint Appendix	Location/Comments
Wall	236	0.074	R-19				0	90	New	4.3.1-A5	Zone 1
Wall	172	0.074	R-19				90	90	New	4.3.1-A5	Zone 1
Wall	244	0.074	R-19				0	90	New	4.3.1-A5	Zone 1
Wall	140	0.074	R-19				270	90	New	4.3.1-A5	Zone 1
Roof	432	0.031	R-30				0	18	New	4.2.1-A20	Zone 1
Wall	1,888	0.074	R-19				0	90	New	4.3.1-A5	Zone 2
Wall	1,376	0.074	R-19				90	90	New	4.3.1-A5	Zone 2
Wall	1,952	0.074	R-19				0	90	New	4.3.1-A5	Zone 2
Wall	1,320	0.074	R-19				270	90	New	4.3.1-A5	Zone 2
Roof	3,456	0.031	R-30				0	18	New	4.2.1-A20	Zone 2

FENESTRATION SURFACE DETAILS

ID	Type	Area	U-Factor	SHGC	Aczm	Status	Glazing Type	Location/Comments		
1	Window	28.0	0.710	Default	0.73	Default	0	New	Double Metal Clear	Zone 1
2	Window	8.0	0.710	Default	0.73	Default	90	New	Double Metal Clear	Zone 1
3	Window	20.0	0.710	Default	0.73	Default	0	New	Double Metal Clear	Zone 1
4	Window	40.0	0.710	Default	0.73	Default	270	New	Double Metal Clear	Zone 1
5	Window	24.0	0.710	Default	0.73	Default	0	New	Double Metal Clear	Zone 2
6	Window	64.0	0.710	Default	0.73	Default	90	New	Double Metal Clear	Zone 2
7	Window	160.0	0.710	Default	0.73	Default	0	New	Double Metal Clear	Zone 2
8	Window	320.0	0.710	Default	0.73	Default	270	New	Double Metal Clear	Zone 2

(1) U-Factor Type: 116-A = Default Table from Standards, NFRC = Labeled Value
SHGC Type: Default Table from Standards, NFRC = Labeled Value

EXTERIOR SHADING DETAILS

ID	Exterior Shade Type	SHGC	Window Hgt	Window Wd	Overhang Len	RExt	Dist Len	Left Fin Hgt	Right Fin Hgt
1	Bug Screen	0.76							
2	Bug Screen	0.76							
3	Bug Screen	0.76							
4	Bug Screen	0.76							
5	Bug Screen	0.76							
6	Bug Screen	0.76							
7	Bug Screen	0.76							
8	Bug Screen	0.76							

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 4 of 8

CERTIFICATE OF COMPLIANCE: Residential (Part 5 of 5) **CF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

BUILDING ZONE INFORMATION

System Name	Zone Name	New	Existing	Altered	Removed	Volume	Year Built
System 1	Dwelling #301A Accessible	432				4,320	
System 2	Typical Dwelling	432				4,320	

HVAC SYSTEMS

System Name	Qty.	Heating Type	Min. Eff	Cooling Type	Min. Eff	Thermostat	Status
System 1	1	Combined Hydronic	see below	No Cooling	13.0 SEER	Setback	New
System 2	8	Combined Hydronic	see below	No Cooling	13.0 SEER	Setback	New

HVAC DISTRIBUTION

System Name	Heating	Cooling	Duct Location	Duct R-Value	Ducts Tested?	Status
System 1	Ducted	Ducted	Attic, Ceiling Ins, vented	8.0	<input type="checkbox"/> New	
System 2	Ducted	Ducted	Attic, Ceiling Ins, vented	8.0	<input type="checkbox"/> New	

WATER HEATING SYSTEMS

System Name	Qty.	Type	Distribution	Rated Input (Btu/h)	Tank Cap. (gal)	Energy Factor or RE	Standby Loss or Pilot Value	Ext. Tank Insul. R-Value	Status
VersaHydro	1	Large Gas	Central System	199,000	119	0.84	0.00 %	n/a	New

MULTI-FAMILY WATER HEATING DETAILS

Control	Qty.	HP	Plenum	Outside	Buried	Insul. Thick.
Time+Temp	1	0.3	0	100	0	0.60

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 5 of 8

MANDATORY MEASURES SUMMARY: Residential (Page 1 of 3) **MF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

NOTES: Low-rise residential buildings subject to the Standards must comply with all applicable mandatory measures listed, regardless of the compliance approach used. More stringent energy measures listed on the Certificate of Compliance (CF-1R, CF-1R-ADD, or CF-1R-ALT Form) shall supersede the items marked with an asterisk (*) below. This Mandatory Measures Summary shall be incorporated into the permit documents, and the applicable features shall be considered by all parties its minimum component performance specifications whether they are shown elsewhere in the documents or in this summary. Submit all applicable sections of the MF-1R Form with plans.

Building Envelope Measures:

§116(a): Doors and windows between conditioned and unconditioned spaces are manufactured to limit air leakage.

§116(a): Fenestration products (except field fabricated windows) have a label listing the certified U-Factor, certified Solar Heat Gain Coefficient (SHGC), and infiltration that meets the requirements of §10-111(a).

§117: Exterior doors and windows are weather-stopped; all joints and penetrations are caulked and sealed.

§118(a): Insulation specified or installed meets Standards for Insulating Material. Indicate type and include on CF-6R Form.

§118(b): The thermal emittance and solar reflectance values of the cool roofing material meets the requirements of §118(b) when the installation of a Cool Roof is specified on the CF-1R Form.

*§150(a): Minimum R-19 insulation in wood-frame ceiling or equivalent U-Factor.

§150(b): Loose fill insulation shall conform with manufacturer's installed design labeled R-Value.

*§150(c): Minimum R-13 insulation in wood-frame wall or equivalent U-Factor.

§150(d): Minimum R-13 insulation in raised wood-frame floor or equivalent U-Factor.

§150(e): Air retarding wrap is tested, labeled, and installed according to ASTM E1677-95(2000) when specified on the CF-1R Form.

§150(f): Mandatory Vapor barrier installed in Climate Zones 14 or 16.

§150(g): Water absorber rate for slab edge insulation material alone without facings is no greater than 0.3%; water vapor permeance rate is no greater than 2.0 perm-inch and shall be protected from physical damage and UV light deterioration.

Fireplaces, Decorative Gas Appliances and Gas Log Measures:

§150(a)A: Masonry or factory-built fireplaces have a closable metal or glass door covering the entire opening of the firebox.

§150(a)B: Masonry or factory-built fireplaces have a combustion outside air intake, which is at least six square inches in area and is equipped with a w/ a readily accessible, operable, and tight-fitting damper and/or a combustion-air control device.

§150(a)C: Continuous burning pilot lights and the use of indoor air for cooling a fabric jacket, when that indoor air is vented to the outside of the building, are prohibited.

Space Conditioning, Water Heating and Plumbing System Measures:

§113-115: HVAC equipment, water heaters, showerheads, faucets and all other regulated appliances are certified by the Energy Commission.

§113(c)5: Water heating recirculation loops serving multiple dwelling units and High-Rise residential occupancies meet the air release valve, backflow prevention, pump isolation valve, and recirculation loop connection requirements of §13-035.

§115: Continuously burning pilot lights are prohibited for natural gas fan-type central furnaces, household cooking appliances (appliances with an electrical supply voltage connection with pilot lights that consume less than 150 Btu/h are exempt), and pool and spa heaters.

§150(h): Heating and/or cooling loads are calculated in accordance with ASHRAE, SMACNA or ACCA.

§150(i): Heating systems are equipped with thermostats that meet the setback requirements of Section 112(c).

§150(j)A: Storage gas water heaters rated with an Energy Factor no greater than the federal minimum standard are externally wrapped with insulation having an installed thermal resistance of R-12 or greater.

§150(j)B: Unfired storage tanks, such as storage tanks or backup tanks for solar water-heating system, or other indirect hot water tanks have R-12 external insulation or R-16 internal insulation where the internal insulation R-value is indicated on the exterior of the tank.

§150(j)C: First 5 feet of hot and cold water pipes closest to water heater tank, non-recirculating systems, and entire length of recirculating sections of hot water pipes are insulated per Standards Table 150-B.

§150(j)D: Cooling system piping (suction, chilled water, or brine lines) and piping insulated between heating source and indirect hot water tank shall be insulated to Table 150-B and Equation 150-A.

§150(j)E: Pipe insulation for steam hydronic heating systems or hot water systems >15 psi, meets the requirements of Standards Table 123-A.

§150(j)A: Insulation is protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind.

§150(j)B: Insulation for chilled water piping and refrigerant suction lines includes a vapor retardant or is enclosed entirely in conditioned space.

§150(j)C: Solar water-heating systems and/or collectors are certified by the Solar Rating and Certification Corporation.

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 6 of 8

MANDATORY MEASURES SUMMARY: Residential (Page 2 of 3) **MF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

§150(m): All air-distribution system ducts and plenums installed, are sealed and insulated to meet the requirements of CMC Sections 601, 602, 603, 604, 605 and Standard 6-5. Supply air and return-air ducts and plenums are insulated to a minimum installed level of R-4.2 or enclosed entirely in conditioned space. Openings shall be sealed with mastic, tape or other duct-closure system that meets the applicable requirements of UL 181, UL 181A, or UL 181B or verot sealant that meets the requirements of UL 723. If mastic or tape is used to seal openings greater than 1/4 inch, the combination of mastic and other mesh or tape shall be used.

§150(m)1: Building cavities, support platforms for air handlers, and plenums defined or constructed with materials other than sealed sheet metal, duct board or flexible duct shall not be used for conveying conditioned air. Building cavities and support platforms may contain ducts. Ducts installed in cavities and support platforms shall not be compressed to cause reductions in the cross-sectional area of the ducts.

§150(m)2: Joints and seams of duct systems and their components shall not be sealed with cloth back rubber adhesive duct tapes unless such tape is used in combination with mastic and draw bands.

§150(m)3: Exhaust fan systems have back draft or automatic dampers.

§150(m)8: Gravity ventilating systems serving conditioned space have other automatic or readily accessible, manually operated dampers.

§150(m)9: Insulation shall be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind. Cellular foam insulation shall be protected as above or painted with a coating that is water retardant and provides sheathing from solar radiation that can cause degradation of the material.

§150(m)10: Flexible ducts cannot have porous inner cores.

§150(o): All dwelling units shall meet the requirements of ANSI/ASHRAE Standard 62.2 2007 Ventilation and Acceptable Indoor Air Quality in Low-Rise Residential Buildings. Window operation is not a permissible method of providing the Whole Building Ventilation required in Section 4 of that Standard.

Pool and Spa Heating Systems and Equipment Measures:

§114(a): Any pool or spa heating system shall be certified to have a thermal efficiency that complies with the Appliance Efficiency Regulations; an on-off switch mounted outside of the heater; a permanent weatherproof plate or cap with operating instructions; and shall not use electric resistance heating or a pilot light.

§114(b)1: Any pool or spa heating equipment shall be installed with at least 36" of pipe between filter and heater, or dedicated suction and return lines, or ball-up connectors, for future solar heating.

§114(b)2: Outdoor pools or spas that have a heat pump or gas heater shall have a cover.

§114(b)3: Pools shall have directional inlets that adequately mix the pool water, and a time switch that will allow all pumps to be set or programmed to run only during off-peak electric demand periods.

§150(p): Residential pool systems or equipment meet the pump sizing, flow rate, piping, filters, and valve requirements of §150(p).

Residential Lighting Measures:

§150(k)1: High efficacy luminaires or LED Light Engine with Integral Heat Sink has an efficacy that is no lower than the efficacies contained in Table 150-C and is not a low efficacy luminaire as specified by §150(k)2.

§150(k)3: The wattage of permanently installed luminaires shall be determined as specified by §130(d).

§150(k)4: Ballasts for fluorescent lamps rated 13 Watts or greater shall be electronic and shall have an output frequency no less than 20 kHz.

§150(k)5: Permanently installed night lights and night lights integral to a permanently installed luminaire or exhaust fan shall contain only high efficacy lamps meeting the minimum efficacies contained in Table 150-C and shall not contain a line-voltage socket or line-voltage lamp holder; OR shall be rated to consume no more than five watts of power as determined by §130(d), and shall not contain a medium screw-base socket.

§150(k)6: Lighting integral to exhaust fans, in rooms other than kitchens, shall meet the applicable requirements of §150(k).

§150(k)7: All switching devices and controls shall meet the requirements of §150(k)7.

§150(k)8: A minimum of 50 percent of the total rated wattage of permanently installed lighting in kitchens shall be high efficacy. EXCEPTION: Up to 500 watts for dwelling units less than or equal to 2,500 sq ft or 100 watts for dwelling units larger than 2,500 sq ft may be exempt from the 50% high efficacy requirement when: all low efficacy luminaires in the kitchen are controlled by a manual on occupant sensor; dimmer, energy management system (EMCS), or a multi-scene programmable control system; and all permanently installed luminaires in garages, laundry rooms, closets greater than 70 square feet, and utility rooms are high efficacy and controlled by a manual on occupant sensor.

§150(k)9: Permanently installed lighting that is internal to cabinets shall use no more than 20 watts of power per linear foot of illuminated cabinet.

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 7 of 8

MANDATORY MEASURES SUMMARY: Residential (Page 3 of 3) **MF-1R**

Project Name: SBCAST Building Type: Single Family Addition Alone Multi Family Existing+ Addition/Alteration Date: 8/01/2013

§150(k)10: Permanently installed luminaires in bathrooms, attached and detached garages, laundry rooms, closets and utility rooms shall be high efficacy.

EXCEPTION 1: Permanently installed low efficacy luminaires shall be allowed provided that they are controlled by a manual-on occupant sensor certified to comply with the applicable requirements of §119.

EXCEPTION 2: Permanently installed low efficacy luminaires in closets less than 70 square feet are not required to be controlled by a manual-on occupant sensor.

§150(k)11: Permanently installed luminaires located in rooms or areas other than in kitchens, bathrooms, garages, laundry rooms, closets, and utility rooms shall be high efficacy luminaires. EXCEPTION 1: Permanently installed low efficacy luminaires shall be allowed provided that they are controlled by either a dimmer switch that complies with the applicable requirements of §119, or by a manual-on occupant sensor that complies with the applicable requirements of §119. EXCEPTION 2: Lighting in detached storage building less than 1000 square feet located on a residential site is not required to comply with §150(k)11.

§150(k)12: Luminaires recessed into insulated ceilings shall be listed for zero clearance insulation contact (C) by Underwriters Laboratories or other nationally recognized testing/labeling laboratory; and have a label that certifies the luminaire is airtight with air leakage less than 2.0 CFM at 75 Pascals when tested in accordance with ASTM E283; and be sealed with a gasket or caulk between the luminaire housing and ceiling.

§150(k)13: Luminaires providing outdoor lighting, including lighting for private patios in low-rise residential buildings with four or more dwelling units, entrances, balconies, and porches, which are permanently mounted to a residential building or to other buildings on the same lot shall be high efficacy. EXCEPTION 1: Permanently installed outdoor low efficacy luminaires shall be allowed provided that they are controlled by a manual on/off switch, a motion sensor not having an override or bypass switch that disables the motion sensor, and one of the following controls: a photocell not having an override or bypass switch that disables the photocell; OR an astronomical time clock not having an override or bypass switch that disables the astronomical time clock; OR an energy management control system (EMCS) not having an override or bypass switch that allows the luminaire to be always on EXCEPTION 2: Outdoor luminaires used to comply with Exception 1 to §150(k)13 may be controlled by a temporary override switch which bypasses the motion sensing function provided that the motion sensor is automatically reactivated within six hours. EXCEPTION 3: Permanently installed luminaires in or around swimming pool, water features, or other location subject to Article 680 of the California Electric Code need not be high efficacy luminaires.

§150(k)14: Internally illuminated address signs shall comply with Section 148; OR not contain a screw-base socket, and consume no more than five watts of power as determined according to §130(d).

§150(k)15: Lighting for parking lots and carports with a total of four or more vehicles per site shall comply with the applicable requirements in Sections 130, 132, 134, and 147. Lighting for parking garages for 3 or more vehicles shall comply with the applicable requirements of Sections 130, 131, 134, and 145.

§150(k)16: Permanently installed lighting in the enclosed, non-dwelling spaces of low-rise residential buildings with four or more dwelling units shall be high efficacy luminaires. EXCEPTION: Permanently installed low efficacy luminaires shall be allowed provided that they are controlled by an occupant sensor(s) certified to comply with the applicable requirements of §119.

EnergyPro 5.1 by EnergySoft User Number: 20573 RunCode: 2013-07-15T14:19:06 ID: 00071 Page 8 of 8

M A C Y A R C H I T E C T U R E

315 Linden Street
San Francisco, CA 94102
Tel 415 551 7630
Fax 415 551 7601
www.macyarchitecture.com

REGISTERED PROFESSIONAL ARCHITECT
No. 22064
EXPIRES 12/31/14
STATE OF CALIFORNIA

CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T.661.993.3343

PROJECT
SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNO

CERTIFICATE OF COMPLIANCE and FIELD INSPECTION ENERGY CHECKLIST (Part 1 of 5) **MECH-1C**

Project Name: SBCAST Date: 9/5/2012
 Project Address: 513 Garden Street Santa Barbara Climate Zone: 6 Total Cond. Floor Area: 2,592 Addition Floor Area: n/a

GENERAL INFORMATION

Building Type: Nonresidential High-Rise Residential Hotel/Motel Guest Room
 Schools (Public School) Relocatable Public School Bldg. Conditioned Spaces Unconditioned Spaces (affidavit)

Phase of Construction: New Construction Addition Alteration
 Approach of Compliance: Component Overall Envelope TDV Unconditioned (file affidavit)

Front Orientation: N, E, S, W or in Degrees: 0 deg

HVAC SYSTEM DETAILS

Equipment ²	Inspection Criteria	FIELD INSPECTION ENERGY CHECKLIST	
		Pass	Fail - Describe Reason ³
Item or System Tags (i.e. AC-1, RTU-1, HP-1)	DHW Heater	<input type="checkbox"/>	<input type="checkbox"/>
Equipment Type ³	Gas Fired DHW Boiler	<input type="checkbox"/>	<input type="checkbox"/>
Number of Systems	1	<input type="checkbox"/>	<input type="checkbox"/>
Max Allowed Heating Capacity ¹	150,000 Btu/hr	<input type="checkbox"/>	<input type="checkbox"/>
Minimum Heating Efficiency ¹	84 %	<input type="checkbox"/>	<input type="checkbox"/>
Max Allowed Cooling Capacity ¹	n/a	<input type="checkbox"/>	<input type="checkbox"/>
Cooling Efficiency ¹	n/a	<input type="checkbox"/>	<input type="checkbox"/>
Duct Location/ R-Value	n/a	<input type="checkbox"/>	<input type="checkbox"/>
When duct testing is required, submit MECH-4A & MECH-4-HERS	n/a	<input type="checkbox"/>	<input type="checkbox"/>
Economizer	n/a	<input type="checkbox"/>	<input type="checkbox"/>
Thermostat	n/a	<input type="checkbox"/>	<input type="checkbox"/>
Fan Control	n/a	<input type="checkbox"/>	<input type="checkbox"/>

1. If the Actual installed equipment performance efficiency and capacity is less than the Proposed (from the energy compliance submittal or from the building plans) the responsible party shall resubmit energy compliance to include the new changes.
 2. For additional detailed discrepancy use Page 2 of the Inspection Checklist Form. Compliance fails if a Fail box is checked.
 3. Indicate Equipment Type: Gas (Pkg or Split), VAV, VAV, HP (Pkg or split), Hydronic, PTAC, or other.

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 1 of 2

CERTIFICATE OF COMPLIANCE and FIELD INSPECTION ENERGY CHECKLIST (Part 1 of 5) **MECH-1C**

Project Name: SBCAST Date: 9/5/2012
 Project Address: 513 Garden Street Santa Barbara Climate Zone: 6 Total Cond. Floor Area: 2,592 Addition Floor Area: n/a

GENERAL INFORMATION

Building Type: Nonresidential High-Rise Residential Hotel/Motel Guest Room
 Schools (Public School) Relocatable Public School Bldg. Conditioned Spaces Unconditioned Spaces (affidavit)

Phase of Construction: New Construction Addition Alteration
 Approach of Compliance: Component Overall Envelope TDV Unconditioned (file affidavit)

Front Orientation: N, E, S, W or in Degrees: 0 deg

HVAC SYSTEM DETAILS

Equipment ²	Inspection Criteria	FIELD INSPECTION ENERGY CHECKLIST	
		Pass	Fail - Describe Reason ³
Item or System Tags (i.e. AC-1, RTU-1, HP-1)	System 2	<input type="checkbox"/>	<input type="checkbox"/>
Equipment Type ³	Hydronic Heat Pump	<input type="checkbox"/>	<input type="checkbox"/>
Number of Systems	1	<input type="checkbox"/>	<input type="checkbox"/>
Max Allowed Heating Capacity ¹	38,567 Btu/hr	<input type="checkbox"/>	<input type="checkbox"/>
Minimum Heating Efficiency ¹	4.20 COP	<input type="checkbox"/>	<input type="checkbox"/>
Max Allowed Cooling Capacity ¹	114,336 Btu/hr	<input type="checkbox"/>	<input type="checkbox"/>
Cooling Efficiency ¹	n/a	<input type="checkbox"/>	<input type="checkbox"/>
Duct Location/ R-Value	Attic, Ceiling Ins, vented / 8.0	<input type="checkbox"/>	<input type="checkbox"/>
When duct testing is required, submit MECH-4A & MECH-4-HERS	No	<input type="checkbox"/>	<input type="checkbox"/>
Economizer	No Economizer	<input type="checkbox"/>	<input type="checkbox"/>
Thermostat	Setback Required	<input type="checkbox"/>	<input type="checkbox"/>
Fan Control	Constant Volume	<input type="checkbox"/>	<input type="checkbox"/>

1. If the Actual installed equipment performance efficiency and capacity is less than the Proposed (from the energy compliance submittal or from the building plans) the responsible party shall resubmit energy compliance to include the new changes.
 2. For additional detailed discrepancy use Page 2 of the Inspection Checklist Form. Compliance fails if a Fail box is checked.
 3. Indicate Equipment Type: Gas (Pkg or Split), VAV, VAV, HP (Pkg or split), Hydronic, PTAC, or other.

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 2 of 2

CERTIFICATE OF COMPLIANCE and FIELD INSPECTION ENERGY CHECKLIST (Part 2 of 5) **MECH-1C**

Project Name: SBCAST Date: 9/5/2012

Discrepancies:

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 3 of 7

CERTIFICATE OF COMPLIANCE and FIELD INSPECTION ENERGY CHECKLIST (Part 3 of 5) **MECH-1C**

Project Name: SBCAST Date: 9/5/2012

Required Acceptance Tests

Designer: This form is to be used by the designer and attached to the plans. Listed below are all the acceptance tests for mechanical systems. The designer is required to check the applicable boxes by all acceptance tests that apply and attach an acceptance item that requires an acceptance item. If the equipment or a certain type requires a test, list the equipment description and part of the plans, completion of this section will allow the responsible party to budget for the scope of work appropriately.

Building Departments: Before occupancy permit is granted for a newly constructed building or space, or a new space-conditioning system serving a building or space is operated for normal use, all control devices serving the building or space shall be certified as meeting the Acceptance Requirements for Code Compliance.

Systems Acceptance: Before occupancy permit is granted, all newly installed HVAC equipment must be tested using the Acceptance Requirements.

The MECH-1C form is not considered a completed form and is not to be accepted by the building department unless the correct boxes are checked. The equipment requiring testing person performing the test (Example: HVAC installer, TAB contractor, control contractor, PE in charge of project) and what Acceptance test must be conducted. The following specifications, installation, certification, and operating and maintenance information meet the requirements of §10-103(b) and Title 24 Part 6. The building inspector must receive the properly filled out and signed forms before the building can receive final occupancy.

TEST DESCRIPTION	MECH-1A	MECH-1B	MECH-1C	MECH-1D	MECH-1E	MECH-1F	MECH-1G	MECH-1H	MECH-1I	MECH-1J	MECH-1K	MECH-1L	MECH-1M	MECH-1N	MECH-1O	MECH-1P	MECH-1Q	MECH-1R	MECH-1S	MECH-1T	MECH-1U	MECH-1V	MECH-1W	MECH-1X	MECH-1Y	MECH-1Z
Equipment Requiring Testing or Verification	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Heater - not Water	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Heating Only - No Cooling	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 4 of 7

CERTIFICATE OF COMPLIANCE and FIELD INSPECTION ENERGY CHECKLIST (Part 4 of 5) **MECH-1C**

Project Name: SBCAST Date: 9/5/2012

TEST DESCRIPTION

TEST DESCRIPTION	MECH-1A	MECH-1B	MECH-1C	MECH-1D	MECH-1E	MECH-1F	MECH-1G	MECH-1H	MECH-1I	MECH-1J	MECH-1K	MECH-1L	MECH-1M	MECH-1N	MECH-1O	MECH-1P	MECH-1Q	MECH-1R	MECH-1S	MECH-1T	MECH-1U	MECH-1V	MECH-1W	MECH-1X	MECH-1Y	MECH-1Z
Equipment Requiring Testing or Verification	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Heater - not Water	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Heating Only - No Cooling	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 5 of 7

CERTIFICATE OF COMPLIANCE (Part 5 of 5) **MECH-1C**

Project Name: SBCAST Date: 9/5/2012

Documentation Author's Declaration Statement

I certify that this Certificate of Compliance documentation is accurate and complete.

Name: Mark Tsukamoto, P.E. Signature: [Signature] Date: 9/5/2012
 Company: Dozal & Associates
 Address: 26123 Singer Place
 City/State/Zip: Stevenson Ranch, CA 91381

The Principal Mechanical Designer's Declaration Statement

- I am eligible under Division 3 of the California Business and Professions Code to accept responsibility for the mechanical design.
- This Certificate of Compliance identifies the mechanical features and performance specifications required for compliance with Title 24, Parts 1 and 6 of the California Code of Regulations.
- The design features represented on this Certificate of Compliance are consistent with the information provided to document this design on the other applicable compliance forms, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

Name: Mark Tsukamoto, P.E. Signature: [Signature] Date: 09-05-12
 Company: Dozal & Associates
 Address: 26123 Singer Place
 City/State/Zip: Stevenson Ranch, CA 91381
 License #: M-279994
 Phone: 661-993-3343

Mandatory Measures
 Indicate location on building plans of Note Block for Mandatory Measures.

MECHANICAL COMPLIANCE FORMS & WORKSHEETS (check box if worksheet is included)

For detailed instructions on the use of this and all Energy Efficiency Standards compliance forms, please refer to the 2008 Nonresidential Manual. Note: The Enforcement Agency may require all forms to be incorporated onto the building plans.

MECH-1C Certificate of Compliance. Required on plans for all submittals.
 MECH-2C Mechanical Equipment Summary is required for all submittals.
 MECH-3C Mechanical Ventilation and Reheat is required for all submittals with mechanical ventilation.
 MECH-4C Fan Power Consumption is required for all prescriptive submittals.

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 6 of 7

MECHANICAL MANDATORY MEASURES: NONRESIDENTIAL **MECH-MM**

Project Name: SBCAST Date: 9/5/2012

Equipment and System Efficiencies

§111: Any appliance for which there is a California standard established in the Appliance Efficiency Regulations will comply with the applicable standard.
 §115(a): Fan type central furnaces shall not have a pilot light.
 §123: Piping, except that conveying fluids at temperatures between 60 and 105 degrees Fahrenheit, or within HVAC equipment, shall be insulated in accordance with Standards Section 123.
 §124: Air handling duct systems shall be installed and insulated in compliance with Sections 601, 602, 603, 604, and 605 of the CMC Standards.

Controls

§122(e): Each space conditioning system shall be installed with one of the following:
 1A. Each space conditioning system serving building types such as offices and manufacturing facilities (and all others not explicitly exempt from the requirements of Section 112 (d)) shall be installed with an automatic time switch with an accessible manual override that allows operation of the system during off-hours for up to 4 hours. The time switch shall be capable of programming different schedules for weekdays and weekends and have program backup capabilities that prevent the loss of the device's program and time setting for at least 10 hours if power is interrupted; or
 1B. An occupancy sensor to control the operating period of the system; or
 1C. A 4-hour timer that can be manually operated to control the operating period of the system.
 2. Each space conditioning system shall be installed with controls that temporarily restart and temporarily operate the system as required to maintain a setback heating and/or a setback cooling thermostat setpoint.
 §122(g): Each space conditioning system serving multiple zones with a combined conditioned floor area more than 25,000 square feet shall be provided with isolation zones. Each zone: shall not exceed 25,000 square feet; shall be provided with isolation devices, such as valves or dampers that allow the supply of heating or cooling to be setback or shut off independently of other isolation areas, and shall be controlled by a time control device as described above.
 §122(c): Thermostats shall have numeric setpoints in degrees Fahrenheit (F) and adjustable setpoint stops accessible only to authorized personnel.
 §122(b): Heat pumps shall be installed with controls to prevent electric resistance supplementary heater operation when the heating load can be met by the heat pump alone.
 §122(a&b): Each space conditioning system shall be controlled by an individual thermostat that responds to temperature within the zone. Where used to control heating, the control shall be adjustable down to 55 degrees F or lower. For cooling, the control shall be adjustable up to 85 degrees F or higher. Where used for both heating and cooling, the control shall be capable of providing a deadband of at least 5 degrees F within which the supply of heating and cooling is shut off or reduced to a minimum.

Ventilation

§121(e): Controls shall be provided to allow outside air dampers or devices to be operated at the ventilation rates as specified on these plans.
 §122(f): All gravity ventilating systems shall be provided with automatic or readily accessible manually operated dampers in all openings to the outside, except for combustion air openings.
 §121(f): Ventilation System Acceptance. Before an occupancy permit is granted for a newly constructed building or space, or a new ventilating system serving a building or space is operated for normal use, all ventilation systems serving the building or space shall be certified as meeting the Acceptance Requirements for Code Compliance.

Service Water Heating Systems

§113(c): Installation
 3. Temperature controls for public lavatories. The controls shall limit the outlet Temperature to 110°F.
 2. Circulating service water-heating systems shall have a control capable of automatically turning off the circulating pump when hot water is not required.

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 7 of 7

MECHANICAL MANDATORY MEASURES: NONRESIDENTIAL **MECH-MM**

Project Name: SBCAST Date: 9/5/2012

Equipment and System Efficiencies

§111: Any appliance for which there is a California standard established in the Appliance Efficiency Regulations will comply with the applicable standard.
 §115(a): Fan type central furnaces shall not have a pilot light.
 §123: Piping, except that conveying fluids at temperatures between 60 and 105 degrees Fahrenheit, or within HVAC equipment, shall be insulated in accordance with Standards Section 123.
 §124: Air handling duct systems shall be installed and insulated in compliance with Sections 601, 602, 603, 604, and 605 of the CMC Standards.

Controls

§122(e): Each space conditioning system shall be installed with one of the following:
 1A. Each space conditioning system serving building types such as offices and manufacturing facilities (and all others not explicitly exempt from the requirements of Section 112 (d)) shall be installed with an automatic time switch with an accessible manual override that allows operation of the system during off-hours for up to 4 hours. The time switch shall be capable of programming different schedules for weekdays and weekends and have program backup capabilities that prevent the loss of the device's program and time setting for at least 10 hours if power is interrupted; or
 1B. An occupancy sensor to control the operating period of the system; or
 1C. A 4-hour timer that can be manually operated to control the operating period of the system.
 2. Each space conditioning system shall be installed with controls that temporarily restart and temporarily operate the system as required to maintain a setback heating and/or a setback cooling thermostat setpoint.
 §122(g): Each space conditioning system serving multiple zones with a combined conditioned floor area more than 25,000 square feet shall be provided with isolation zones. Each zone: shall not exceed 25,000 square feet; shall be provided with isolation devices, such as valves or dampers that allow the supply of heating or cooling to be setback or shut off independently of other isolation areas, and shall be controlled by a time control device as described above.
 §122(c): Thermostats shall have numeric setpoints in degrees Fahrenheit (F) and adjustable setpoint stops accessible only to authorized personnel.
 §122(b): Heat pumps shall be installed with controls to prevent electric resistance supplementary heater operation when the heating load can be met by the heat pump alone.
 §122(a&b): Each space conditioning system shall be controlled by an individual thermostat that responds to temperature within the zone. Where used to control heating, the control shall be adjustable down to 55 degrees F or lower. For cooling, the control shall be adjustable up to 85 degrees F or higher. Where used for both heating and cooling, the control shall be capable of providing a deadband of at least 5 degrees F within which the supply of heating and cooling is shut off or reduced to a minimum.

Ventilation

§121(e): Controls shall be provided to allow outside air dampers or devices to be operated at the ventilation rates as specified on these plans.
 §122(f): All gravity ventilating systems shall be provided with automatic or readily accessible manually operated dampers in all openings to the outside, except for combustion air openings.
 §121(f): Ventilation System Acceptance. Before an occupancy permit is granted for a newly constructed building or space, or a new ventilating system serving a building or space is operated for normal use, all ventilation systems serving the building or space shall be certified as meeting the Acceptance Requirements for Code Compliance.

Service Water Heating Systems

§113(c): Installation
 3. Temperature controls for public lavatories. The controls shall limit the outlet Temperature to 110°F.
 2. Circulating service water-heating systems shall have a control capable of automatically turning off the circulating pump when hot water is not required.

EnergyPro 5.1 by EnergySoft User Number: 6931 RunCode: 2012-09-05T07:10:19 ID: 00071 Page 7 of 7

M A C Y A R C H I T E C T U R E

315 Linden Street
 San Francisco, CA 94102
 Tel 415 551 7630
 Fax 415 551 7601
 www.macyarchitecture.com

REGISTERED PROFESSIONAL ENGINEER
 CIVIL
 NO. 27884
 EXP. 08/28/14
 STATE OF CALIFORNIA

CONSULTANTS
 Dozal & Assoc.
 26123 Singer Pl.
 Stevenson Ranch, CA
 91381
 T. 661.993.3343

PROJECT
 SANTA BARBARA CENTER FOR ART, SCIENCE & TECHNOLOGY

ISSUES / REVISIONS

SHEET TITLE
 TITLE 24 DOCUMENTS

DATE
 04/10/14

PHASE
 ISSUE FOR BID

SCALE
 NONE

SHEET
 MI.2


STAMP

FULL SIZE

WHOLE BUILDING VENTILATION REQUIREMENTS (FROM ASHRAE 62.2)			
AT LEAST ONE MECHANICAL VENTILATION SYSTEM IN THE BUILDING MUST BE DESIGNATED FOR USE IN COMPLIANCE WITH THE WHOLE-BUILDING VENTILATION REQUIREMENT. ALTERNATIVELY, THE SUM OF THE RATED AIRFLOWS FROM MULTIPLE FANS CAN BE UTILIZED TO MEET THE REQUIRED WHOLE			
[Eq. 4.1a]	$Q_{fan} = 0.01 A_{floor} + 7.5 (N_{br} + 1)$	Where: A _{floor} = conditioned floor area, ft ² N _{br} = number of bedrooms, not to be less than one Q _{fan} = ventilation air requirement = fan flow rate, (cfm)	Eq. 4.1a Calculation: A _{floor} = 376 N _{br} = 1 Q _{fan} = 20

LOCAL VENTILATION EXHAUST REQUIREMENTS (FROM ASHRAE 62.2)		
LOCAL MECHANICAL EXHAUST FANS SHALL BE INSTALLED IN EACH KITCHEN AND BATHROOM ACCORDING TO THE REQUIREMENTS OF ASHRAE 62.2. THE MINIMUM AIRFLOW RATES SHALL BE GREATER THAN OR EQUAL TO THE AMOUNT INDICATED IN TABLE 5.1 BELOW AND FAN SONE RATINGS MUST NOT		
TABLE 5.1 MINIMUM INTERMITTENT LOCAL EXHAUST VENTILATION EXHAUST AIRFLOW RATES		
APPLICATION	AIRFLOW	NOTES
KITCHEN	100 CFM	VENTED RANGE HOOD REQUIRED IF EXHAUST FAN FLOW IS LESS THAN 5 ACH *. IF RANGE HOOD IS USED FOR LOCAL EXHAUST, IT MUST BE VENTED TO THE OUTDOORS.
BATHROOM	50 CFM	
* AIR CHANGES PER HOUR (ACH), WHICH IS DETERMINED BY MULTIPLYING THE VOLUME OF THE SPACE BY FIVE (5) ACH = CUBIC FEET PER HOUR, AND THEN DIVIDING BY 60 MINUTES PER HOUR TO DETERMINE THE CUBIC FEET PER MINUTE.		


(EXISTING PRE-ENGINEERED METAL BUILDING) ≈ +14.24'

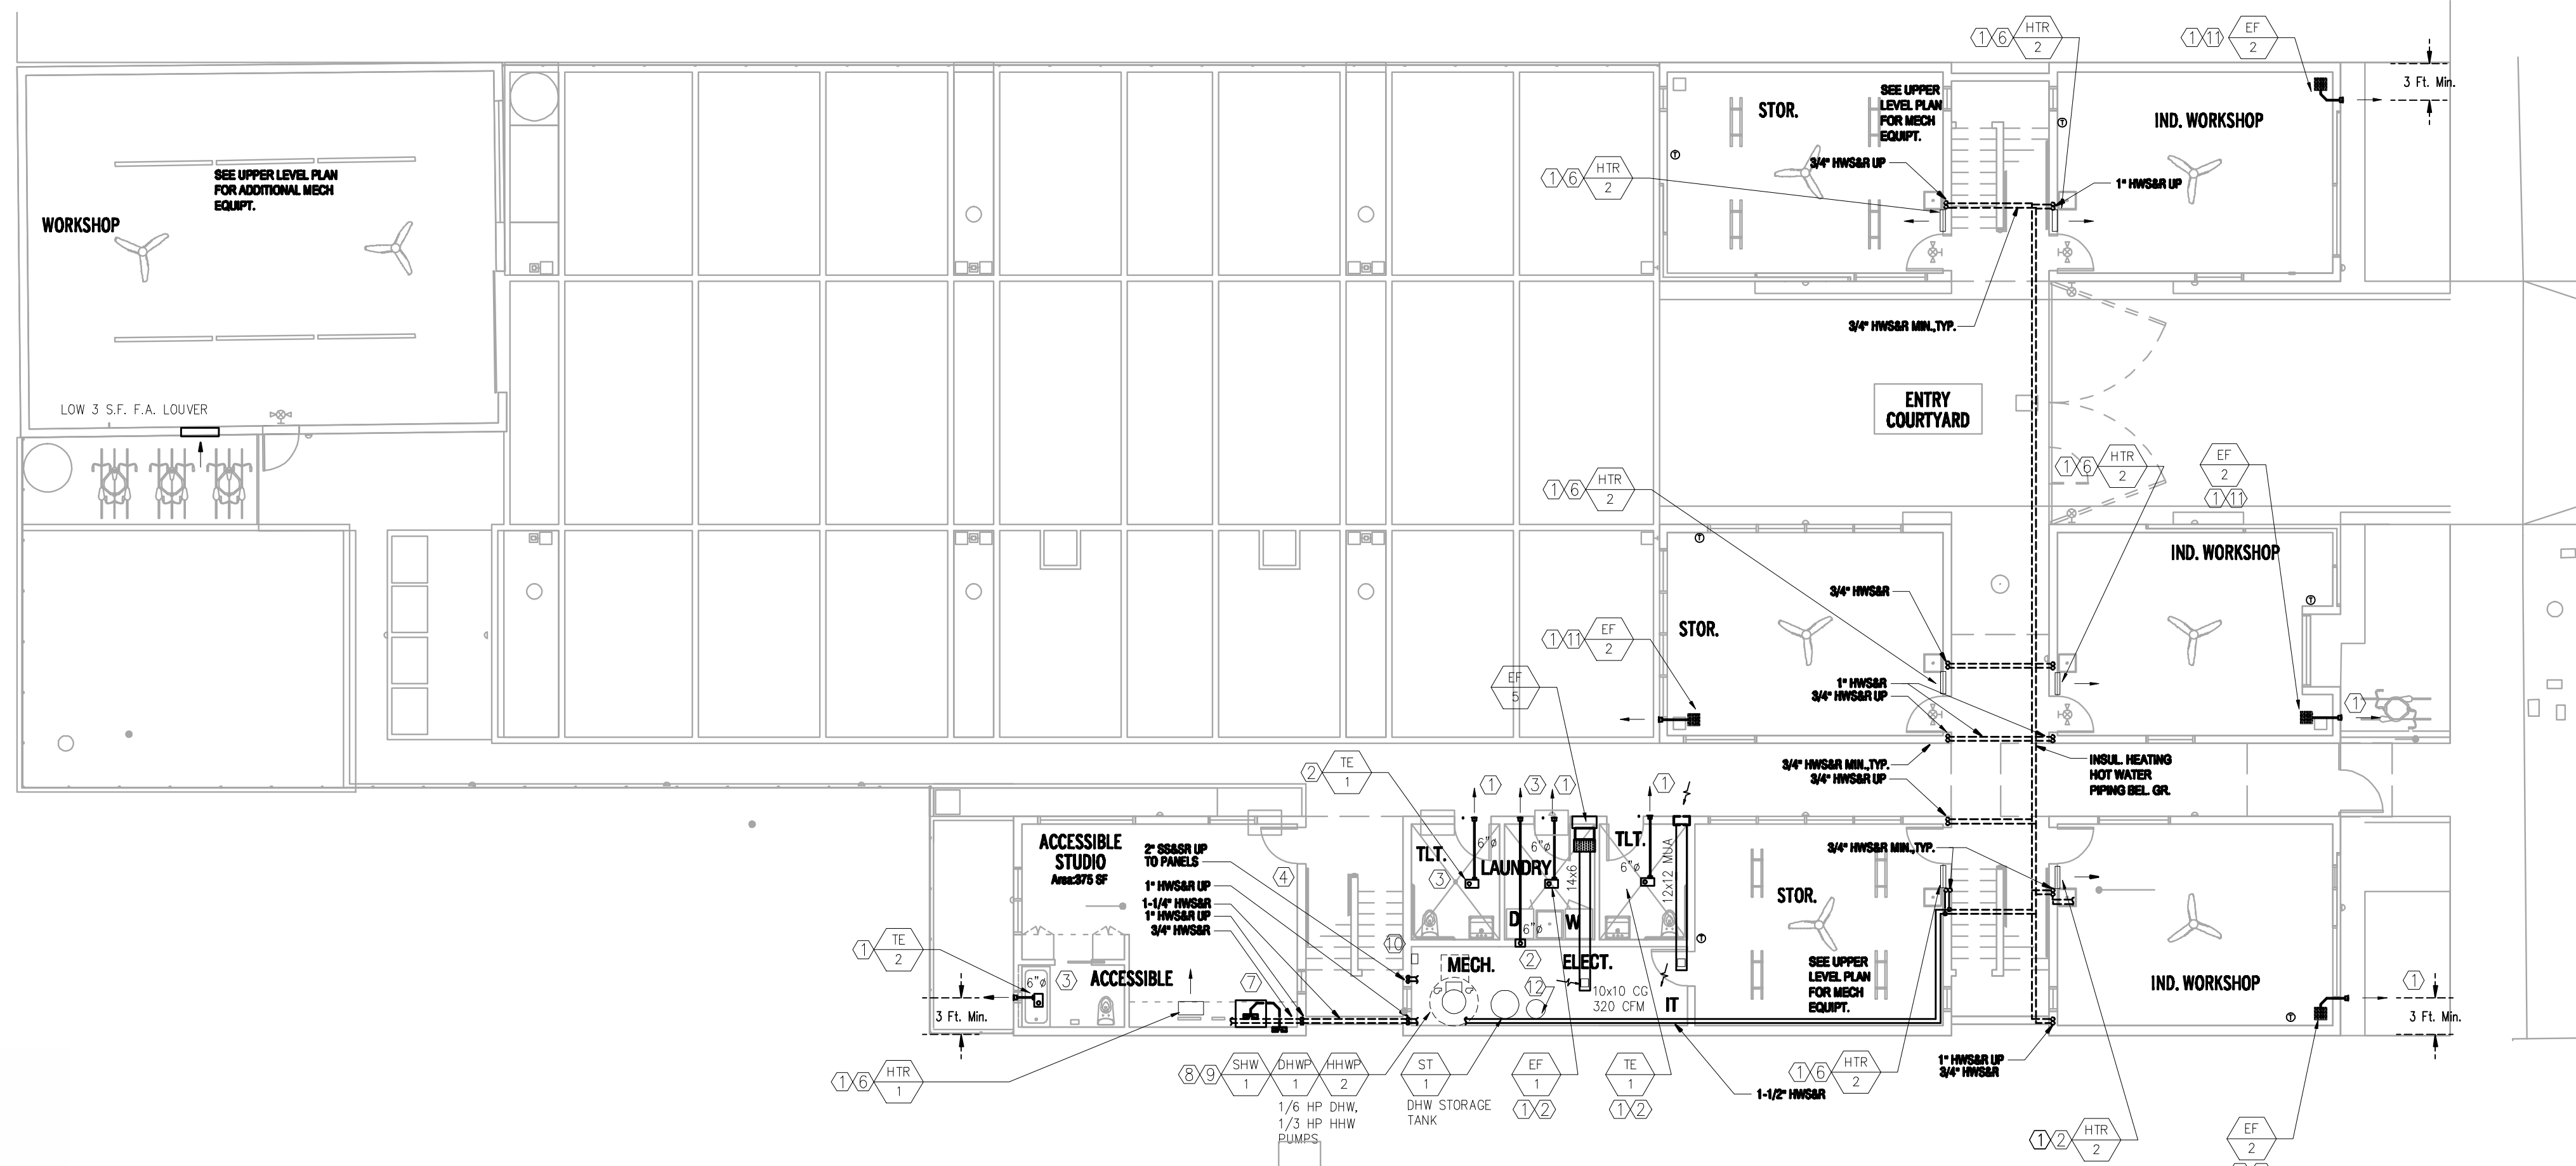

GARDEN STREET (CENTERLINE OF STREET)

- MECHANICAL GENERAL NOTES**
- CONTRACTOR SHALL INSTALL MECH. EQUIPT. FOR CONCEALED LOC'NS. W/ SERVICE ACCESS IN SUCH A MANNER AS TO ALLOW FOR 36" IN FRONT OF CONTROLLERS, COMPONENT ACCESS AND ELECTRICAL DISCONNECTS.
 - ALL EXTERIOR COMPONENTS OR ANY COMPONENT EXPOSED TO THE EXTERIOR ENVIRON. SHALL BE EPOXY-COATED, CORROSION-PROOF OR EQUAL. INSECT AND BIRDSCREENS SHALL BE STAINLESS STEEL.
 - EXPOSED DUCTS SHALL BE INSTALLED WITHOUT DENTS OR DEFECTS. USE COUPLINGS AT JOINTS SEALED WITH CLEAR SILICONE SEAL.
 - ALL DUCTWORK SHALL BE GALVANIZED SHEET METAL AND COMPLY WITH CURRENT CMC CH. 6.
 - CONTRACTOR SHALL VERIFY ALL WALL PARTITIONS TYPES/CELING TYPES AND RATING IN ORDER TO PROVIDE COMBINATION SMOKE FIRE DAMPERS / FIRE STOPPING AT PENETRATIONS TO FIRE RATED AREAS (IN ACCORDANCE WITH MECHANICAL CODE).
 - THERMOSTATS SHALL BE INSTALLED 48" ABOVE FINISHED FLOOR. FINAL THERMOSTAT LOCATION(S) SHALL BE COORDINATED WITH FURNITURE LAYOUT AND APPROVED BY THE ARCHITECT.
 - FINAL GRILL TYPES AND LOCATIONS SHALL BE COORDINATED AND APPROVED BY ARCHITECT.
 - CONTRACTOR SHALL COORDINATE FINAL MECHANICAL DISTRIBUTION AND NOTIFY ARCHITECT/ENGINEER OF ANY DISCREPANCIES OR CLEARANCE ISSUES.
 - ALL DUCT AND PIPE PENETRATIONS THROUGH FULL HEIGHT WALLS SHALL BE ACOUSTICALLY SEALED.
 - CONTRACTOR SHALL PROVIDE ACCESS PANELS FOR ALL EQUIPMENT LOCATED ABOVE HARD LID CEILINGS.
 - PROVIDE LINED DUCTWORK FOR THE FIRST 15 FEET TO AND FROM FANS.
 - ALL ACCESS PANELS INCLUDING THOSE IN ACCESSIBLE CEILING SHALL BE DESIGNATED AND PROPERLY FRAMED TO ALLOW PROPER ACCESS WITHOUT DRAGGING THE CEILING TILE OR GRID. AVOID LOCATING ANY CONDUITS DIRECTLY ABOVE ACCESS TO EQUIPMENTS.
 - ALL THERMOSTATS INSTALLED ON EXTERIOR WALLS OR COLUMNS SHALL HAVE AN INSULATED BACKING INSTALLED BEHIND THE THERMOSTAT.
 - BATHROOM EXHAUST FANS WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH CGCS 4.506 AND SHALL INCLUDE THE FOLLOWING:
(A) BE ENERGY STAR COMPLIANT.
(B) UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM FANS MUST BE CONTROLLED BY A HUMIDISTAT WHICH SHALL BE READILY ACCESSIBLE. HUMIDITY CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY OF 50% TO 80%. [FOR SB/CASIT, THE RESIDENTIAL BATHROOM EXHAUST FANS ARE A COMPONENT OF THE WHOLE HOUSE VENTILATION SYSTEM.]

- KEYED MECHANICAL NOTES:**
- CENTER MECHANICAL DEVICES WITH, OR IN BETWEEN ARCHITECTURAL FEATURES, SUCH AS DOORS, WINDOWS, WALLS, COLUMNS, ETC. WHEN POSSIBLE, SUBMIT OPENING LAYOUTS TO ARCHITECT FOR APPROVAL, PRIOR TO PENETRATION.
 - 6" EA DUCT IN JOIST SPACE TRANS. TO 4" THRU WALL TO SEHO #SF14-N WITH STAINLESS STEEL INSECT SCREEN.
 - 4" RIGID SHEET METAL DRYER (W/ NO INTERIOR SCREWS) DUCT UP, TO FANTECH LINT TRAP #BLT4 (DUCT IN JOIST SPACE TRANS. TO 4" THRU WALL TO SEHO #SFZ-C4-N WITH DRYER BACKDRAFT DAMPER [MAX. 14 FT. RUN INCL. 2 ELBOWS, OTHERWISE INCREASE TO 5 INCH ROUND DUCT])
 - MANDATORY VENTILATION SIGNAGE IN AREA, 12 FT. MIN. TO MAINTAIN MINIMUM LEVELS OF OUTSIDE AIR VENTILATION REQ'D. FOR GOOD HEALTH, THE FAN CONTROL SHOULD BE ON AT ALL TIMES WHEN THE BUILDING IS OCCUPIED, UNLESS THERE IS SEVERE OUTDOOR AIR CONTAMINATION.
 - PROVIDE ALL SUSPENDED MOTORIZED EQUIPMENT WITH RESILIENT ISOLATION AND FLEXIBLE CONNECTIONS TO PREVENT VIBRATIONS. SUPPORT ALL MOTORIZED EQUIPMENT WITH ALL-THREAD RODS.
 - LOCATE HEATER PER ARCHITECT & ACCORDING TO MFR. INSTALLN. INSTRUCTIONS. MAINTAIN 24 INCHES MIN. FROM ADJACENT WALLS AND STRUCTURE.
 - HIGH STATIC RESIDENTIAL HOOD BY OTHERS, 14x3-1/4 EXH. DUCT UP IN WALLS & OFFSET OVER AND THRU THE ROOF AT 3 FT. FROM BLDG. EDGE, TYP.
 - PROVIDE CONCENTRIC CAT. IN VENT TO ROOF WITH CODE-APPROVED ROOF VENT. PROVIDE FIRE-WRAP AS REQUIRED.
 - PROVIDE COMPLETE INSTALLATION OF HTC VERSAHYDRO MODEL PHE-199-119-S, COMBINATION SOLAR WATER HEATER, DUAL PUMPS & STORAGE TANK ACCORDING TO CODE, MFR. INSTRUCTIONS, AND FIELD CONDITIONS. SEE DETAIL SHIT M3.0. SUBMIT COMPLETE COORDINATION SHOP DRAWINGS AND FIELD PROCESS & INSTRUMENTATION DRAWINGS FOR APPROVAL PRIOR TO ORDERING AND INSTALLATION. PROVIDE CODE-FREE APPROVED SEISMIC RESTRAINT STRAPS ON TANKS: HOLDRITE BRAND # 05-120, SEISMIC STRAP FOR MIN. 3 STRAPS/TANK.
 - COORDINATE INSTALLATION ACCESS.
 - 8" EXH. DUCT IN JOIST SPACE TO SEHO MODEL SFX8-N W/ STAINLESS STEEL INSECT SCREEN.
 - DUE TO THE AREA'S HARD WATER, PROVIDE A WATER TREATMENT SYSTEM TO INHIBIT SCALE, CORROSION, ON AN EXCHANGE BASIS FOR CLOSED LOOP MAKEUP WATER.
 - COORDINATE INSTALLATION ACCESS.
 - 8" EXH. DUCT IN JOIST SPACE TO SEHO MODEL SFX8-N W/ STAINLESS STEEL INSECT SCREEN.
 - DUE TO THE AREA'S HARD WATER, PROVIDE A WATER TREATMENT SYSTEM TO INHIBIT SCALE, CORROSION, ON AN EXCHANGE BASIS FOR CLOSED LOOP MAKEUP WATER.

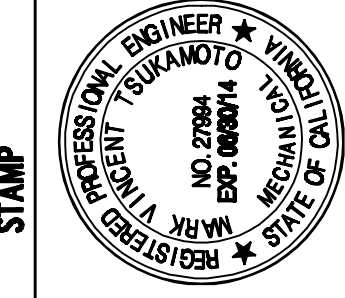

CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T.661.993.3343

PROJECT
SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNOLOGY
513 GARDEN STREET
SANTA BARBARA, CA 93101

ISSUES / REVISIONS

SHEET TITLE
FIRST FLOOR
MECHANICAL PLAN

DATE
04/10/14


PHASE
ISSUE FOR BID

SCALE
1/8" = 1'-0"

FULL SIZE

SHEET
M2.1

MACEY ARCHITECTURE
315 Linden Street
San Francisco, CA 94102
Tel 415 551 7630
Fax 415 551 7601
www.maceyarchitecture.com

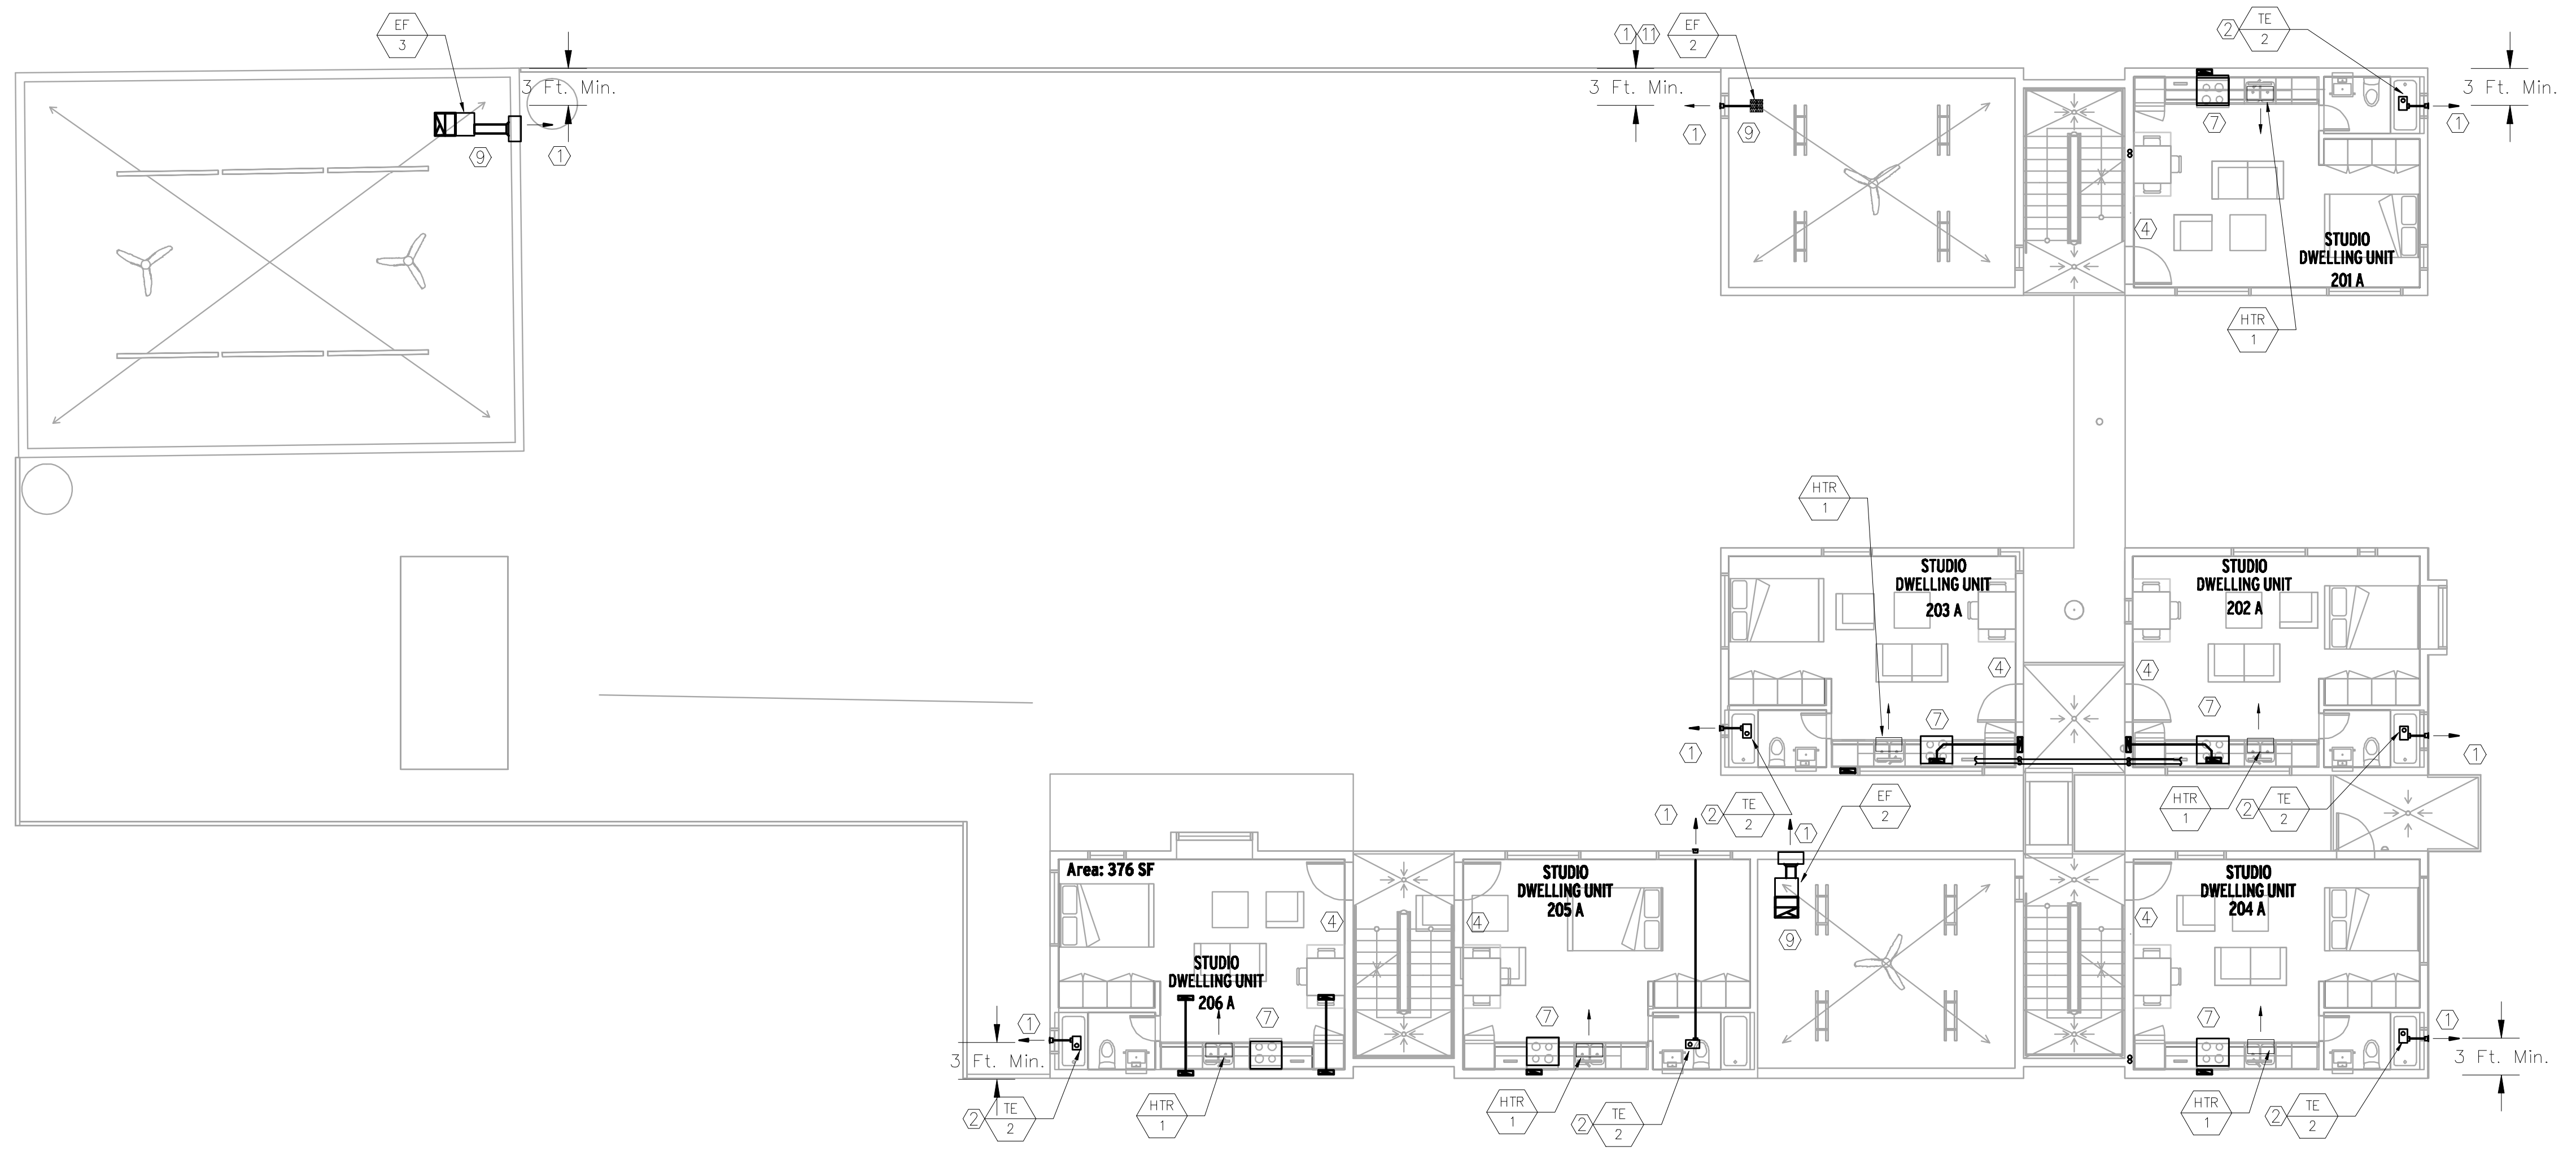


MECHANICAL GENERAL NOTES

- ① CONTRACTOR SHALL INSTALL MECH. EQUIP. FOR CONCEALED LOC'NS. W/ SERVICE ACCESS IN SUCH A MANNER AS TO ALLOW FOR 36" IN FRONT OF CONTROLLERS, COMPONENT ACCESS AND ELECTRICAL DISCONNECTS.
- ② ALL EXTERIOR COMPONENTS OR ANY COMPONENT EXPOSED TO THE EXTERIOR ENVIRON. SHALL BE EPOXY-COATED, CORROSION-PROOF OR EQUAL. INSECT AND BIRDSCREENS SHALL BE STAINLESS STEEL.
- ③ EXPOSED DUCTS SHALL BE INSTALLED WITHOUT DENTS OR DEFECTS. USE COUPLINGS AT JOINTS SEALED WITH CLEAR SILICONE SEAL.
- ④ ALL DUCTWORK SHALL BE GALVANIZED SHEET METAL AND COMPLY WITH CURRENT CMC CH. 6.
- ⑤ CONTRACTOR SHALL VERIFY ALL WALL PARTITIONS TYPES/CEILING TYPES AND RATING IN ORDER TO PROVIDE COMBINATION SMOKE FIRE DAMPERS / FIRE STOPPING AT PENETRATIONS TO FIRE RATED AREAS (IN ACCORDANCE WITH MECHANICAL CODE).
- ⑥ THERMOSTATS SHALL BE INSTALLED 48" ABOVE FINISHED FLOOR. FINAL THERMOSTAT LOCATION(S) SHALL BE COORDINATED WITH FURNITURE LAYOUT AND APPROVED BY THE ARCHITECT.
- ⑦ FINAL GRILL TYPES AND LOCATIONS SHALL BE COORDINATED AND APPROVED BY ARCHITECT.
- ⑧ CONTRACTOR SHALL COORDINATE FINAL MECHANICAL DISTRIBUTION AND NOTIFY ARCHITECT/ENGINEER OF ANY DISCREPANCIES OR CLEARANCE ISSUES.
- ⑨ ALL DUCT AND PIPE PENETRATIONS THROUGH FULL HEIGHT WALLS SHALL BE ACOUSTICALLY SEALED.
- ⑩ CONTRACTOR SHALL PROVIDE ACCESS PANELS FOR ALL EQUIPMENT LOCATED ABOVE HARD LID CEILINGS.
- ⑪ PROVIDE LINED DUCTWORK FOR THE FIRST 15 FEET TO AND FROM FANS.
- ⑫ ALL ACCESS PANELS INCLUDING THOSE IN ACCESSIBLE CEILING SHALL BE DESIGNATED AND PROPERLY FRAMED TO ALLOW PROPER ACCESS WITHOUT DRAGGING THE CEILING TILE OR GRID. AVOID LOCATING ANY CONDUITS DIRECTLY ABOVE ACCESS TO EQUIPMENTS.
- ⑬ ALL THERMOSTATS INSTALLED ON EXTERIOR WALLS OR COLUMNS SHALL HAVE AN INSULATED BACKING INSTALLED BEHIND THE THERMOSTAT.

KEYED MECHANICAL NOTES:

- ① CENTER MECHANICAL DEVICES WITH OR IN BETWEEN ARCHITECTURAL FEATURES, SUCH AS DOORS, WINDOWS, WALLS, COLUMNS, ETC. WHEN POSSIBLE, SUBMIT OPENING LAYOUTS TO ARCHITECT FOR APPROVAL, PRIOR TO PENETRATION.
- ② 6" Ø EA DUCT IN JOIST SPACE TRANS. TO 4" Ø THRU WALL TO SEHO #SF4-N WITH STAINLESS STEEL INSECT SCREEN.
- ③ 4" Ø RIGID SHEET METAL DRYER (W/ NO INTERIOR SCREWS) DUCT UP, TO FANTECH LINT TRAP #DBL14 (DUCT IN JOIST SPACE TRANS. TO 4" Ø THRU WALL TO SEHO #SF2-C4-N WITH DRYER BACKDRAFT DAMPER (MAX. 14 FT. RUN INCL. 2 ELBOWS, OTHERWISE INCREASE TO 5 INCH ROUND DUCT)
- ④ MANDATORY VENTILATION SIGNAGE IN ARIAL12 PT. MIN.: TO MAINTAIN MINIMUM LEVELS OF OUTSIDE AIR VENTILATION REQ'D. FOR GOOD HEALTH, THE FAN CONTROL SHOULD BE ON AT ALL TIMES WHEN THE BUILDING IS OCCUPIED, UNLESS THERE IS SEVERE OUTDOOR AIR CONTAMINATION.
- ⑤ PROVIDE ALL SUSPENDED MOTORIZED EQUIPMENT WITH RESILIENT ISOLATION AND FLEXIBLE CONNECTIONS TO PREVENT VIBRATIONS. SUPPORT ALL MOTORIZED EQUIPMENT WITH ALL-THREAD RODS.
- ⑥ LOCATE HEATER PER ARCHITECT & ACCORDING TO MFR. INSTALL'N. INSTRUCTIONS: MAINTAIN 24 INCHES MIN. FROM ADJACENT WALLS AND STRUCTURE.
- ⑦ HIGH STATIC RESIDENTIAL HOOD BY OTHERS, 14x3-1/4 EXH. DUCT UP IN WALLS & OFFSET OVER AND THRU THE ROOF AT 3 FT. FROM BLDG. EDGE, TYP.
- ⑧ PROVIDE CONCENTRIC CAT. IV VENT TO ROOF WITH CODE-APPROVED ROOF VENT. PROVIDE FIRE-WRAP AS REQUIRED.
- ⑨ PROVIDE COMPLETE INSTALLATION OF HTC VERSAHYDRO MODEL PHC-199-119-S, COMBINATION SOLAR WATER HEATER, DUAL PUMPS & STORAGE TANK ACCORDING TO CODE, MFR. ROOMS, AND FIELD CONDITIONS. SUBMIT COMPLETE COORDINATION SHOP DRAWINGS AND P&ID, PROCESS & INSTRUMENTATION DRAWINGS FOR APPROVAL PRIOR TO ORDERING AND INSTALLATION.
- ⑩ COORDINATE INSTALLATION ACCESS.
- ⑪ 8" Ø EXH. DUCT IN JOIST SPACE TO SEHO MODEL SFX8-N W/ STAINLESS STEEL INSECT SCREEN.

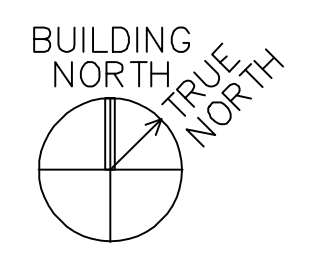

315 Linden Street
San Francisco, CA 94102
Tel 415 551 7630
Fax 415 551 7601
www.macyarchitecture.com

**M A C Y
A R C H
I T E C T U R E**

REGISTERED PROFESSIONAL ENGINEER
CALIFORNIA
NO. 27884
EXPIRES 06/30/2014
MARTIN M. MACY
MEDIANA, CA
STATE OF CALIFORNIA


CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91881
T.661.993.3343

PROJECT
**SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNOLOGY**
59 GARDEN STREET
SANTA BARBARA, CA 93001

ISSUES / REVISIONS

SHEET TITLE	DATE	PHASE	ISSUE FOR BID	SCALE	FULL SIZE
SECOND FLOOR MECHANICAL PLAN	04/10/14	ISSUE FOR BID			FULL SIZE


SHEET M2.2

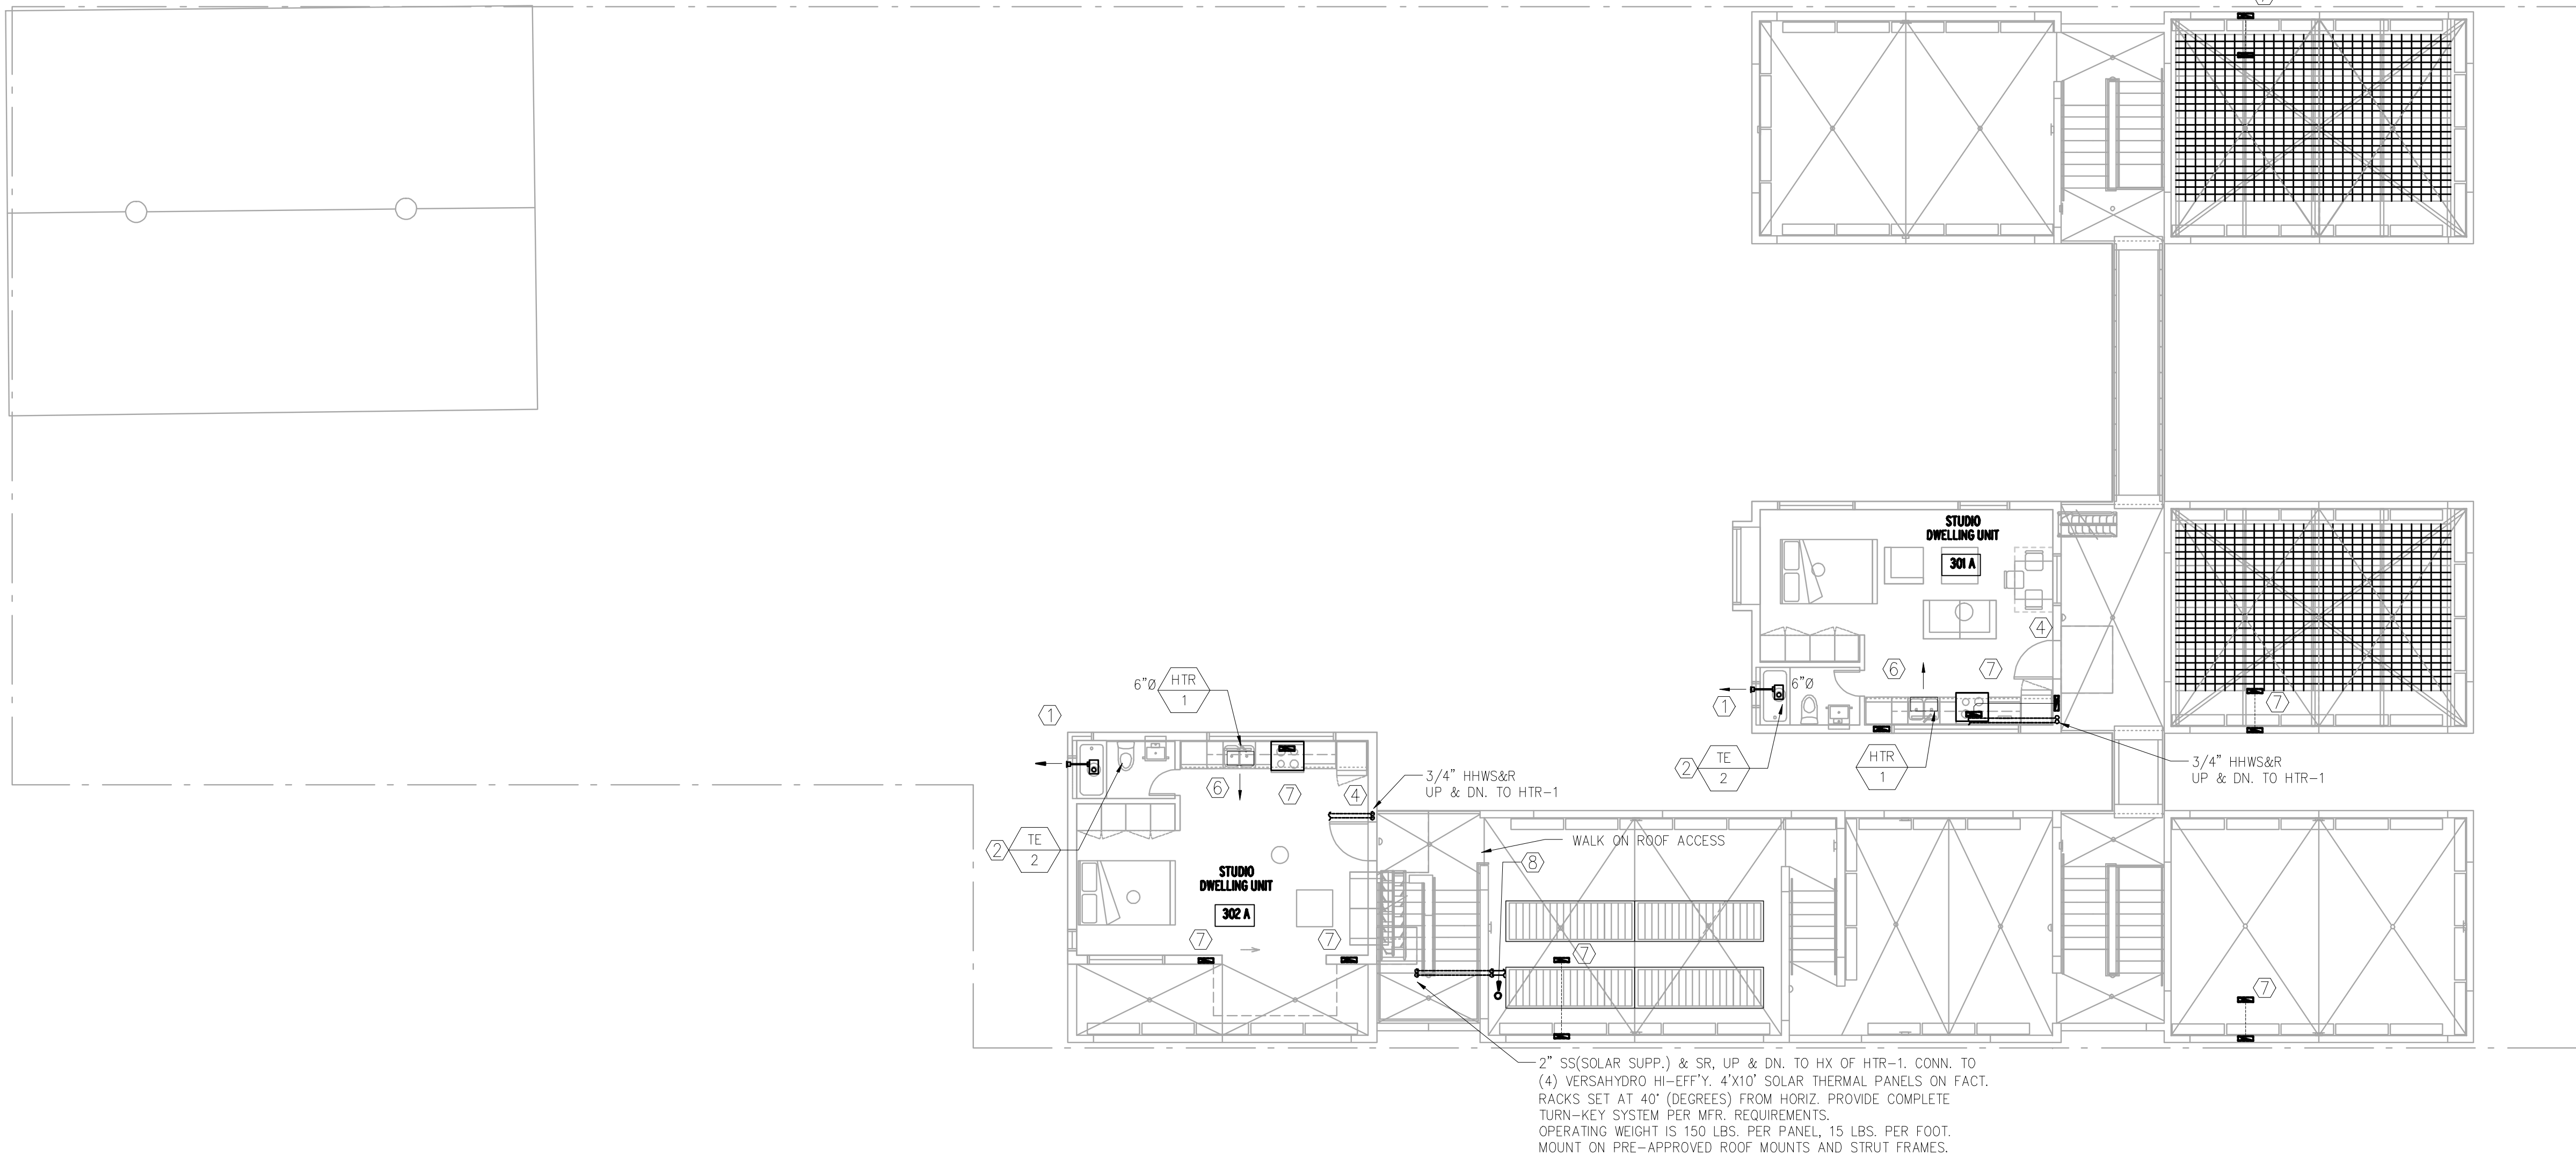


MECHANICAL GENERAL NOTES	
1. CONTRACTOR SHALL INSTALL MECH. EQUIPT. FOR CONDENSED LOCNS. W/ SERVICE ACCESS IN SUCH A MANNER AS TO ALLOW FOR 36" IN FRONT OF CONTROLLERS, COMPONENT ACCESS AND ELECTRICAL DISCONNECTS.	10. PROVIDE LINED DUCTWORK FOR THE FIRST 15 FEET TO AND FROM FANS.
2. ALL EXTERIOR COMPONENTS OR ANY COMPONENT EXPOSED TO THE EXTERIOR ENVIRONMENT SHALL BE EPDM-COATED, CORROSION-PROOF OR EQUAL. INSECT AND BIRDSCREENS SHALL BE STAINLESS STEEL.	11. ALL ACCESS PANELS INCLUDING THOSE IN ACCESSIBLE CEILING SHALL BE DESIGNATED AND PROPERLY FRAMED TO ALLOW PROPER ACCESS WITHOUT DAMAGING THE CEILING TILE OR GRID. AVOID LOCATING ANY CONDUITS DIRECTLY ABOVE ACCESS TO EQUIPMENTS.
3. EXPOSED DUCTS SHALL BE INSTALLED WITHOUT DENTS OR DEFECTS. USE COUPLINGS AT JOINTS SEALED WITH CLEAR SILICONE SEAL.	12. ALL THERMOSTATS INSTALLED ON EXTERIOR WALLS OR COLUMNS SHALL HAVE AN INSULATED BACKING INSTALLED BEHIND THE THERMOSTAT.
4. ALL DUCTWORK SHALL BE GALVANIZED SHEET METAL AND COMPLY WITH CURRENT CMC CH. 6.	13. BATHROOM EXHAUST FANS WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH CGCS 4.506 AND SHALL INCLUDE THE FOLLOWING: (A) BE ENERGY STAR COMPLIANT. (B) UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM FANS MUST BE CONTROLLED BY A HUMIDISTAT SWITCH WHICH SHALL BE READILY ACCESSIBLE. HUMIDITY CONTROL SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY OF 50% TO 80%. (C) FOR SBCSST, THE RESIDENTIAL BATHROOM EXHAUST FANS ARE A COMPONENT OF THE WHOLE HOUSE VENTILATION SYSTEM.
5. CONTRACTOR SHALL VERIFY ALL WALL PARTITIONS TYPES/CEILING TYPES AND RATING IN ORDER TO PROVIDE COMBINATION SMOKE FIRE DAMPERS / FIRE STOPPING AT PENETRATIONS TO FIRE RATED AREAS (IN ACCORDANCE WITH MECHANICAL CODE).	14. THERMOSTATS SHALL BE INSTALLED 48" ABOVE FINISHED FLOOR. FINAL THERMOSTAT LOCATION(S) SHALL BE COORDINATED WITH FURNITURE LAYOUT AND APPROVED BY THE ARCHITECT.
6. THERMOSTATS SHALL BE INSTALLED 48" ABOVE FINISHED FLOOR. FINAL THERMOSTAT LOCATION(S) SHALL BE COORDINATED WITH FURNITURE LAYOUT AND APPROVED BY THE ARCHITECT.	15. FINAL GRILL TYPES AND LOCATIONS SHALL BE COORDINATED AND APPROVED BY ARCHITECT.
7. CONTRACTOR SHALL COORDINATE FINAL MECHANICAL DISTRIBUTION AND NOTIFY ARCHITECT/ENGINEER OF ANY DISCREPANCIES OR CLEARANCE ISSUES.	16. ALL DUCT AND PIPE PENETRATIONS THROUGH FULL HEIGHT WALLS SHALL BE ACOUSTICALLY SEALED.
8. ALL DUCT AND PIPE PENETRATIONS THROUGH FULL HEIGHT WALLS SHALL BE ACOUSTICALLY SEALED.	17. CONTRACTOR SHALL PROVIDE ACCESS PANELS FOR ALL EQUIPMENT LOCATED ABOVE HARD LID CEILINGS.

KEYED MECHANICAL NOTES:

- 1. CENTER MECHANICAL DEVICES WITH, OR IN BETWEEN ARCHITECTURAL FEATURES, SUCH AS DOORS, WINDOWS, WALLS, COLUMNS, ETC. WHEN POSSIBLE, SUBMIT OPENING LAYOUTS TO ARCHITECT FOR APPROVAL, PRIOR TO PENETRATION.
- 2. 6"Ø EA DUCT IN JOIST SPACE TRANS. TO 4"Ø THRU WALL TO SEIHO #SF4-N WITH STAINLESS STEEL INSECT SCREEN.
- 3. 4"Ø RIGID SHEET METAL DRYER (W/ NO INTERIOR SCREWS) DUCT UP, TO FANTECH LINT TRAP #DBLT4 (DUCT IN JOIST SPACE TRANS. TO 4"Ø THRU WALL TO SEIHO #SF2-C4-N WITH DRYER BACKDRAFT DAMPER [MAX. 14 FT. RUN INCL. 2 ELBOWS, OTHERWISE INCREASE TO 5 INCH ROUND DUCT]).
- 4. MANDATORY VENTILATION SIGNAGE IN ARIAL, 12 PT. MIN.: TO MAINTAIN MINIMUM LEVELS OF OUTSIDE AIR VENTILATION REQ'D. FOR GOOD HEALTH, THE FAN CONTROL SHOULD BE ON AT ALL TIMES WHEN THE BUILDING IS OCCUPIED, UNLESS THERE IS SEVERE OUTDOOR AIR CONTAMINATION.
- 5. PROVIDE ALL SUSPENDED MOTORIZED EQUIPMENT WITH RESILIENT ISOLATION AND FLEXIBLE CONNECTIONS TO PREVENT VIBRATIONS. SUPPORT ALL MOTORIZED EQUIPMENT WITH ALL-THREAD RODS.
- 6. LOCATE HEATER PER ARCHITECT & ACCORDING TO MFR. INSTALL'N INSTRUCTIONS. MAINTAIN 24 INCHES MIN. FROM ADJACENT WALLS AND STRUCTURE.
- 7. HIGH STATIC RESIDENTIAL HOOD BY OTHERS, 14x3-1/4 EXH. DUCT UP IN WALLS & OFFSET OVER AND THRU THE ROOF AT 3 FT. FROM BLDG. EDGE, TYP.
- 8. PROVIDE CONCENTRIC CAT. IV VENT TO ROOF WITH CODE-APPROVED ROOF VENT. PROVIDE FIRE-WRAP AS REQUIRED.
- 9. PROVIDE COMPLETE INSTALLATION OF HTC VERSAHYDRO MODEL PHE-199-119-S, COMBINATION SOLAR WATER HEATER, DUAL PUMPS & STORAGE TANK ACCORDING TO CODE, MFR. RQMTS. AND FIELD CONDITIONS. SUBMIT COMPLETE COORDINATION SHOP DRAWINGS AND P&ID, PROCESS & INSTRUMENTATION DRAWINGS FOR APPROVAL PRIOR TO ORDERING AND INSTALLATION.
- 10. COORDINATE INSTALLATION ACCESS.
- 11. 8"Ø EXH. DUCT IN JOIST SPACE TO SEIHO MODEL SFX8-N W/ STAINLESS STEEL INSECT SCREEN.



**M A C Y
A R C H I T E C T U R E**

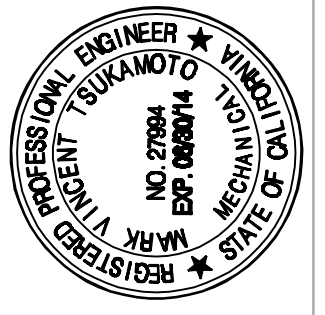

CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T. 661.993.3343


PROJECT
**SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNOLOGY**
513 GARDEN STREET
SANTA BARBARA, CA 93101

ISSUES / REVISIONS

SHEET TITLE
THIRD FLOOR
MECHANICAL PLAN


DATE: 04/10/14
PHASE: ISSUE FOR BID
SCALE: 1/8" = 1'-0"
FULL SIZE

SHEET
M2.3

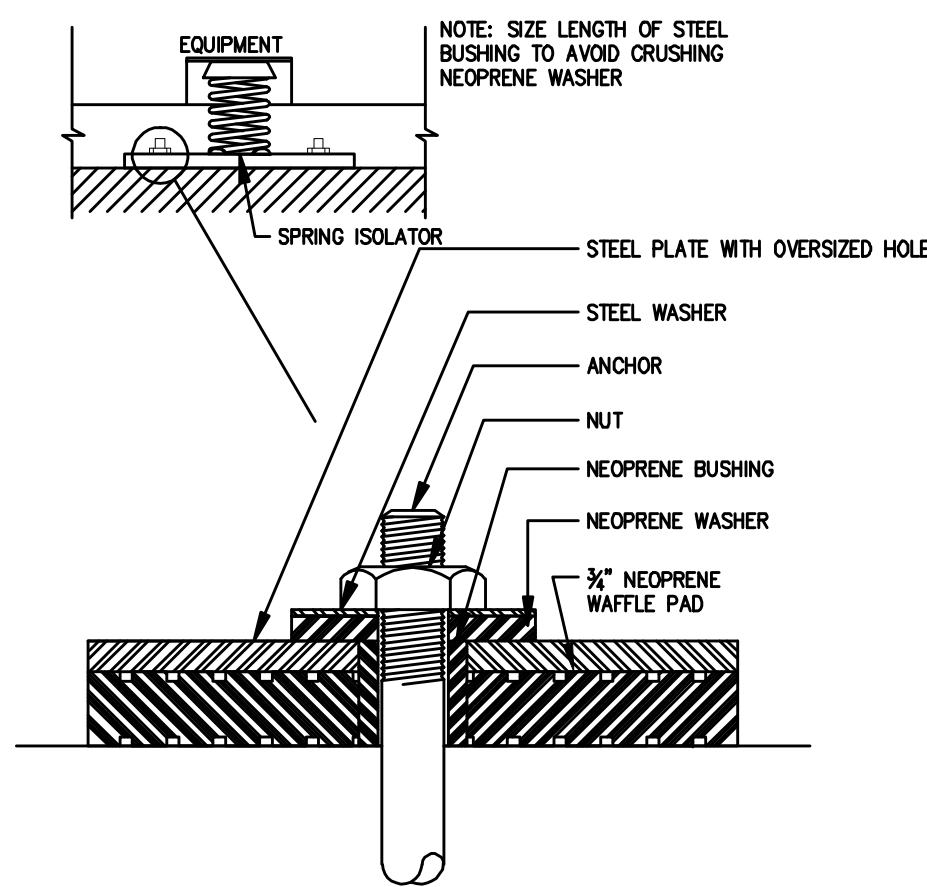


TYPICAL SPRING MOUNT RESTRAINT BOLT

16

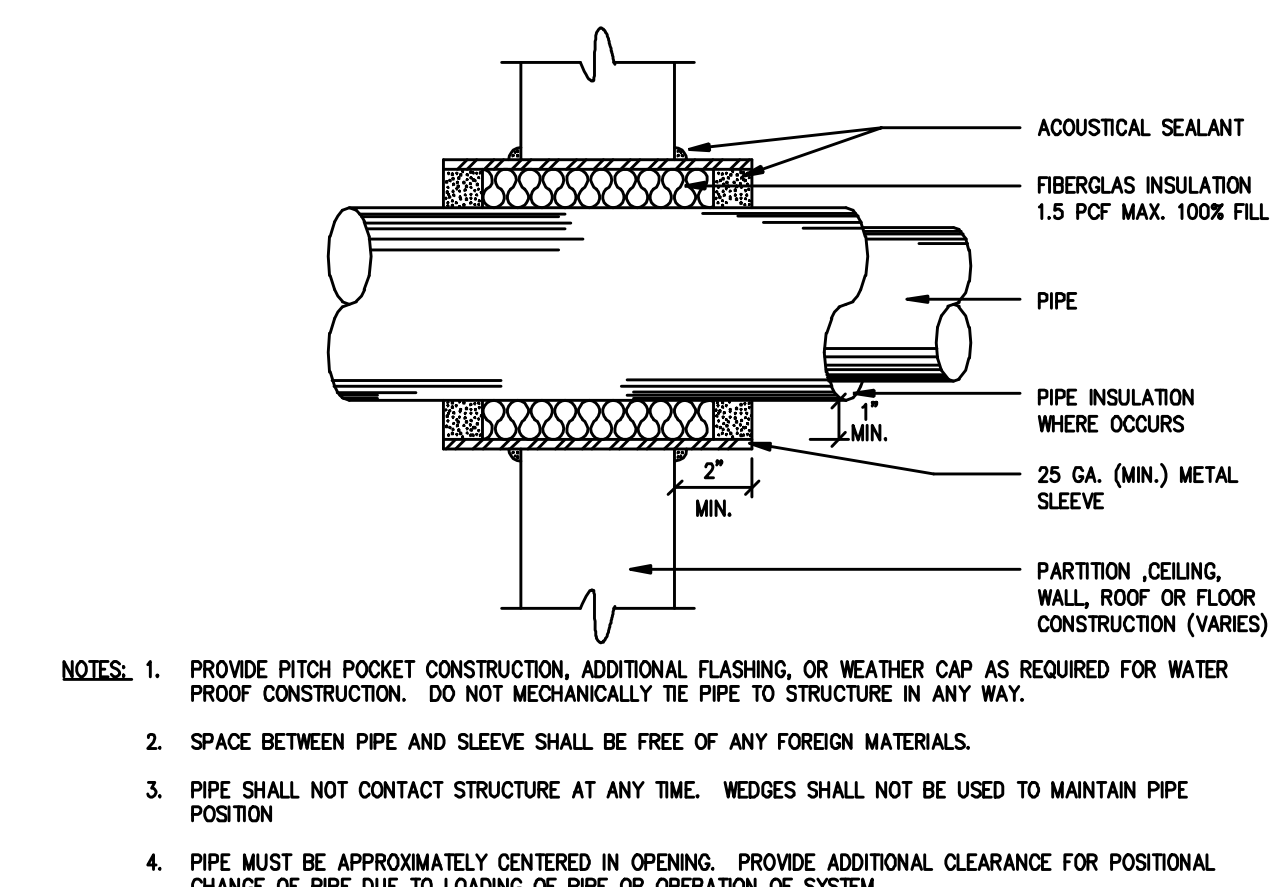


ISOLATED PIPE PENETRATION DETAIL

11

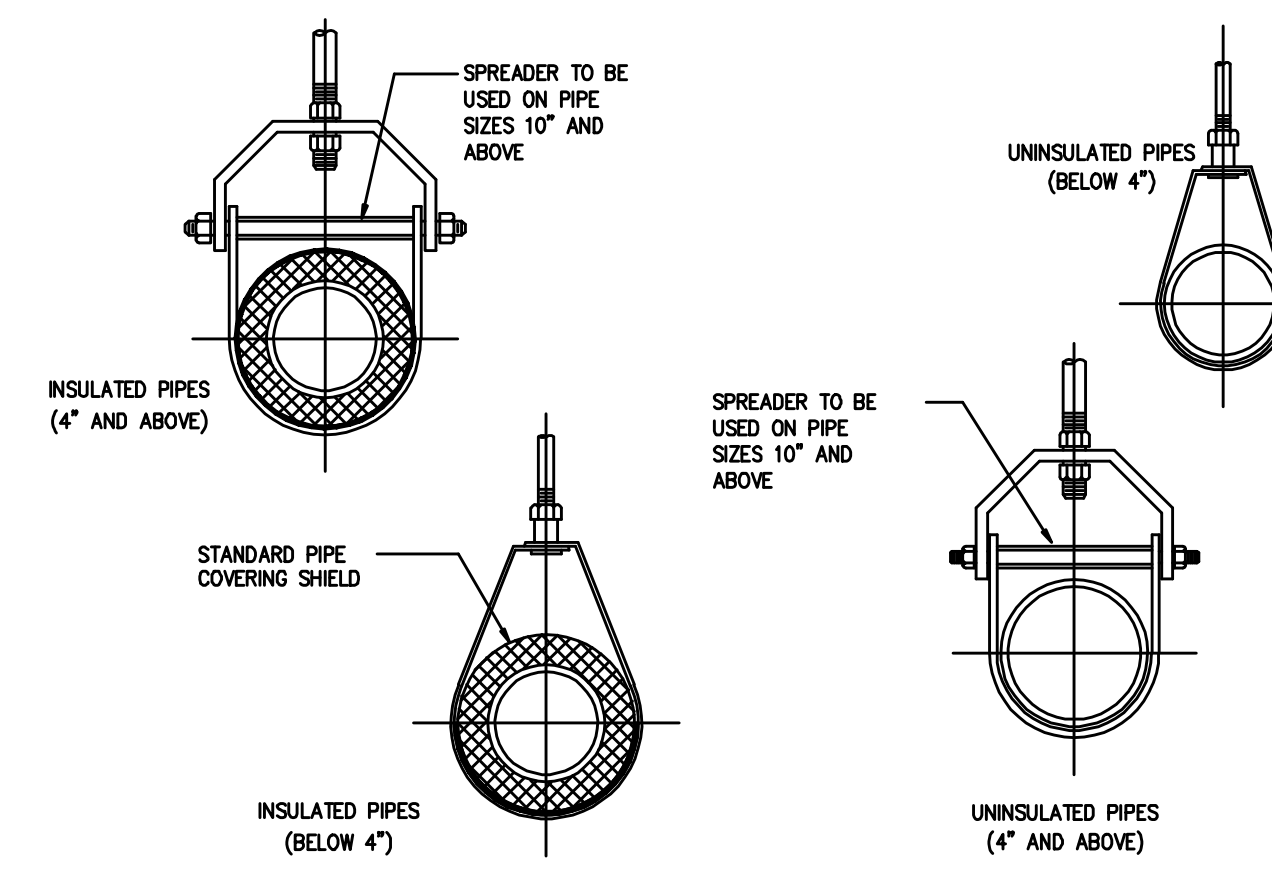


TYPICAL PIPE HANGER DETAIL

6

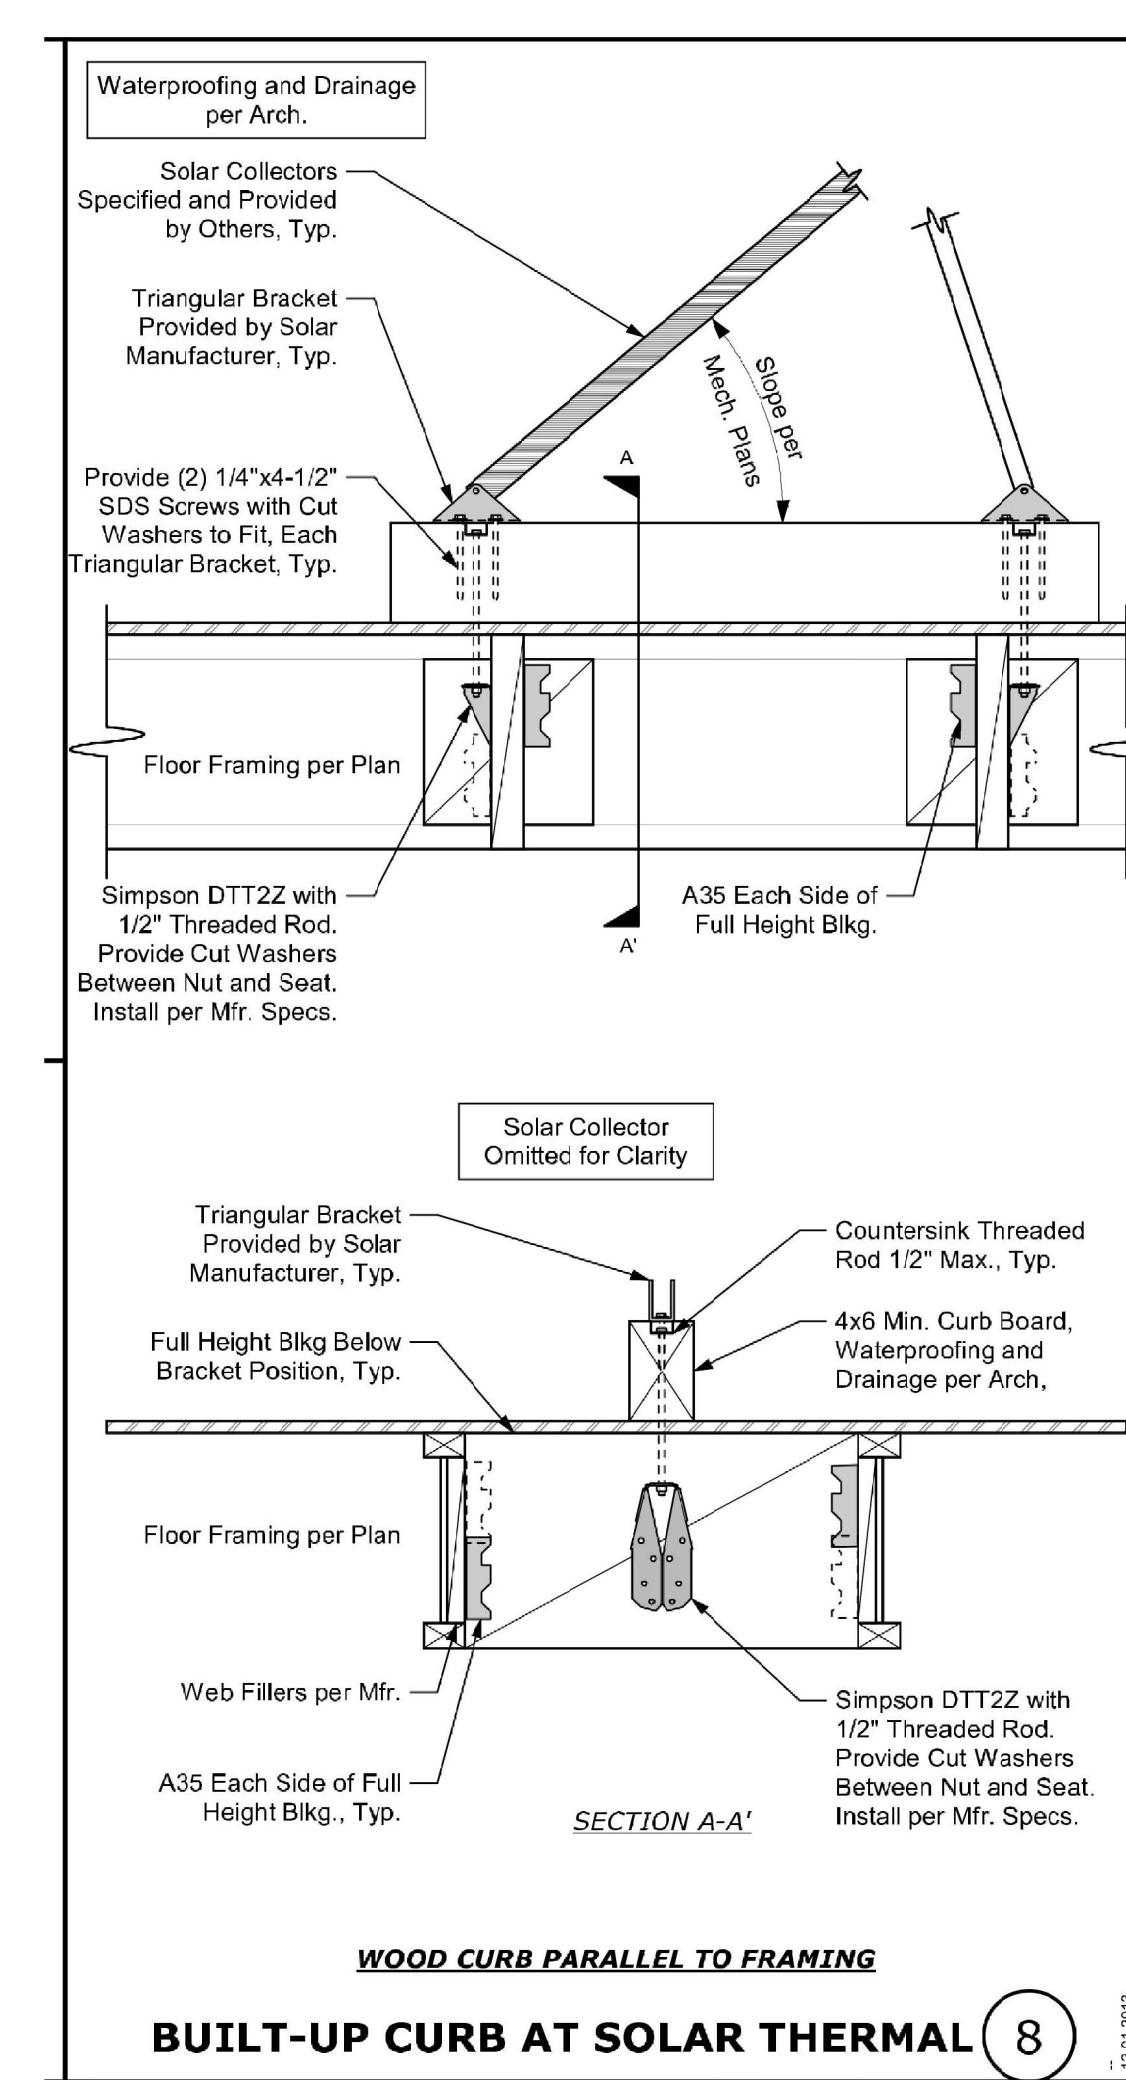


WOOD CURB PARALLEL TO FRAMING BUILT-UP CURB AT SOLAR THERMAL

8

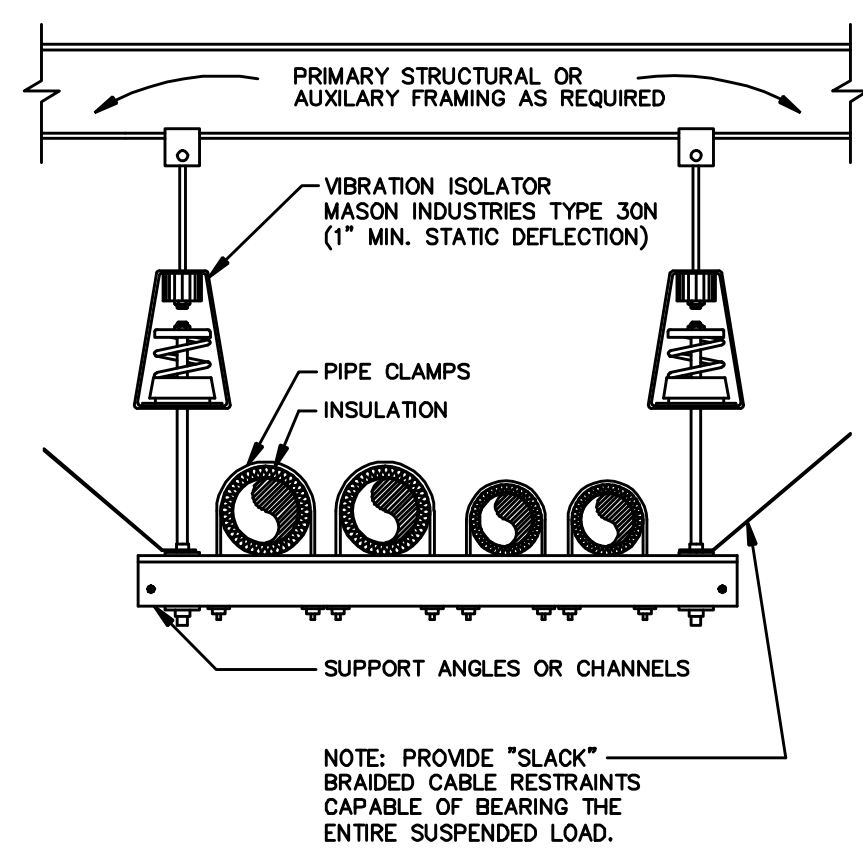


TRAPEZE PIPING OR EQUIPMENT SUPPORT

17

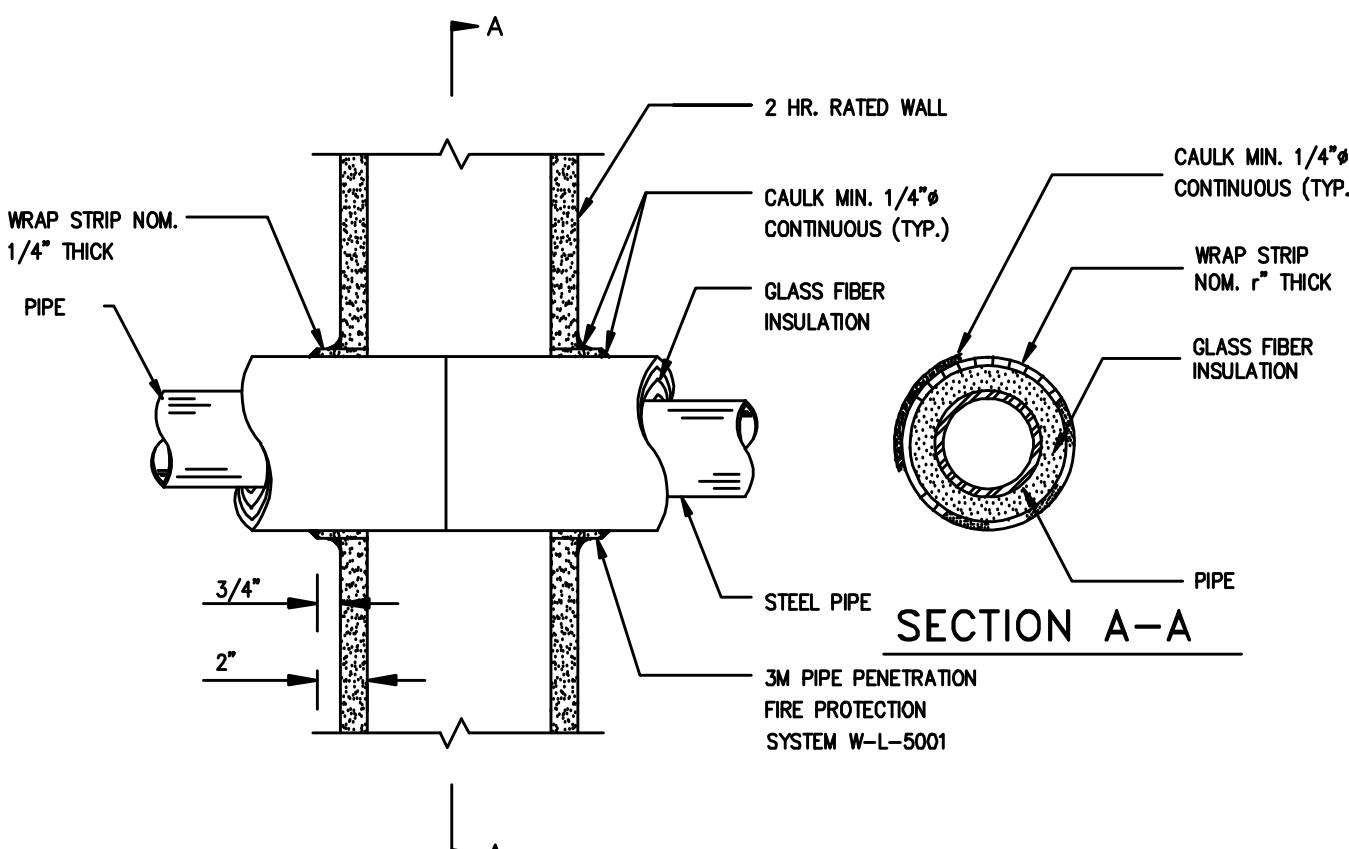


FIRE RATED WALL PIPE PENETRATION

12

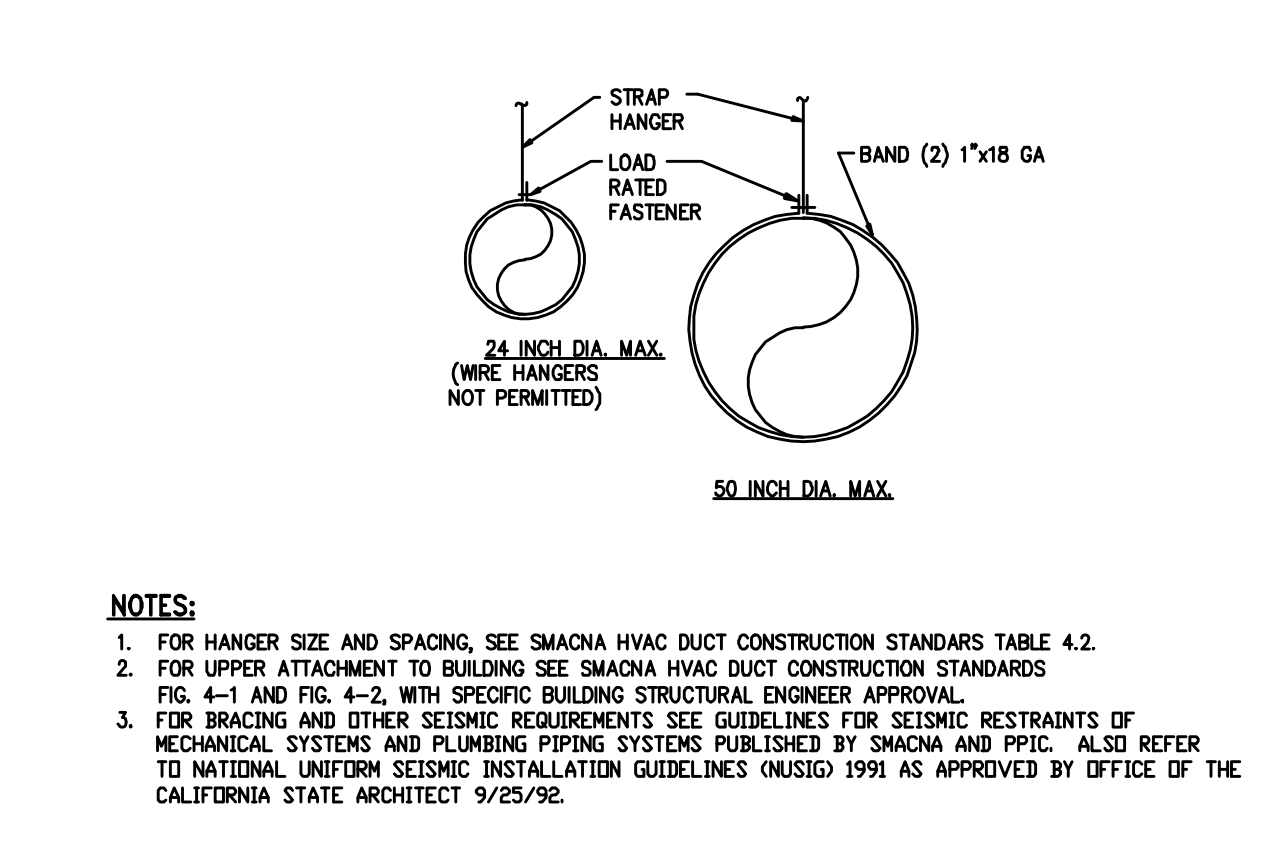


TYPICAL HORIZONTAL ROUND DUCT SUPPORTS

7

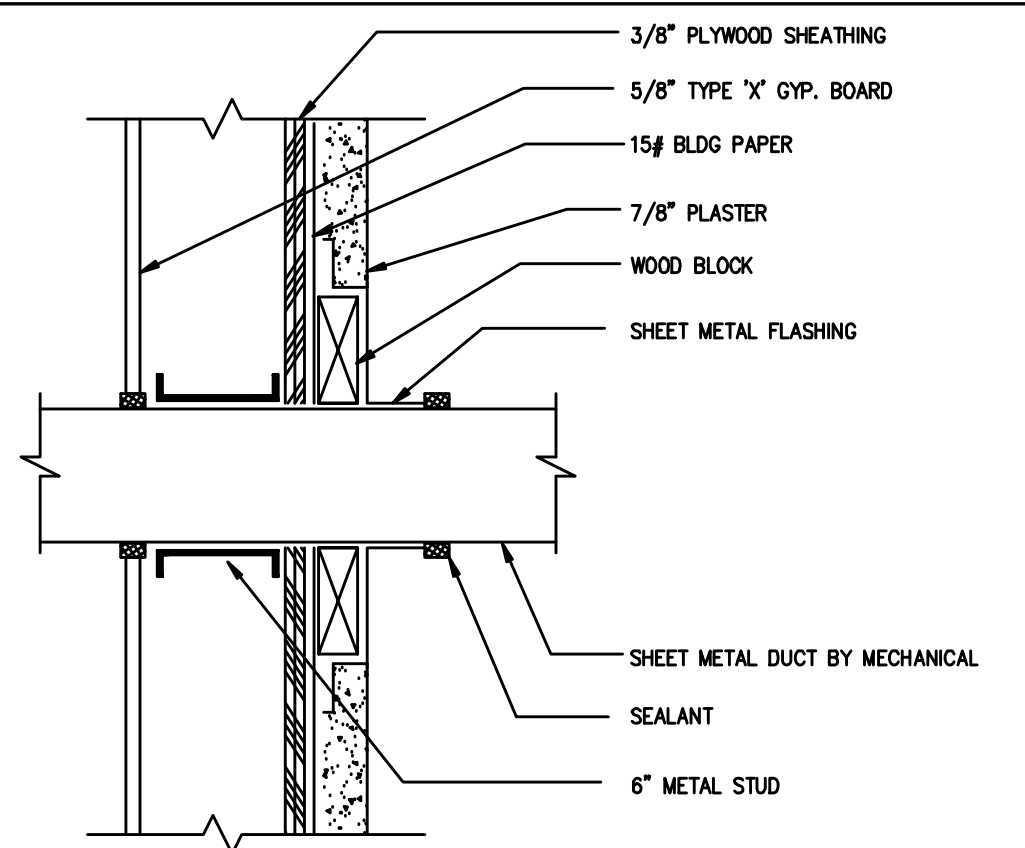


HORIZONTAL DUCT FLASH THROUGH EXTERNAL WALL

9

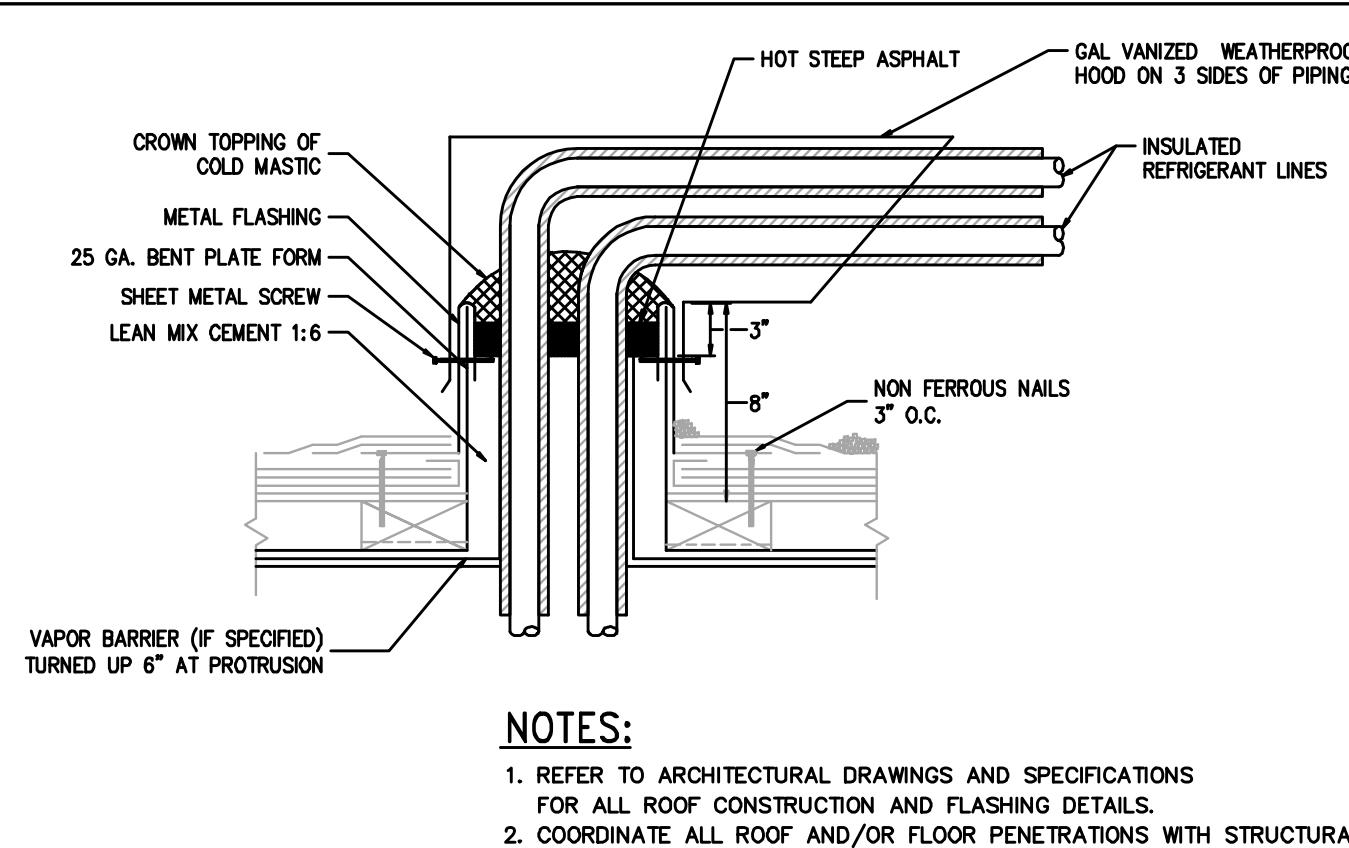


REFRIGERANT LINE ROOF PENETRATION DETAIL

13

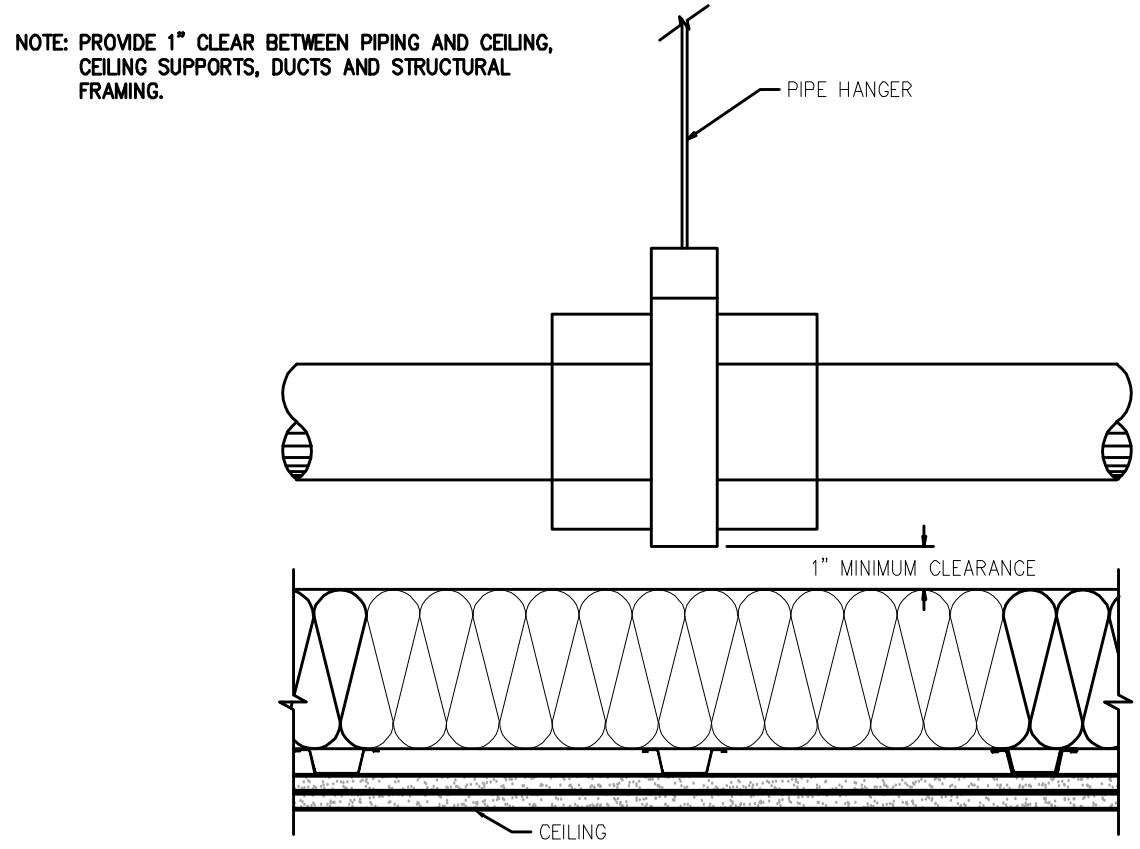

HORIZONTAL PIPE RUN FROM TOP PIPE SUPPORT DETAIL

20

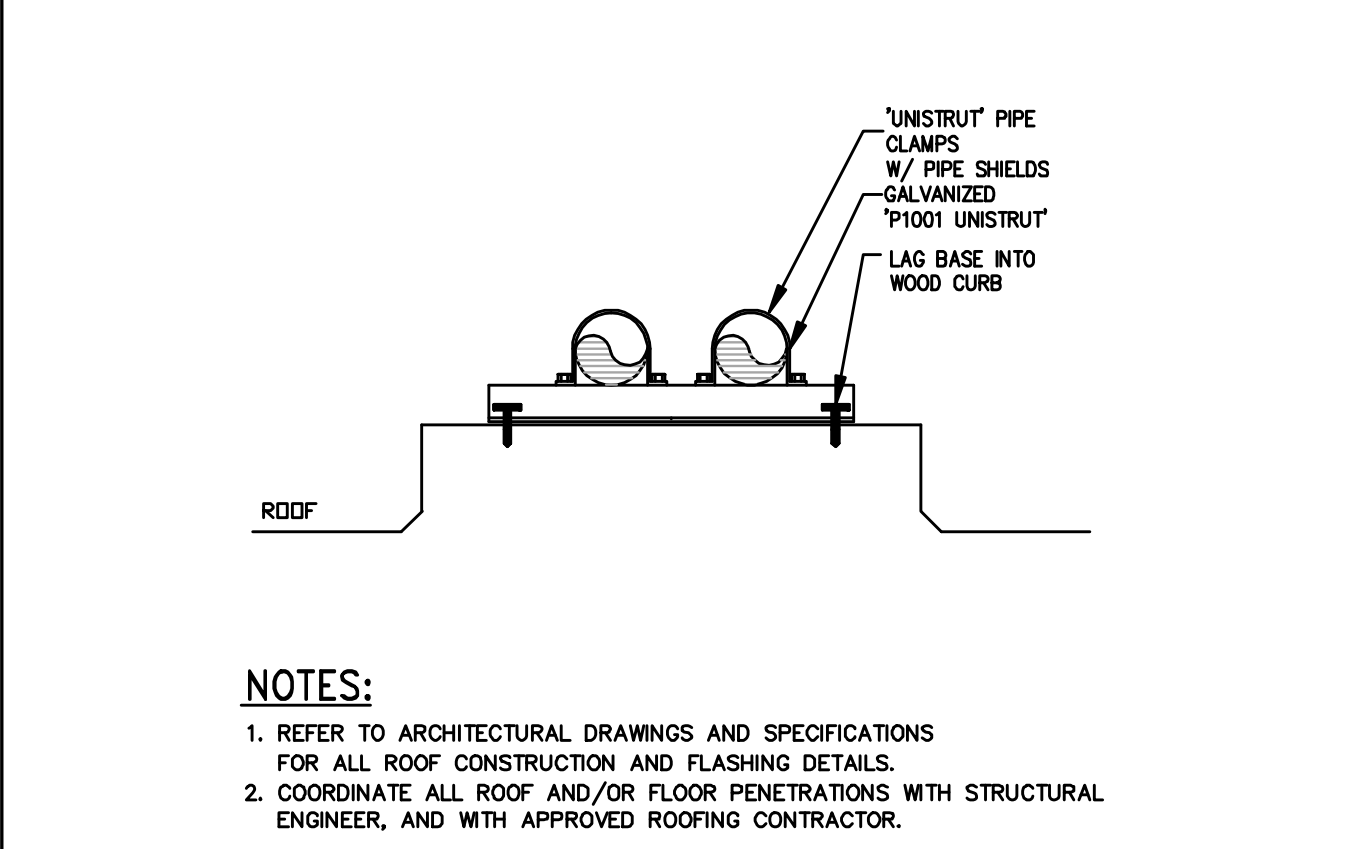

HORIZONTAL PIPE RUN FROM TOP PIPE SUPPORT DETAIL

11


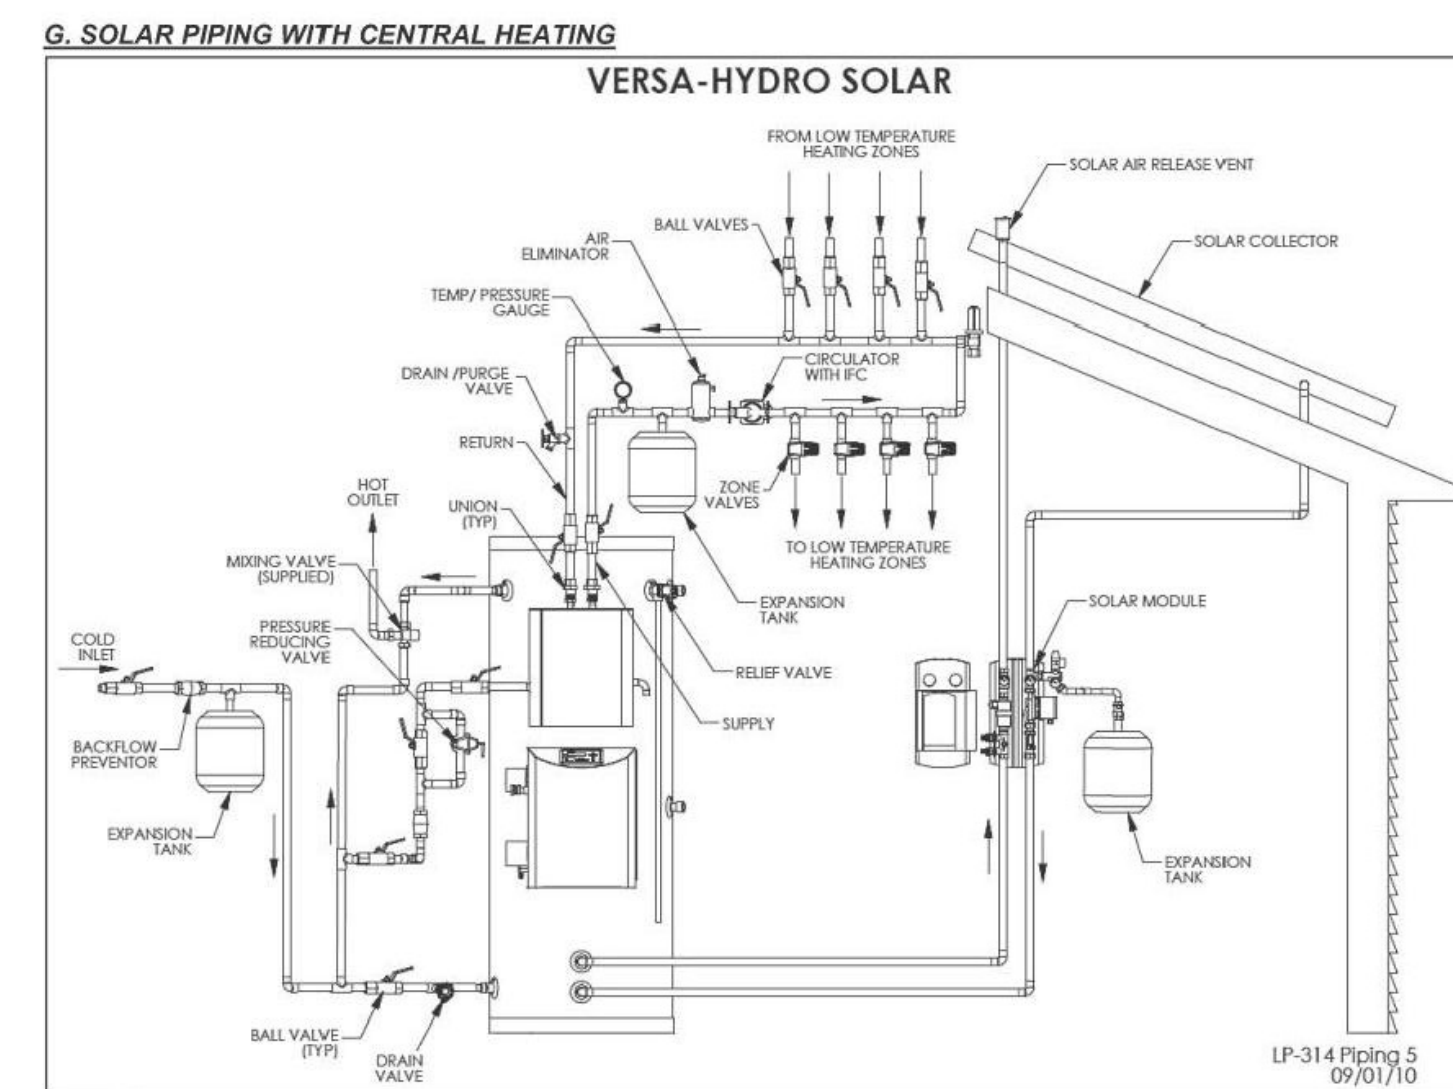


Figure 8
FIGURE NOTES:
1. Minimum pipe size should match connection size on appliance. If you require greater flow, upsize pipe accordingly.
2. A thermal expansion tank suitable for potable water must be sized and installed within the piping system between the check valve and cold water inlet of the appliance.
3. Gas line must be rated to the maximum capacity of the unit. Unit must have 10 feet of pipe after gas regulator.
4. All circulators shall have an integral flow check.
5. An ASSE 1017 mixing valve is required per SRCC OG-300.

SOLAR THERMAL PANEL DETAIL FROM STRUCTURAL PLANS

MACY ARCHITECTURE
315 Linden Street
San Francisco, CA 94102
Tel 415 551 7630
Fax 415 551 7601
www.macyarchitecture.com

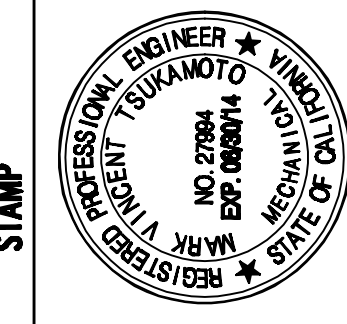


CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T.661.993.3343

PROJECT
SANTA BARBARA CENTER FOR ART, SCIENCE & TECHNOLOGY
513 GARDEN STREET
SANTA BARBARA, CA 93101

SHEET TITLE	DATE	PHASE	SCALE	FULL SIZE
MECHANICAL DETAILS	04/10/14	ISSUE FOR BID	NONE	

SHEET
M3.0

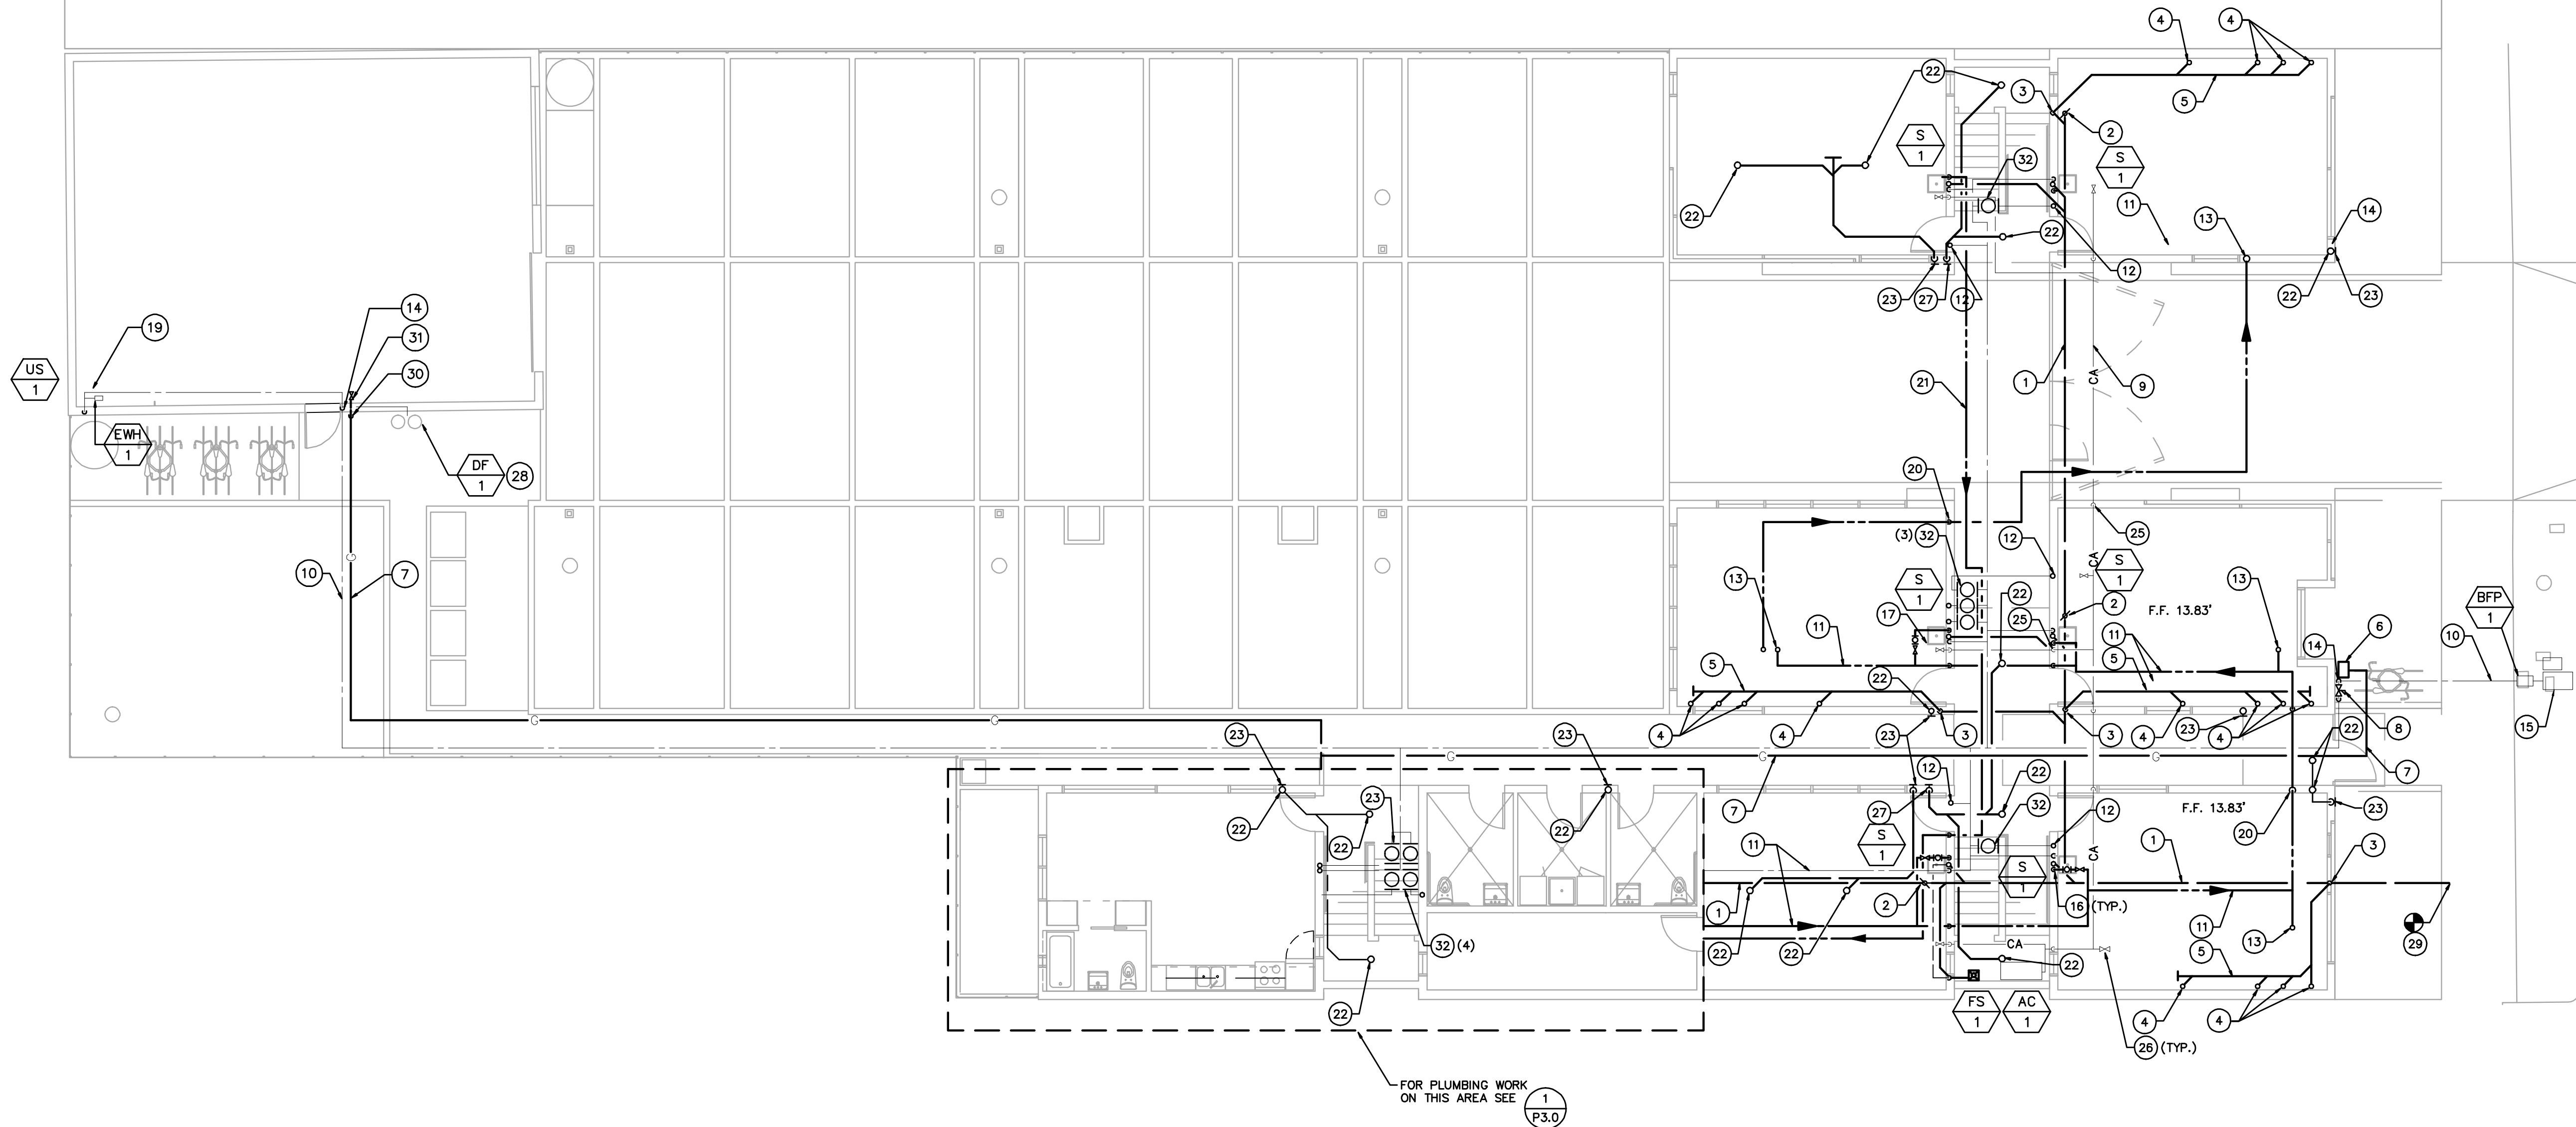


1 SITE / FIRST FLOOR PLUMBING PLAN
 1/8" = 1'-0"

KEY NOTES

- ① WASTE LINE RUN BELOW FLOOR/PAVING.
- ② WCO/FCO - SEE DETAIL
- ③ WASTE LINE DOWN TO BELOW FLOOR.
- ④ WASTE LINE DOWN FROM FLOOR ABOVE.
- ⑤ WASTE LINE RUN ABOVE CEILING.
- ⑥ PROPOSED GAS METER LOCATION
- ⑦ GAS LINE RUN BELOW FLOOR/PAVING.
- ⑧ WATER PRESSURE REGULATOR
- ⑨ COMPRESSED AIR LINE RUN BELOW FLOOR/PAVING.
- ⑩ COLD WATER LINE RUN BELOW FLOOR/PAVING.
- ⑪ COLD/HOT WATER LINE RUN ABOVE CEILING.
- ⑫ COLD WATER LINE UP TO SECOND FLOOR.
- ⑬ HOT WATER LINE UP TO SECOND FLOOR.
- ⑭ COLD WATER UP FROM BELOW FLOOR.
- ⑮ NEW 1-1/2" DOMESTIC WATER METER IN CONCRETE BOX.
- ⑯ VENT LINE UP TO SECOND FLOOR.
- ⑰ HOT WATER SUBMETER WITH SOV BEHIND ACCESS PANEL
- ⑱ HOT WATER RETURN DN FROM SECOND FLOOR
- ⑲ CONNECT NEW 2"WASTE AND 1-1/2"V LINES TO EXISTING WASTE
- ⑳ HOT WATER DN TO BELOW FLOOR
- ㉑ HOT WATER RETURN RUN BELOW FLOOR
- ㉒ 3" SD/OSD LINE DN FROM SECOND FLOOR
- ㉓ 3" SD LINE SPILL @ FLOOR. TERMINATE WITH DOWNSPOUT NOZZLE. MANUF. WATTS MODEL RD-940
- ㉔ COMPRESSED AIR LINE RUN ABOVE CEILING
- ㉕ COMPRESSED AIR LINE DN TO BELOW FLOOR
- ㉖ COMPRESSED AIR LINE WITH QUICK DISCONNECT NIPPLE
- ㉗ 3" OSD LINE SPILL @ FLOOR. TERMINATE WITH DOWNSPOUT NOZZLE. MANUF. WATTS MODEL RD-940
- ㉘ CONNECT NEW 2"WASTE AND 1-1/2"V LINES TO EXISTING WASTE. EXTEND LINE AS NECESSARY.
- ㉙ UPSTREAM MANHOLE I.E.= 12.56'
- ㉚ GAS UP FROM BELOW FLOOR
- ㉛ STUB OUT WITH SOV FOR FUTURE
- ㉜ 5/8" WATER SUBMETER. INSTALL BY CITY OF SANTA BARBARA REQUIREMENTS. FURNISHED BY THE CITY INSTALLED BY PLUMBER CONTRACTOR. SEE ARCHITECT DRAWINGS FOR DETAIL.

315 Linden Street
 San Francisco, CA 94102
 Tel 415 551 7630
 Fax 415 551 7601
 www.macyarchitecture.com

M A C H A R C H I T E C T U R E

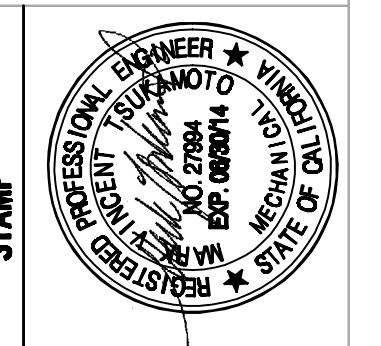


CONSULTANTS
 Dozal & Assoc.
 26123 Singer Pl.
 Stevenson Ranch, CA
 91381
 T.661.993.3343

PROJECT
 SANTA BARBARA CENTER FOR
 ART, SCIENCE & TECHNOLOGY
 515 GARDEN STREET
 SANTA BARBARA, CA 93101

ISSUES / REVISIONS

SHEET TITLE	SITE / FIRST FLOOR PLUMBING PLAN
DATE	04/10/14
PHASE	ISSUE FOR BID
SCALE	FULL SIZE

SHEET P2.1

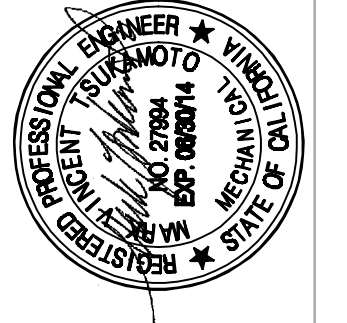

CONSULTANTS
 Dozal & Assoc.
 26123 Singer Pl.
 Stevenson Ranch, CA
 91381
 T.661.993.3343


PROJECT
**SANTA BARBARA CENTER FOR
 ART, SCIENCE & TECHNOLOGY**
 515 GARDEN STREET
 SANTA BARBARA, CA 93101

ISSUES / REVISIONS

SHEET TITLE
 SECOND FLOOR
 PLUMBING PLAN


DATE 04/10/14
PHASE ISSUE FOR BID
SCALE 1/8" = 1'-0" **FULL SIZE**

SHEET P2.2

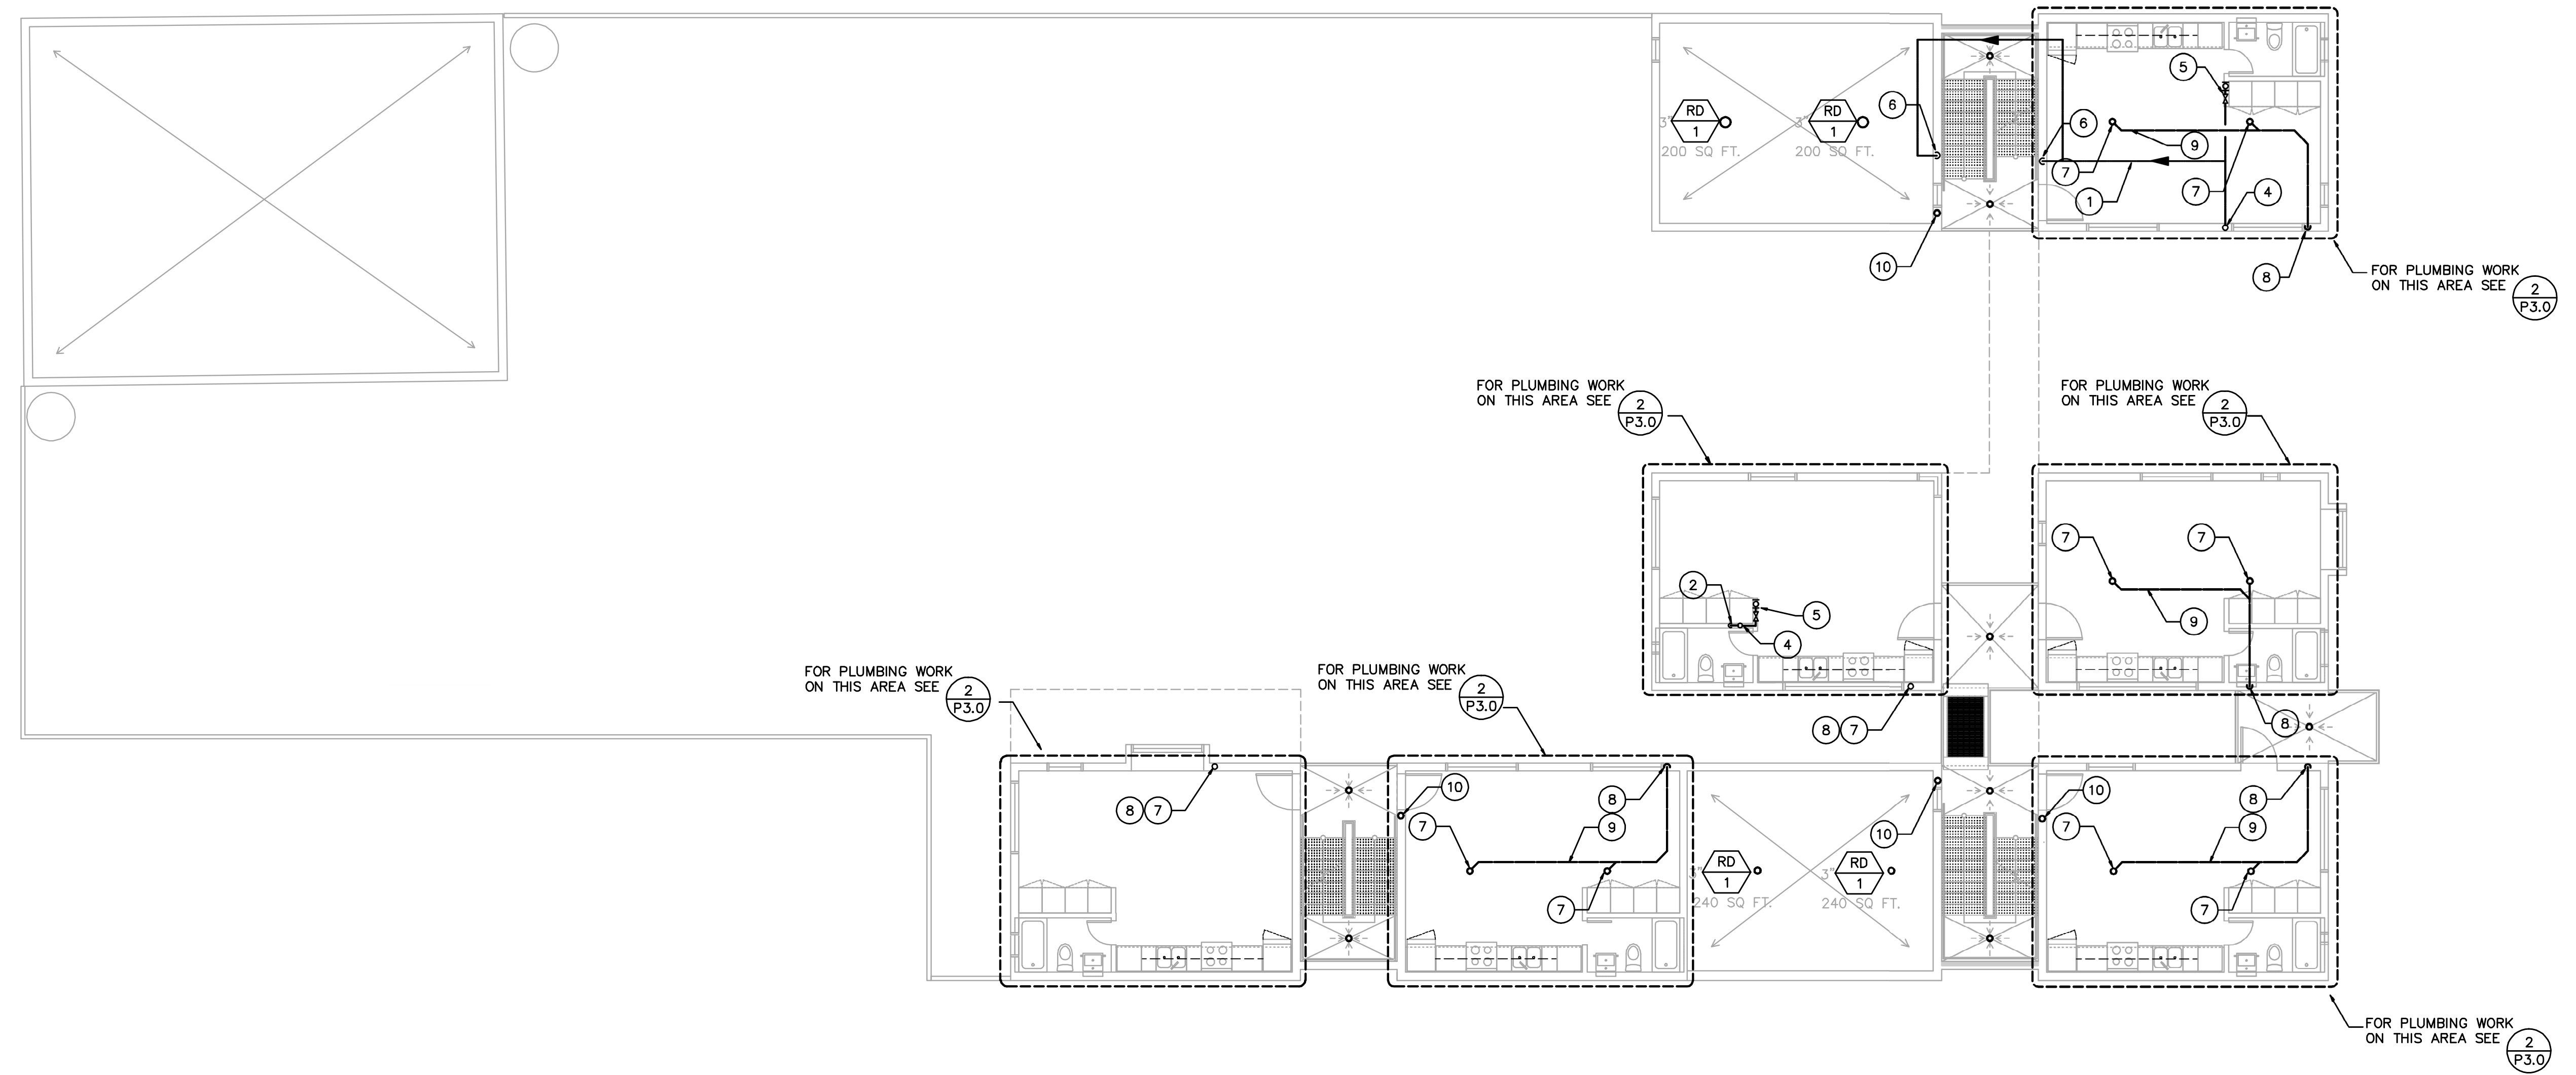

- KEY NOTES**
- ① HOT WATER LINE RUN ABOVE CEILING.
 - ② HOT WATER LINE UP TO THIRD FLOOR.
 - ③ HOT WATER LINE DN TO FIRST FLOOR.
 - ④ HOT WATER UP FROM FIRST FLOOR.
 - ⑤ HOT WATER SUBMETER BEHIND ACCESS PANEL
 - ⑥ HOT WATER LINE DN TO FIRST FLOOR. COONECT TO WORKSHOP SINK
 - ⑦ 3"SD DN FROM ROOF
 - ⑧ 3"SD DN TO FIRST FLOOR
 - ⑨ 3"SD DN RUN ABOVE CEILING.
 - ⑩ COLD WATER RISER


① SECOND FLOOR PLUMBING PLAN
 1/8" = 1'-0"

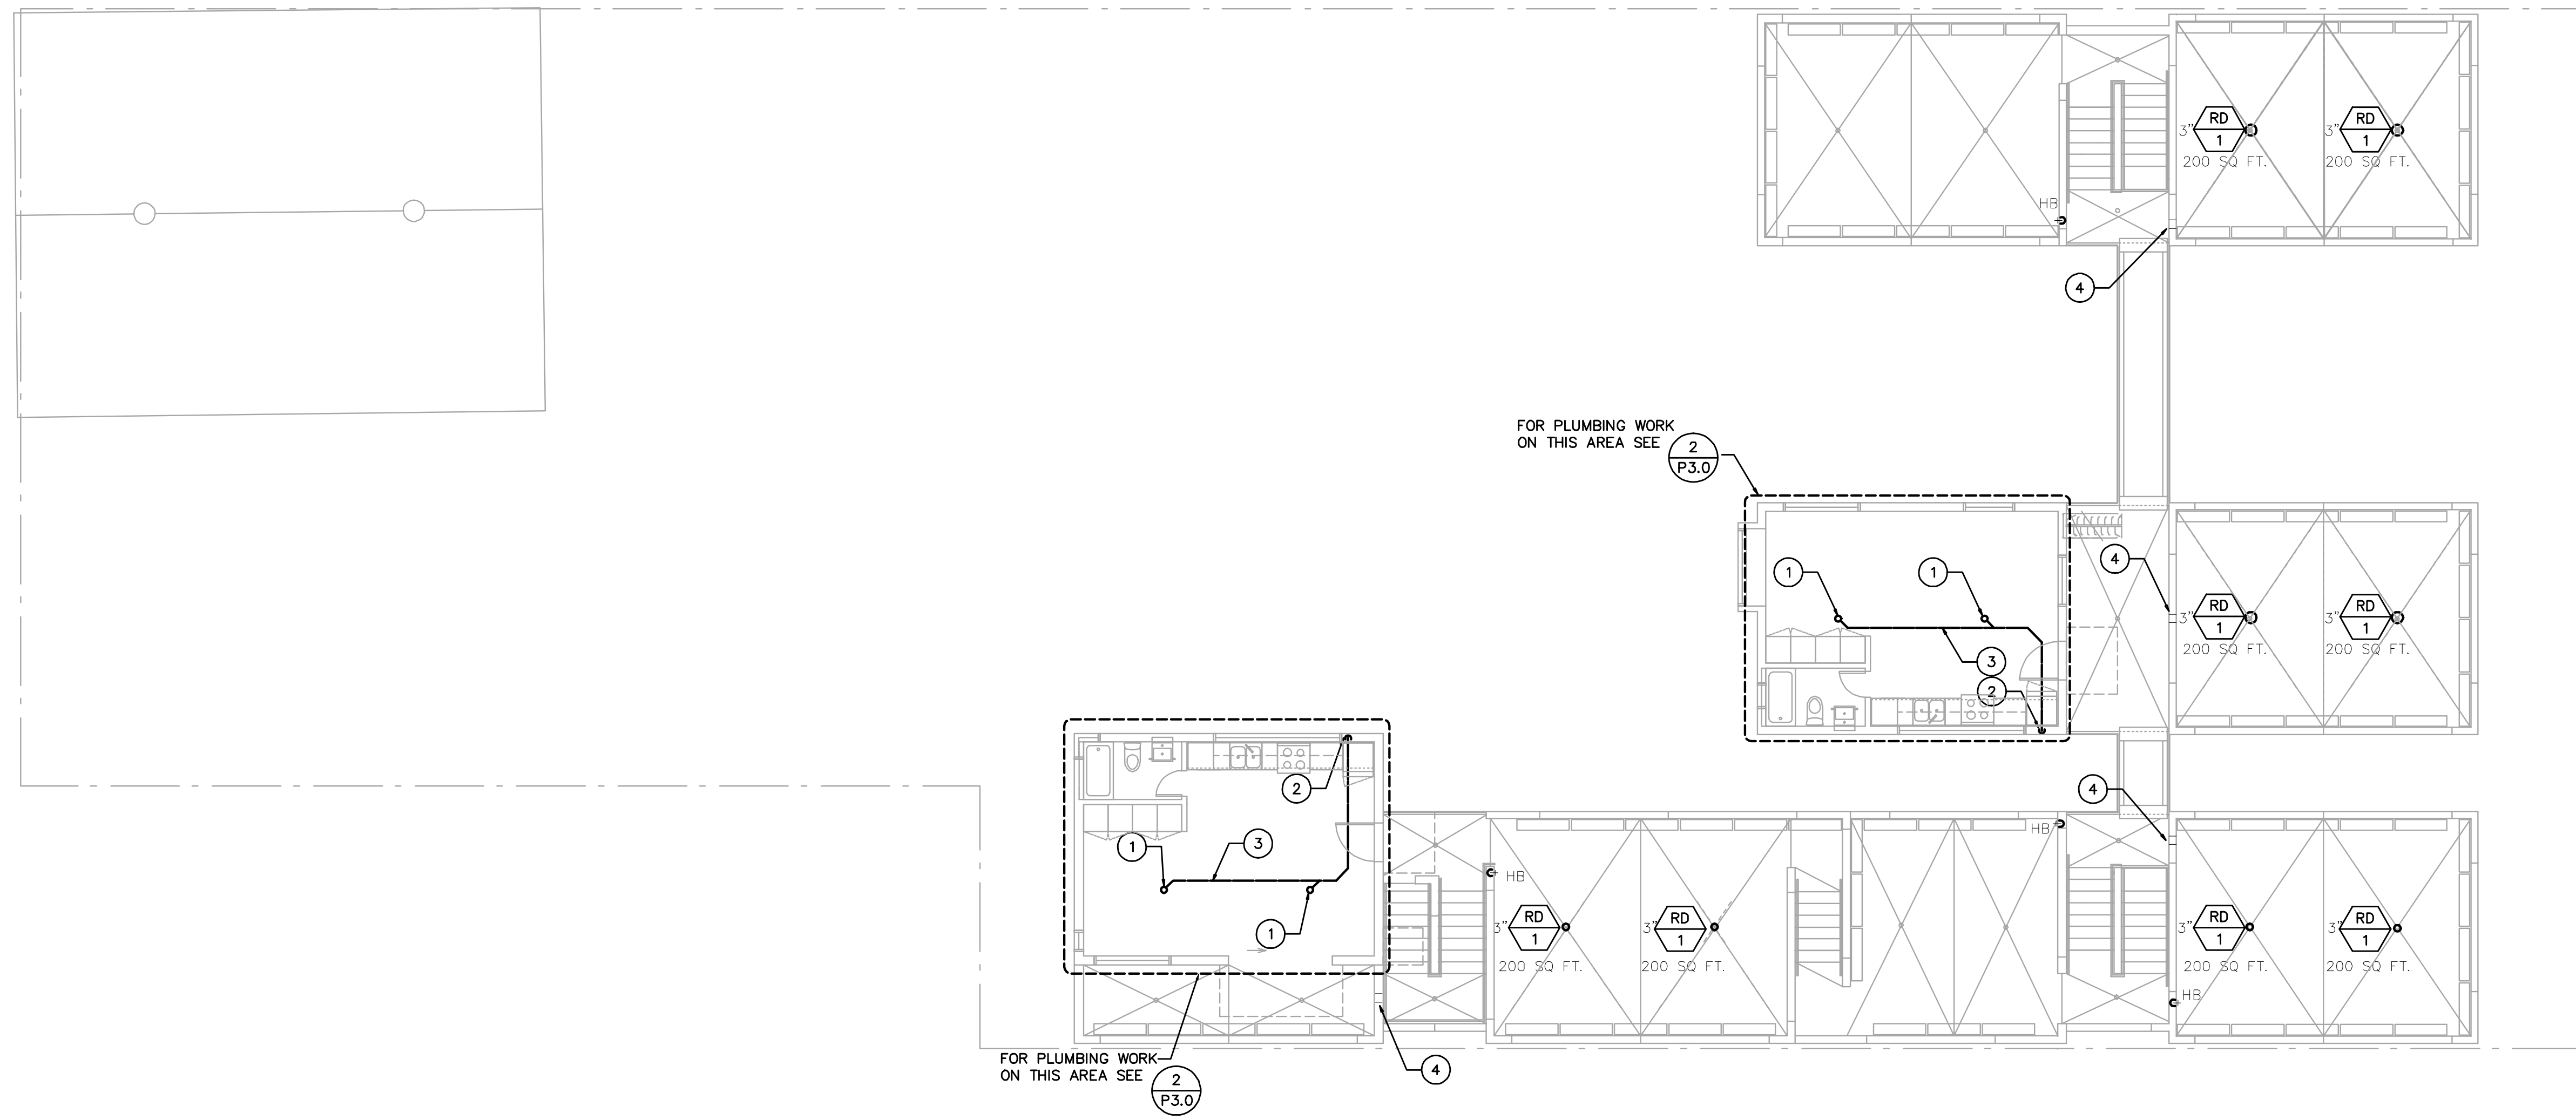

① THIRD FLOOR PLUMBING PLAN
 1/8" = 1'-0"

315 Linden Street
 San Francisco, CA 94102
 Tel 415 551 7630
 Fax 415 551 7601
 www.macyarchitecture.com

M A C H G E
 A R C H I T E C T U R E

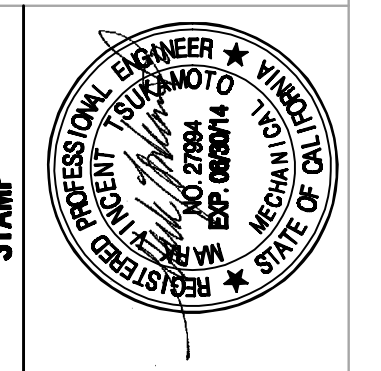

CONSULTANTS
 Dozal & Assoc.
 26123 Singer Pl.
 Stevenson Ranch, CA
 91381
 T.661.993.3343


PROJECT
 SANTA BARBARA CENTER FOR
 ART, SCIENCE & TECHNOLOGY
 515 GARDEN STREET
 SANTA BARBARA, CA 93101

ISSUES / REVISIONS
 REV1 06-12-13

SHEET TITLE
 THIRD FLOOR
 PLUMBING PLAN

DATE 04/10/14
 PHASE ISSUE FOR BID
 SCALE 1/8" = 1'-0" FULL SIZE

SHEET P2.3

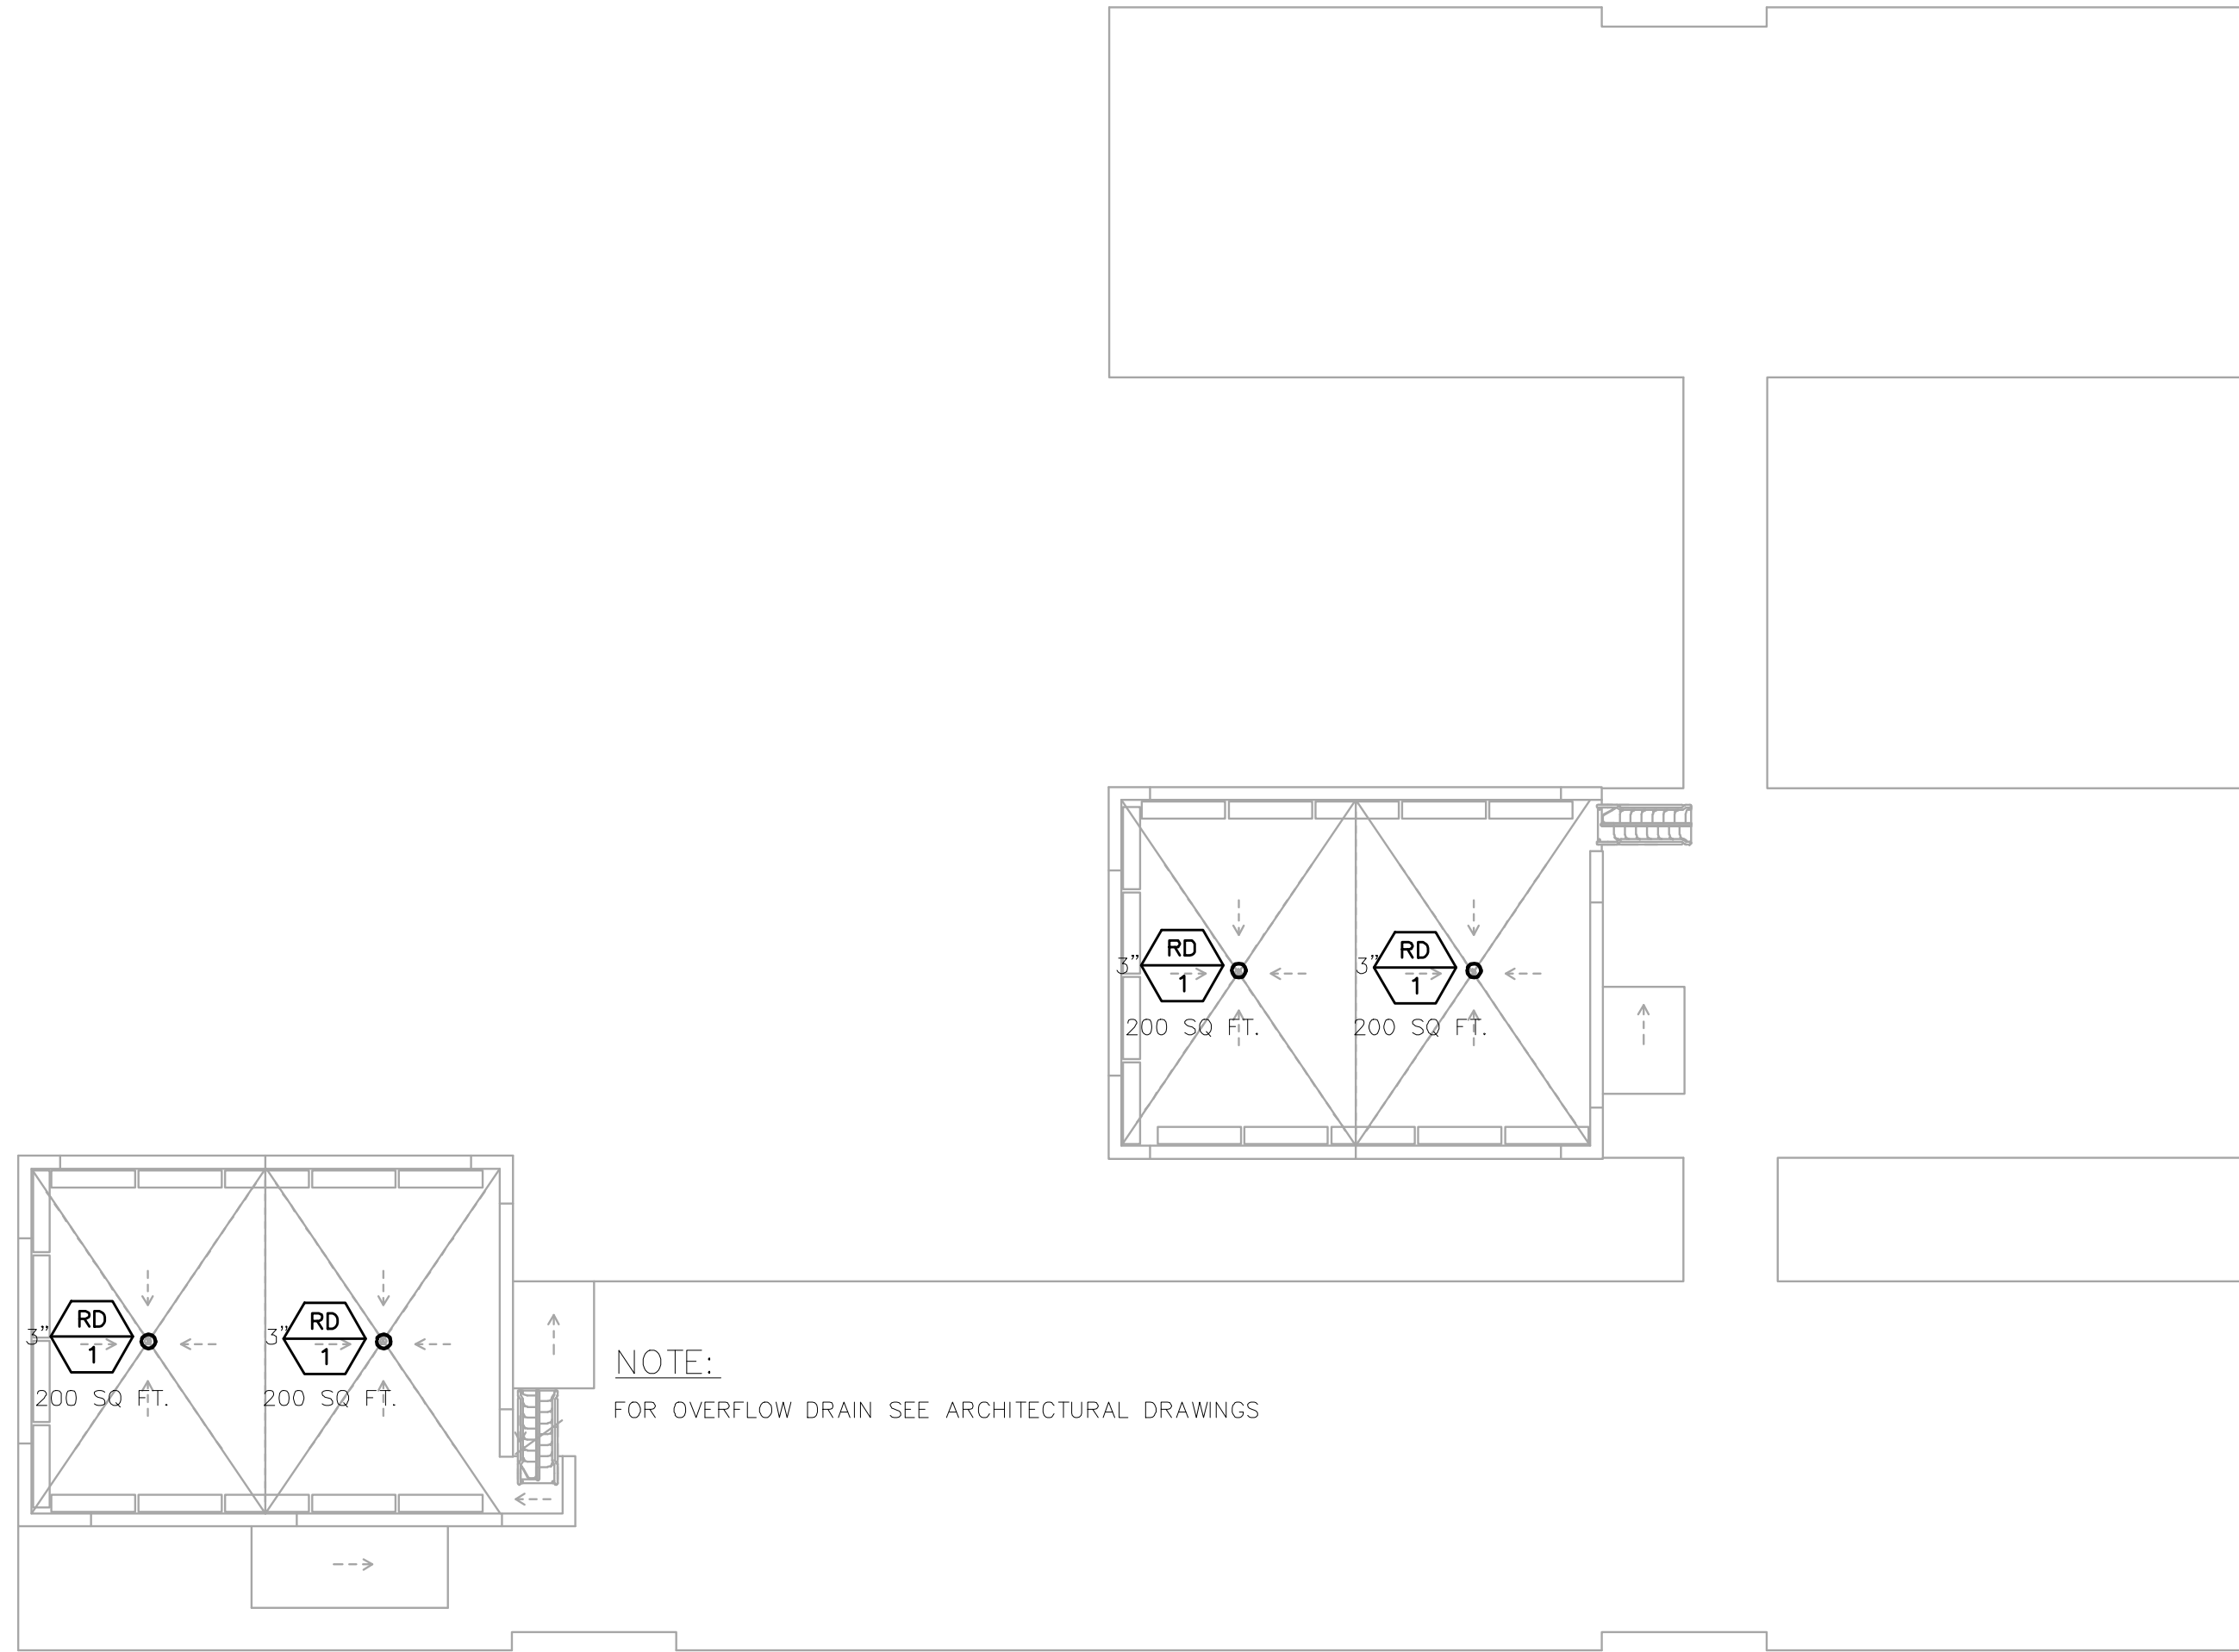

1 PLUMBING ROOF PLAN
1/8" = 1'-0"

315 Linden Street
San Francisco, CA 94102
Tel 415 551 7630
Fax 415 551 7601
www.macyarchitecture.com

M A C H
A R C H
I T U R E



CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T.661.993.3343


PROJECT
SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNOLOGY
515 GARDEN STREET
SANTA BARBARA, CA 93101

ISSUES / REVISIONS
REV 1 06-12-13


SHEET TITLE
PLUMBING ROOF PLAN

DATE 04/10/13
PHASE ISSUE FOR BID
SCALE FULL SIZE

SHEET P2.4

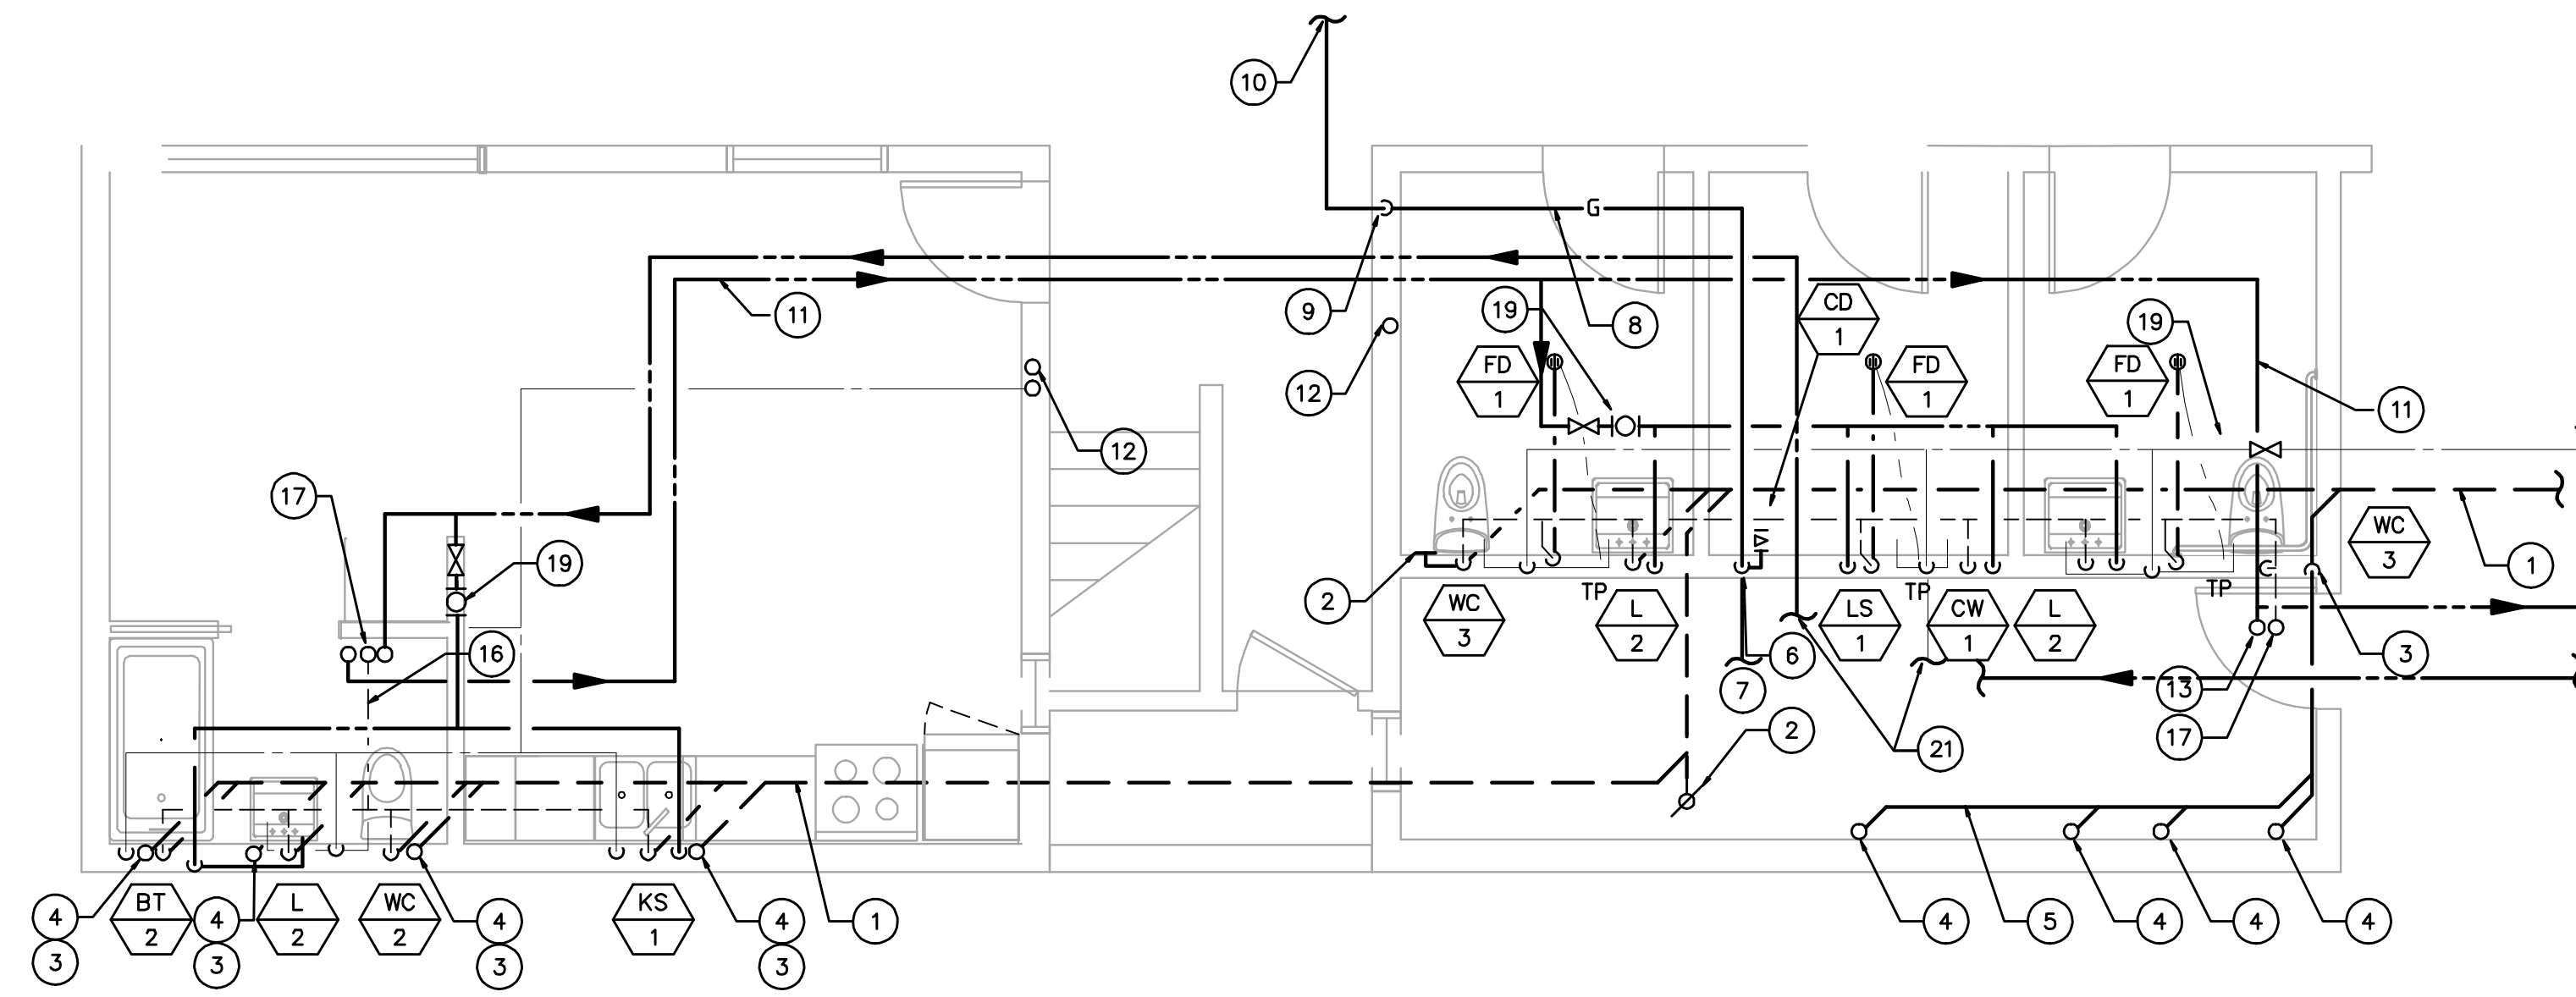


1 ENLARGED ACCESSIBLE DWELLING UNIT,
LAUNDRY AND RESTROOMS PLUMBING PLANS
1/4" = 1'-0"

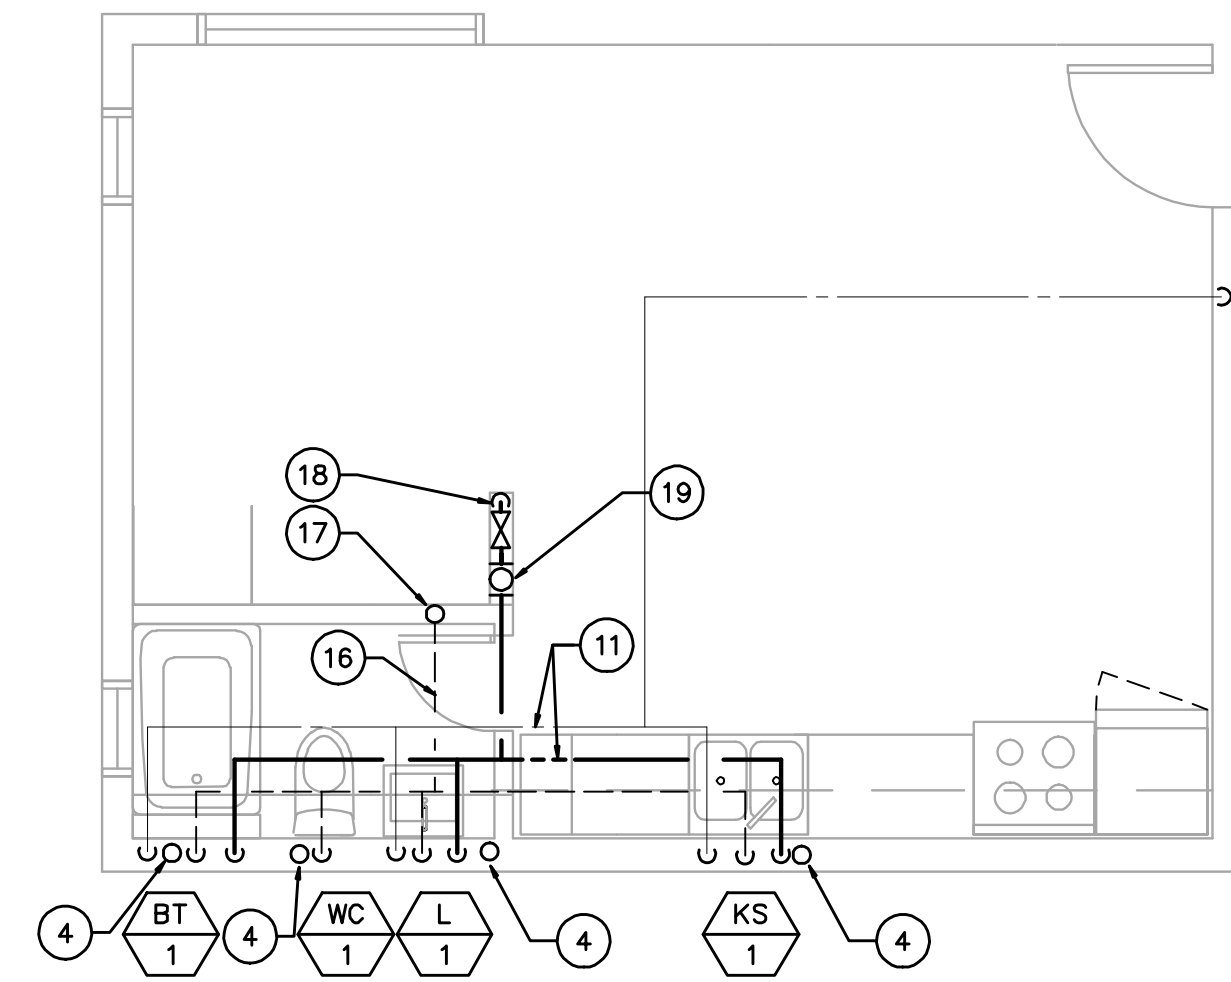

2 ENLARGED TYPICAL DWELLING UNIT PLUMBING PLAN
1/4" = 1'-0"

KEY NOTES

- 1 WASTE LINE RUN BELOW FLOOR.
- 2 WCO/FCO - SEE DETAIL
- 3 WASTE LINE DOWN TO BELOW FLOOR.
- 4 WASTE LINE DOWN FROM FLOOR ABOVE.
- 5 WASTE LINE RUN ABOVE CEILING.
- 6 CONNECT G W/SOC TO CLOTH DRYER (70 CFH).
- 7 CONNECT G W/SOC TO WATER HEATER (199 CFH) SEE MECHANICAL DRAWINGS FOR EXACT LOCATION
- 8 GAS LINE RUN IN ABOVE CEILING.
- 9 G LINE DOWN TO BELOW FLOOR.
- 10 FOR G LINE CONTINUATION, SEE SITE PLAN P2.1
- 11 COLD/HOT WATER LINE RUN ABOVE CEILING.
- 12 COLD WATER LINE UP TO SECOND FLOOR.
- 13 HOT WATER LINE UP TO SECOND FLOOR.
- 14 COLD WATER DOWN TO BELOW FLOOR.
- 15 FOR WATER LINE CONT. SEE SITE PLAN P2.1.
- 16 VENT LINE RUN ABOVE CEILING.
- 17 VENT LINE UP TO SECOND FLOOR.
- 18 COLD/HOT WATER LINE UP FROM FLOOR BELOW
- 19 HOT WATER SUBMETER WITH SOV BEHIND ACCESS PANEL
- 20 3/4" HWR UP TO SECOND FLOOR.
- 21 COLD AND HOT WATER LINE FROM WATER HEATER. SEE MECHANICAL DRAWINGS FOR EXACT LOCATION.
- 22 HOT WATER LINE DN FROM SECOND FLOOR.

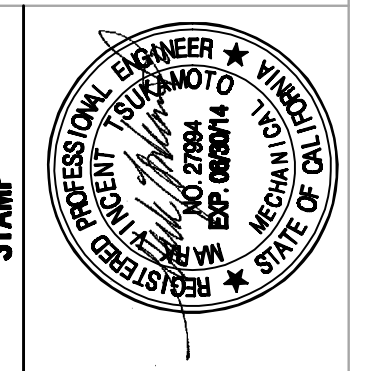

CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T.661.993.3343


PROJECT
SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNOLOGY
515 GARDEN STREET
SANTA BARBARA, CA 93101

ISSUES / REVISIONS

DATE	PHASE	SCALE	FULL SIZE
04/10/14	ISSUE FOR BID	1/8" = 1'-0"	FULL SIZE


SHEET TITLE
ENLARGED PLUMBING
PLANS

SHEET
P3.0

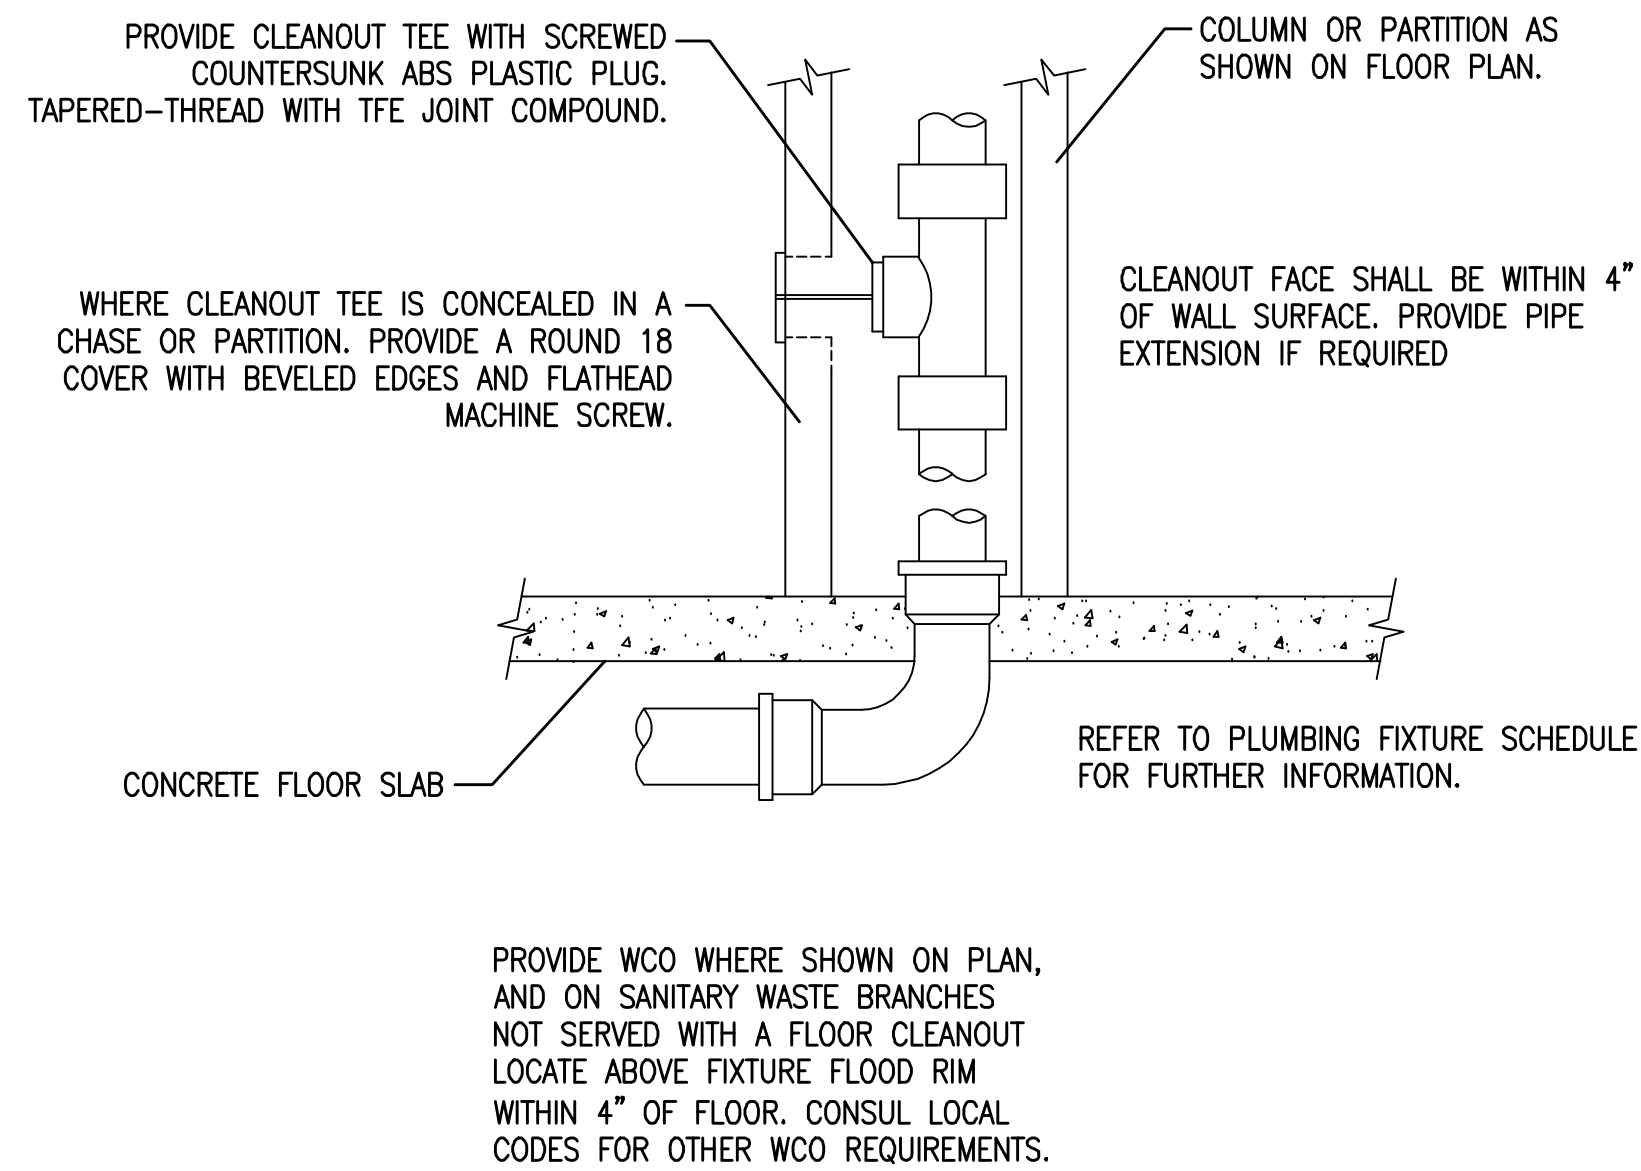


WALL CLEANOUT DETAIL

SCALE: NONE 1

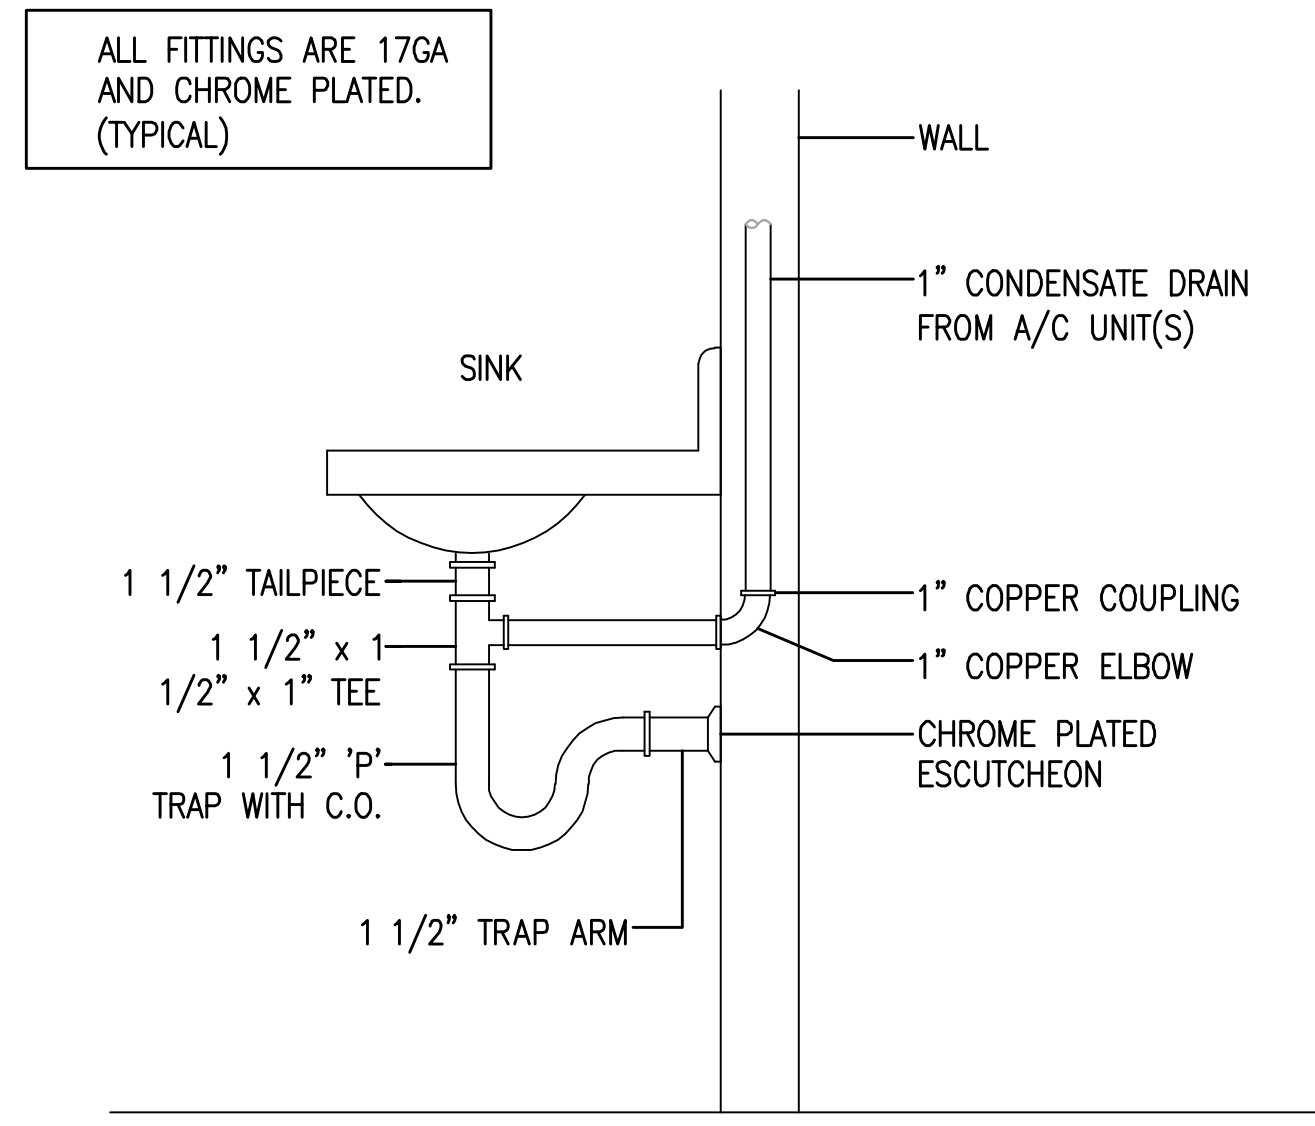


SINK TAILPIECE DETAIL

SCALE: NONE 2

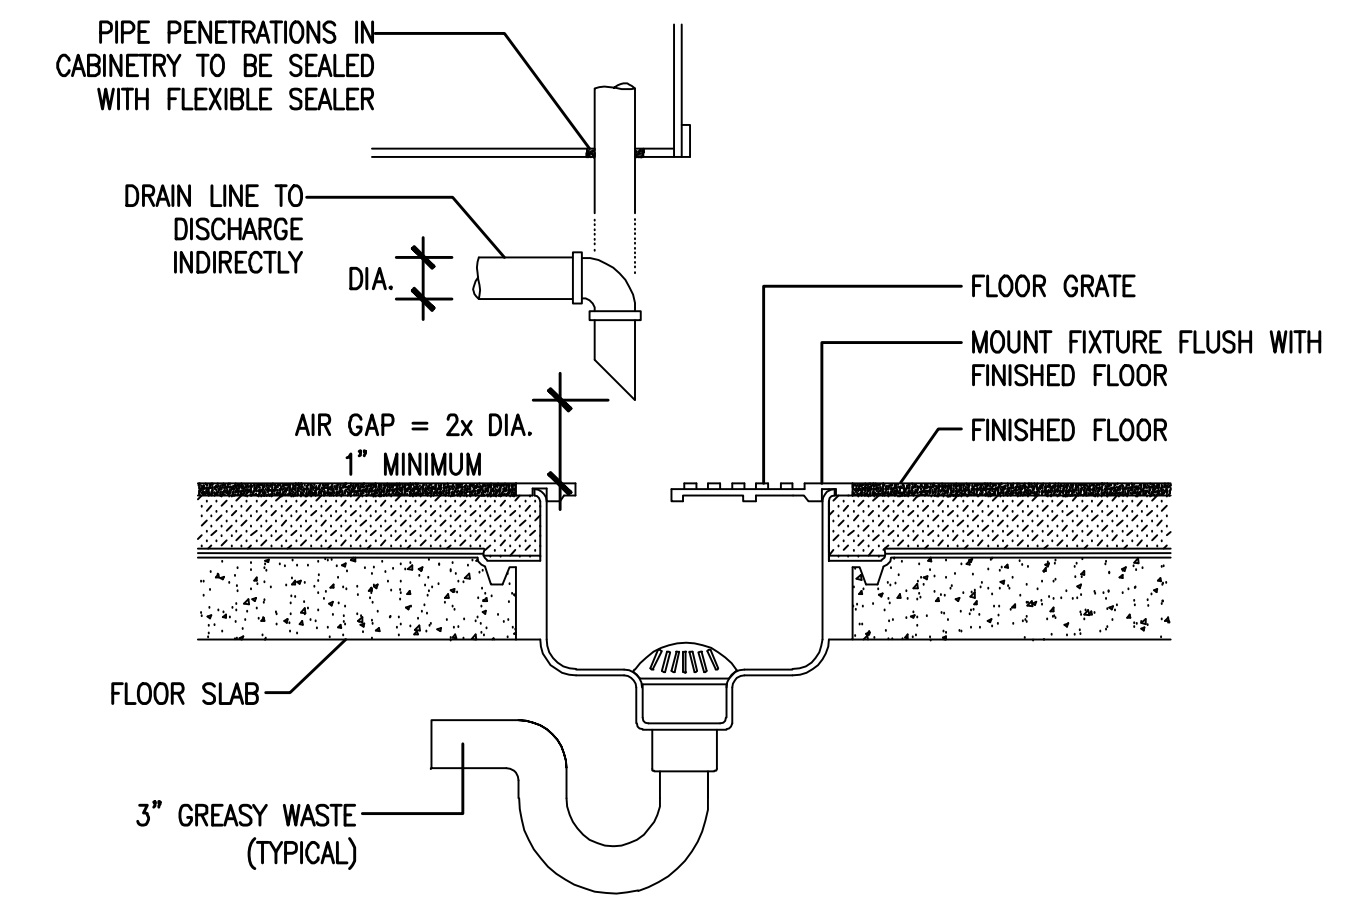


FLOOR SINK DETAIL

SCALE: NONE 3

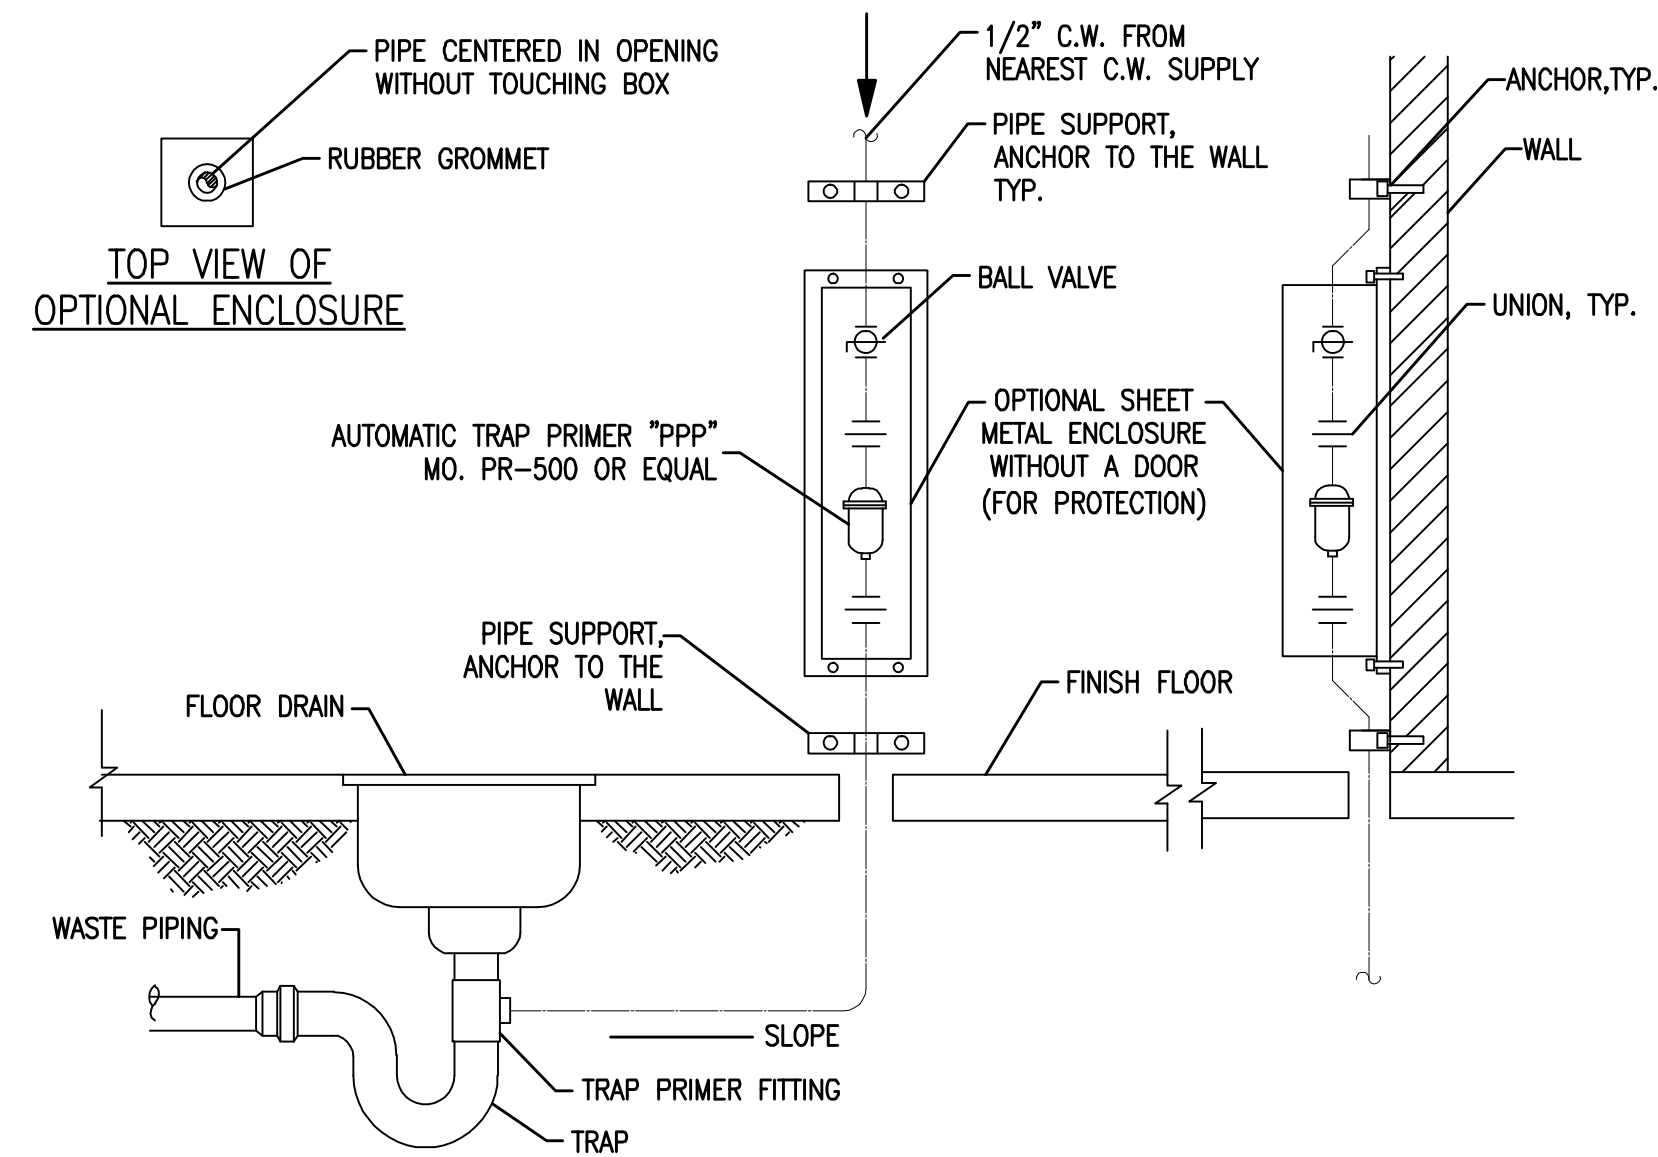


TRAP PRIMER DETAIL

SCALE: NONE 4

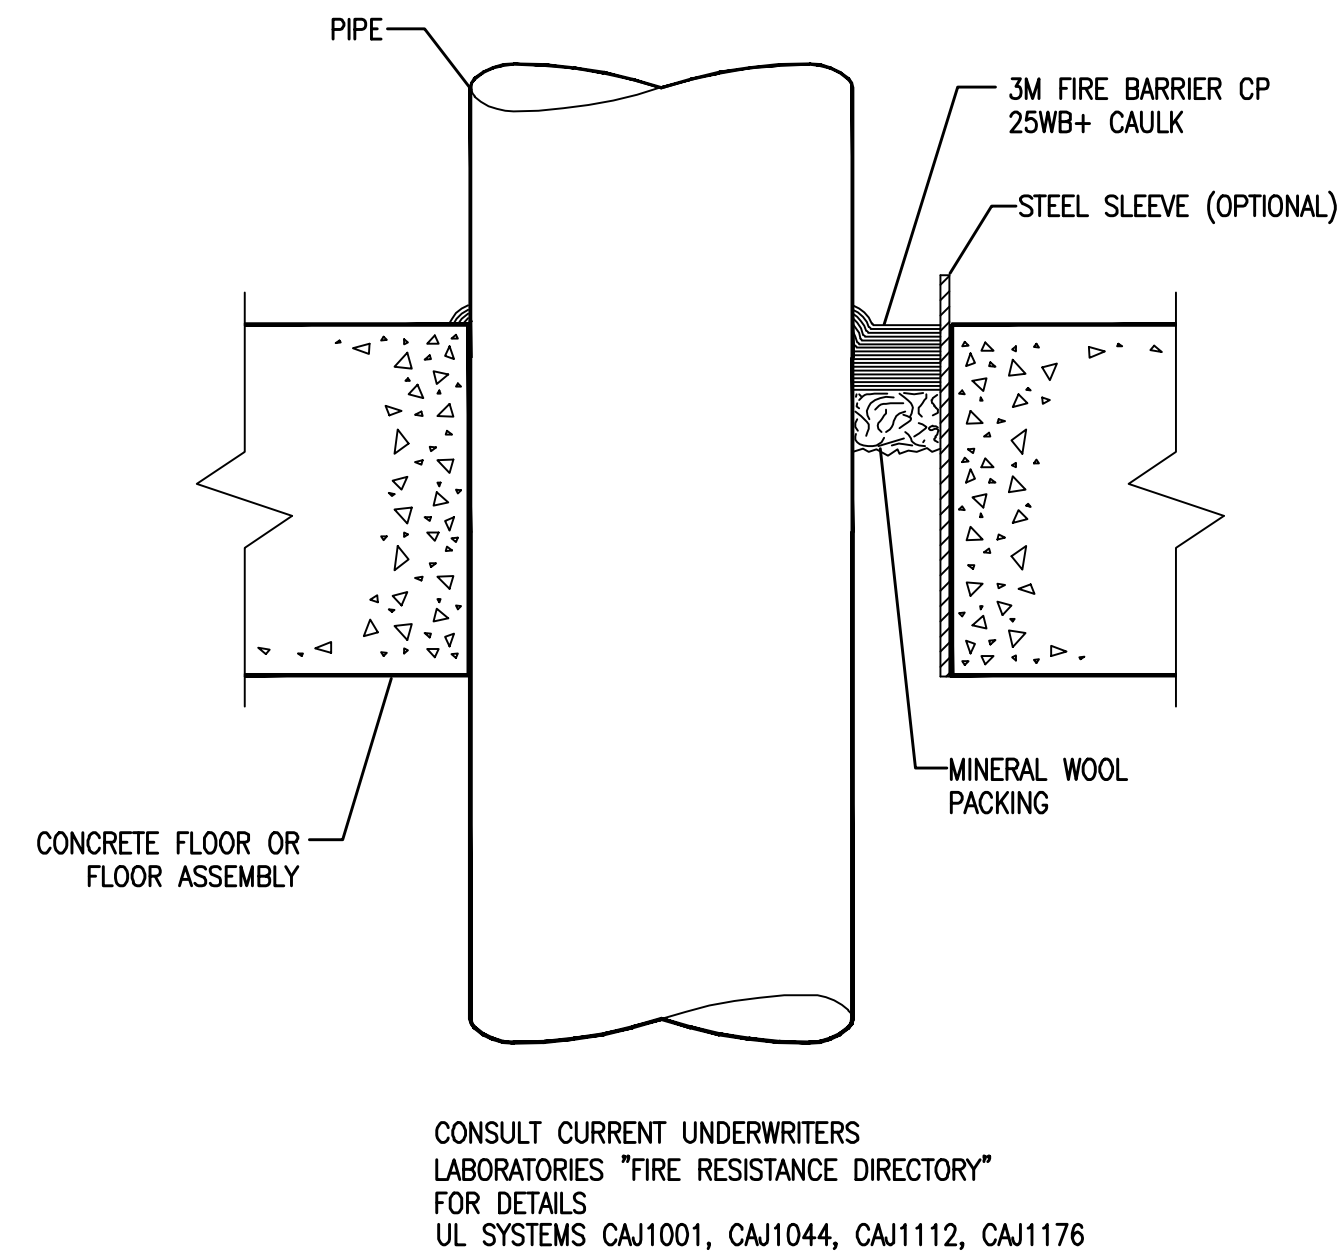


PIPE PENETRATION THRU THE FLOOR DETAIL

SCALE: NONE 5

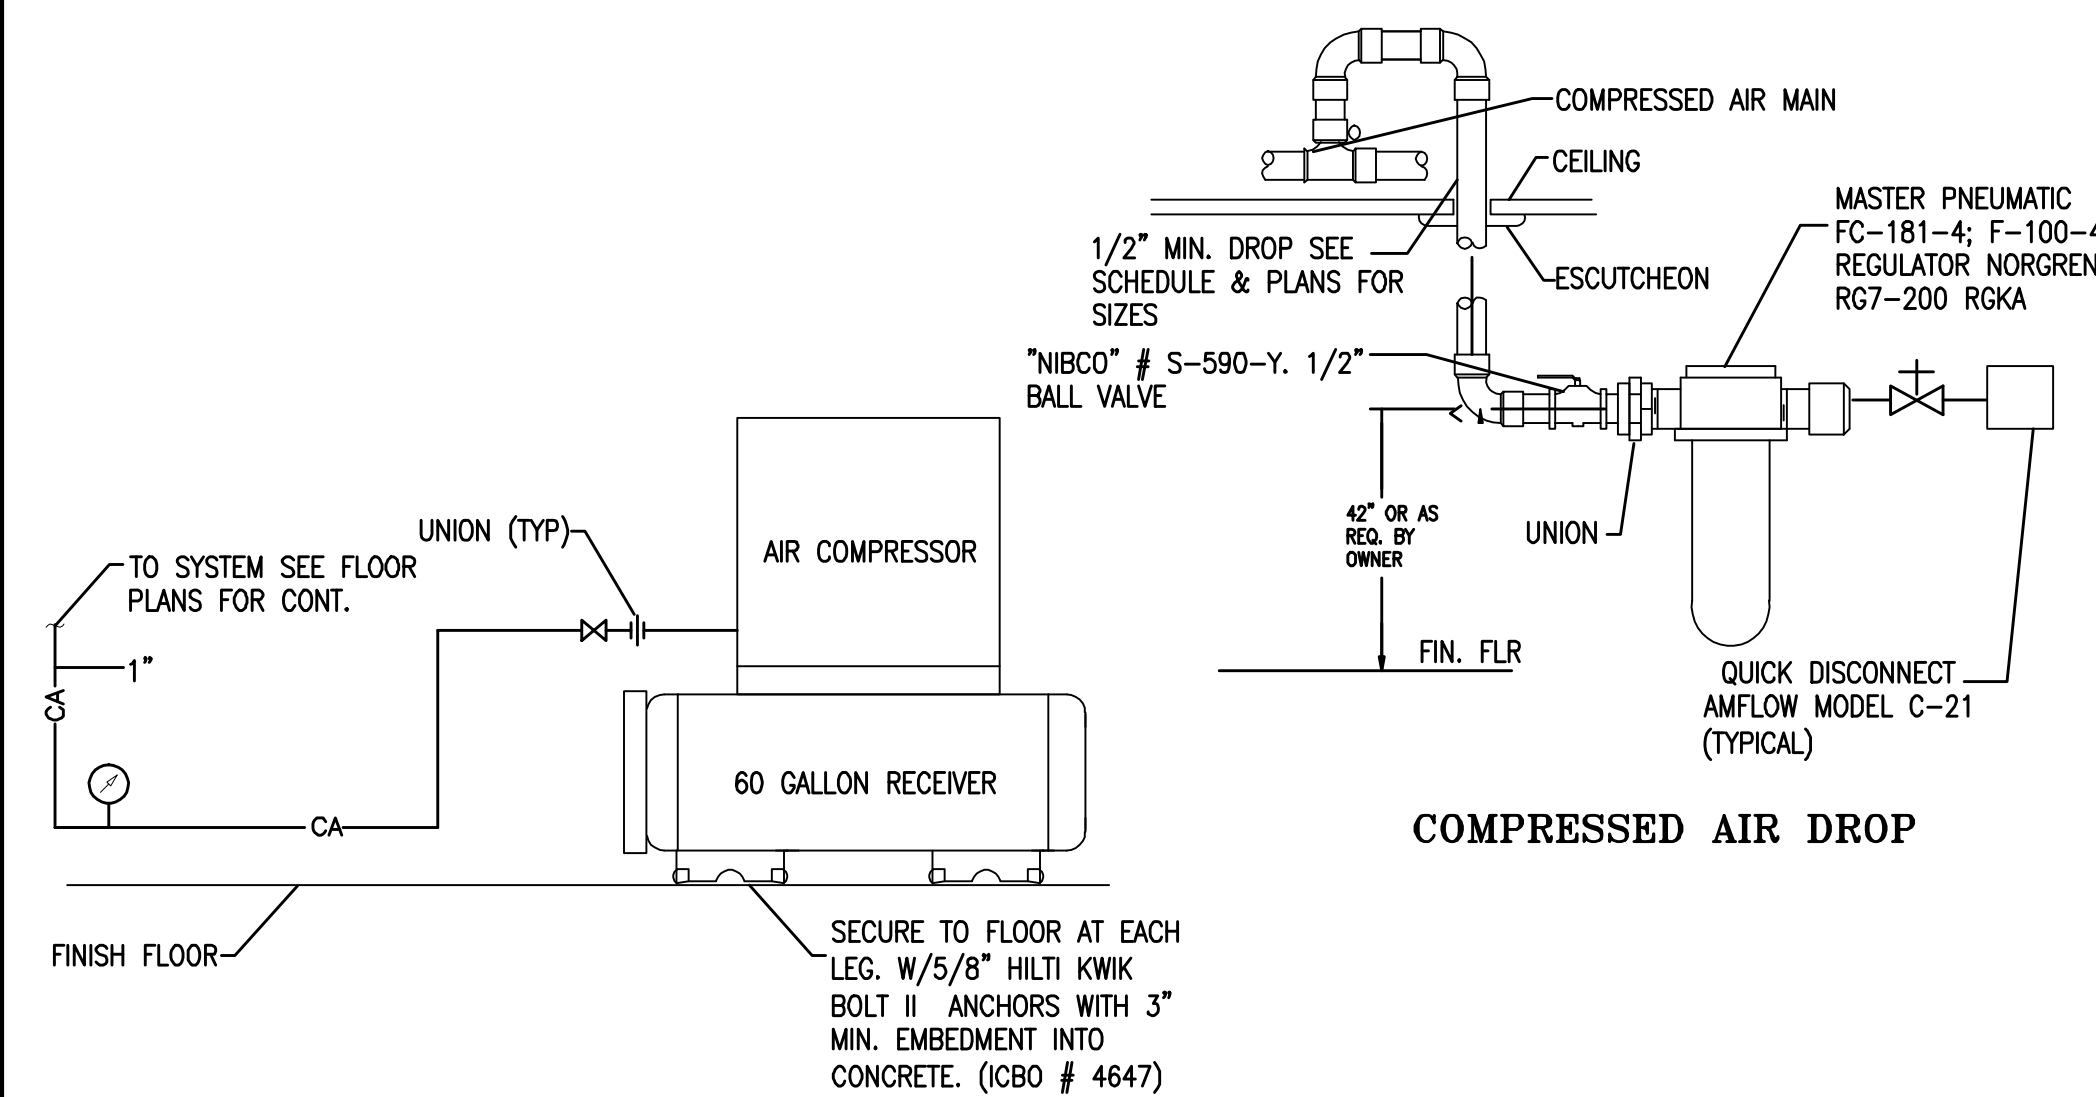


AIR COMPRESSOR DETAIL

SCALE: NONE 6

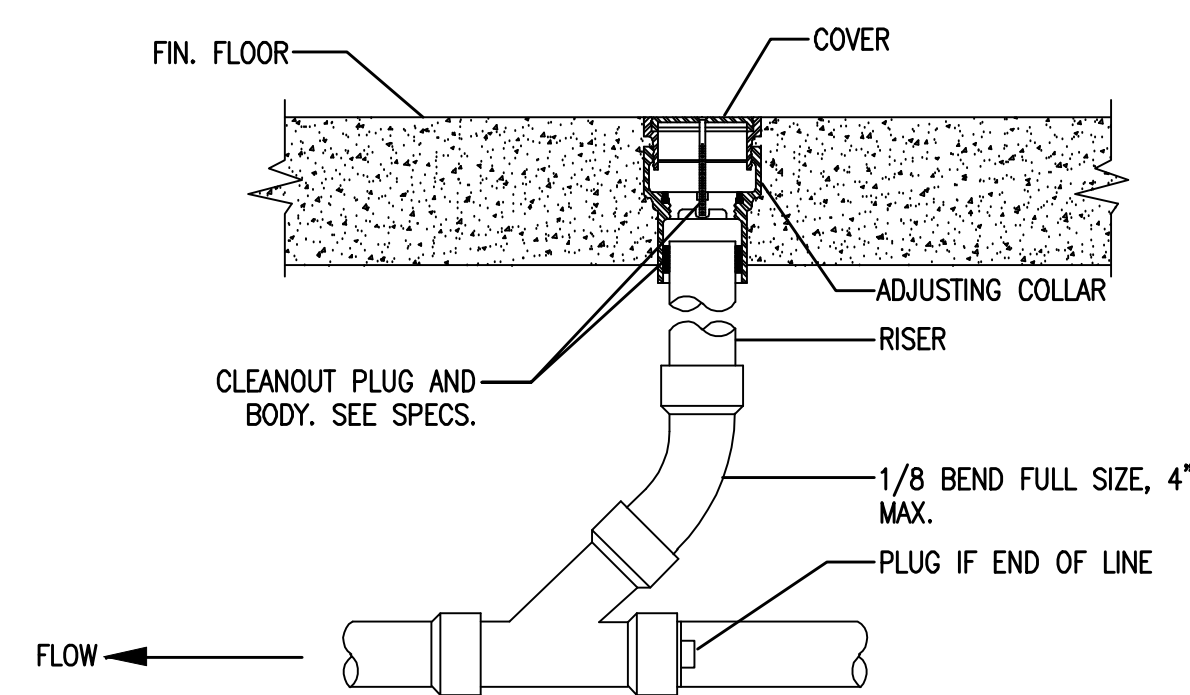

FLOOR CLEANOUT DETAIL

SCALE: NONE 7

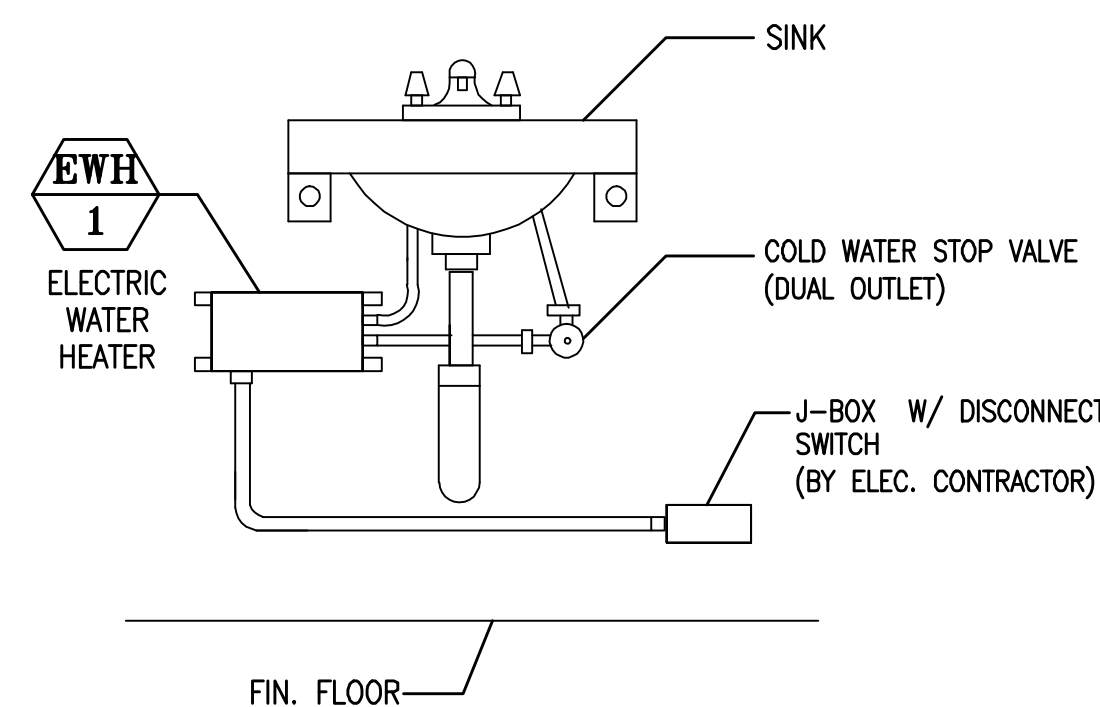


POINT OF USE WATER HEATER DETAIL

SCALE: NONE 8

3115 Linden Street
San Francisco, CA 94102
Tel 415 551 7630
Fax 415 551 7601
www.macyarchitecture.com

**M A C Y
A R C H
I T E C
T U R E**

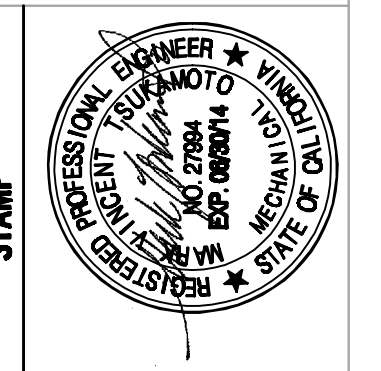


CONSULTANTS
Dozal & Assoc.
26123 Singer Pl.
Stevenson Ranch, CA
91381
T.661.993.3343

PROJECT
**SANTA BARBARA CENTER FOR
ART, SCIENCE & TECHNOLOGY**
515 GARDEN STREET
SANTA BARBARA, CA 93101

ISSUES / REVISIONS

SHEET TITLE
PLUMBING DETAILS
DATE 04/10/14
PHASE ISSUE FOR BID SET
SCALE NONE
FULL SIZE

SHEET
P4.0

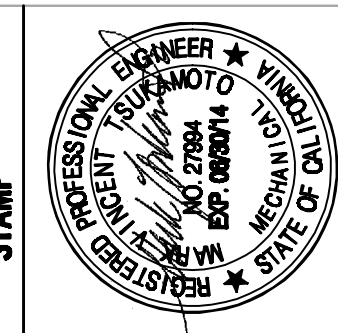

CONSULTANTS
 Dozal & Assoc.
 26123 Singer Pl.
 Stevenson Ranch, CA
 91381
 T.661.993.3343

PROJECT
 SANTA BARBARA CENTER FOR
 ART, SCIENCE & TECHNOLOGY
 515 GARDEN STREET
 SANTA BARBARA, CA 93101


ISSUES / REVISIONS

SHEET TITLE
 RISER DIAGRAMS


DATE 04/10/13
PHASE ISSUE FOR BID
SCALE

SHEET P4.1

FULL SIZE

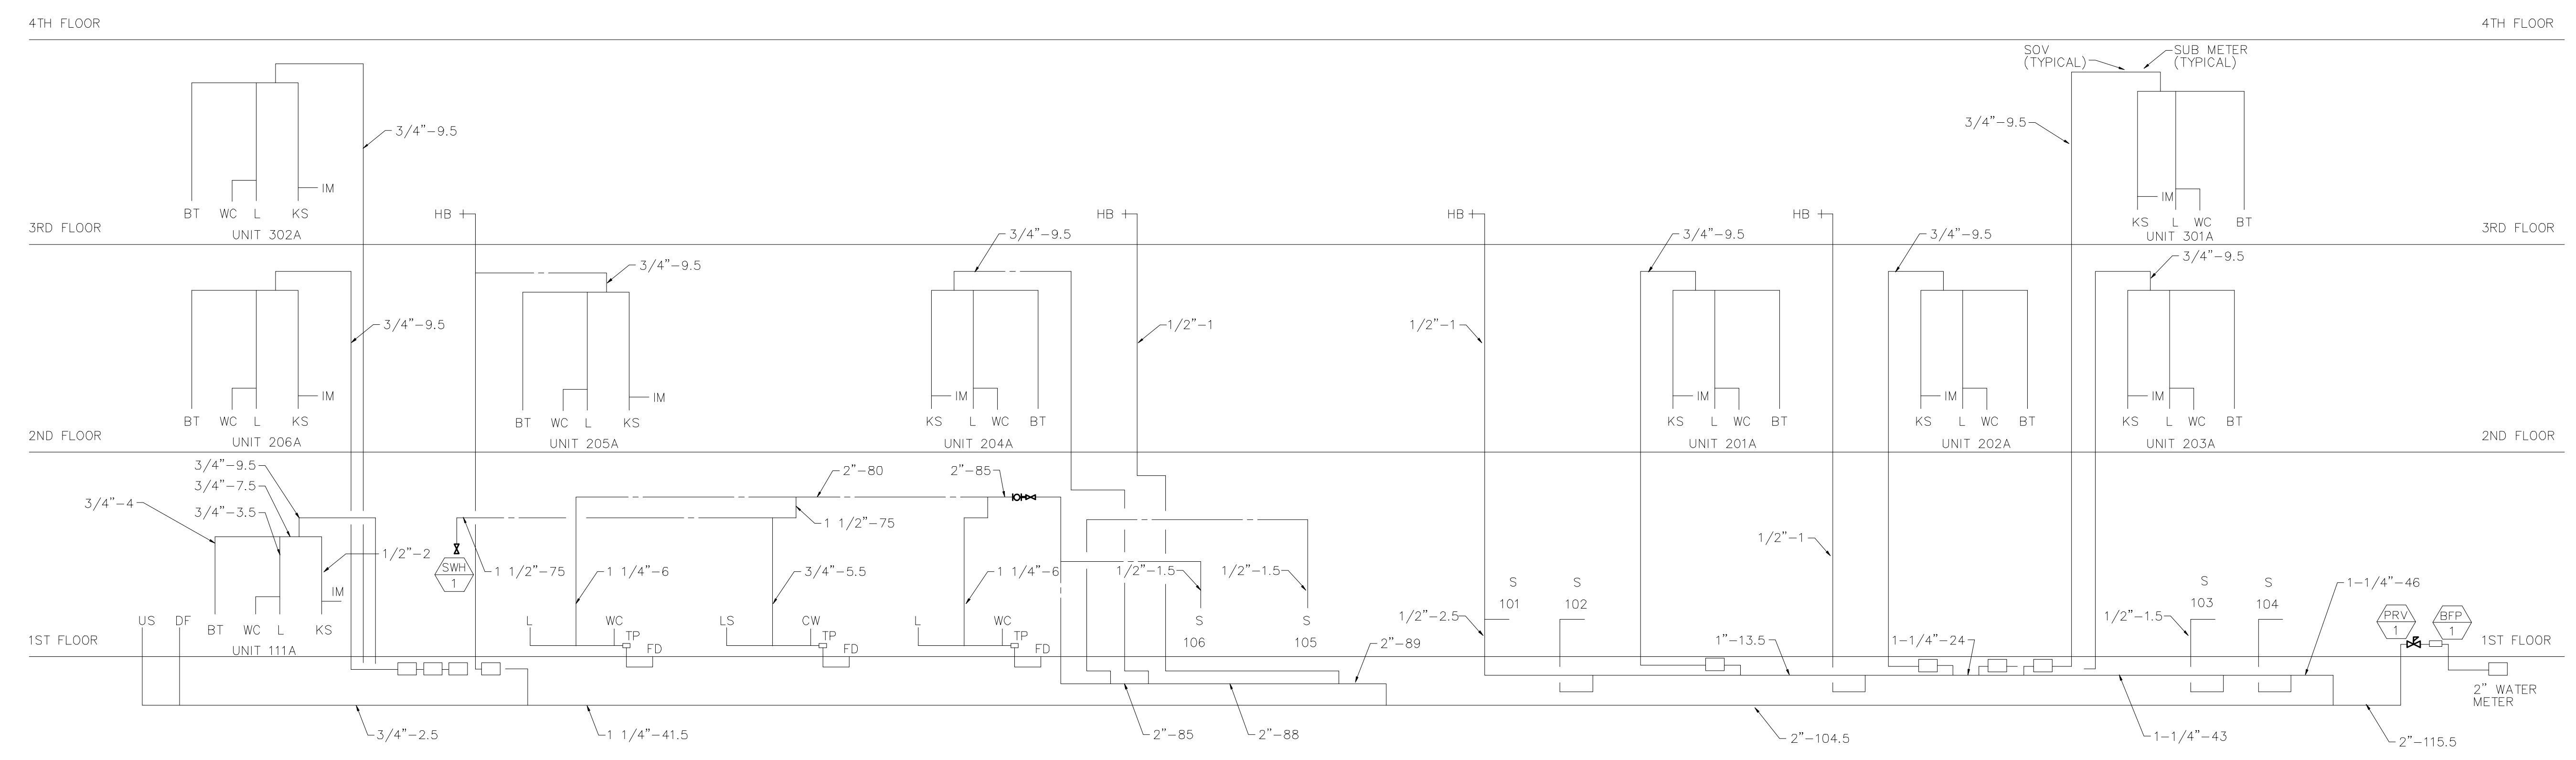

COLD WATER RISER DIAGRAM

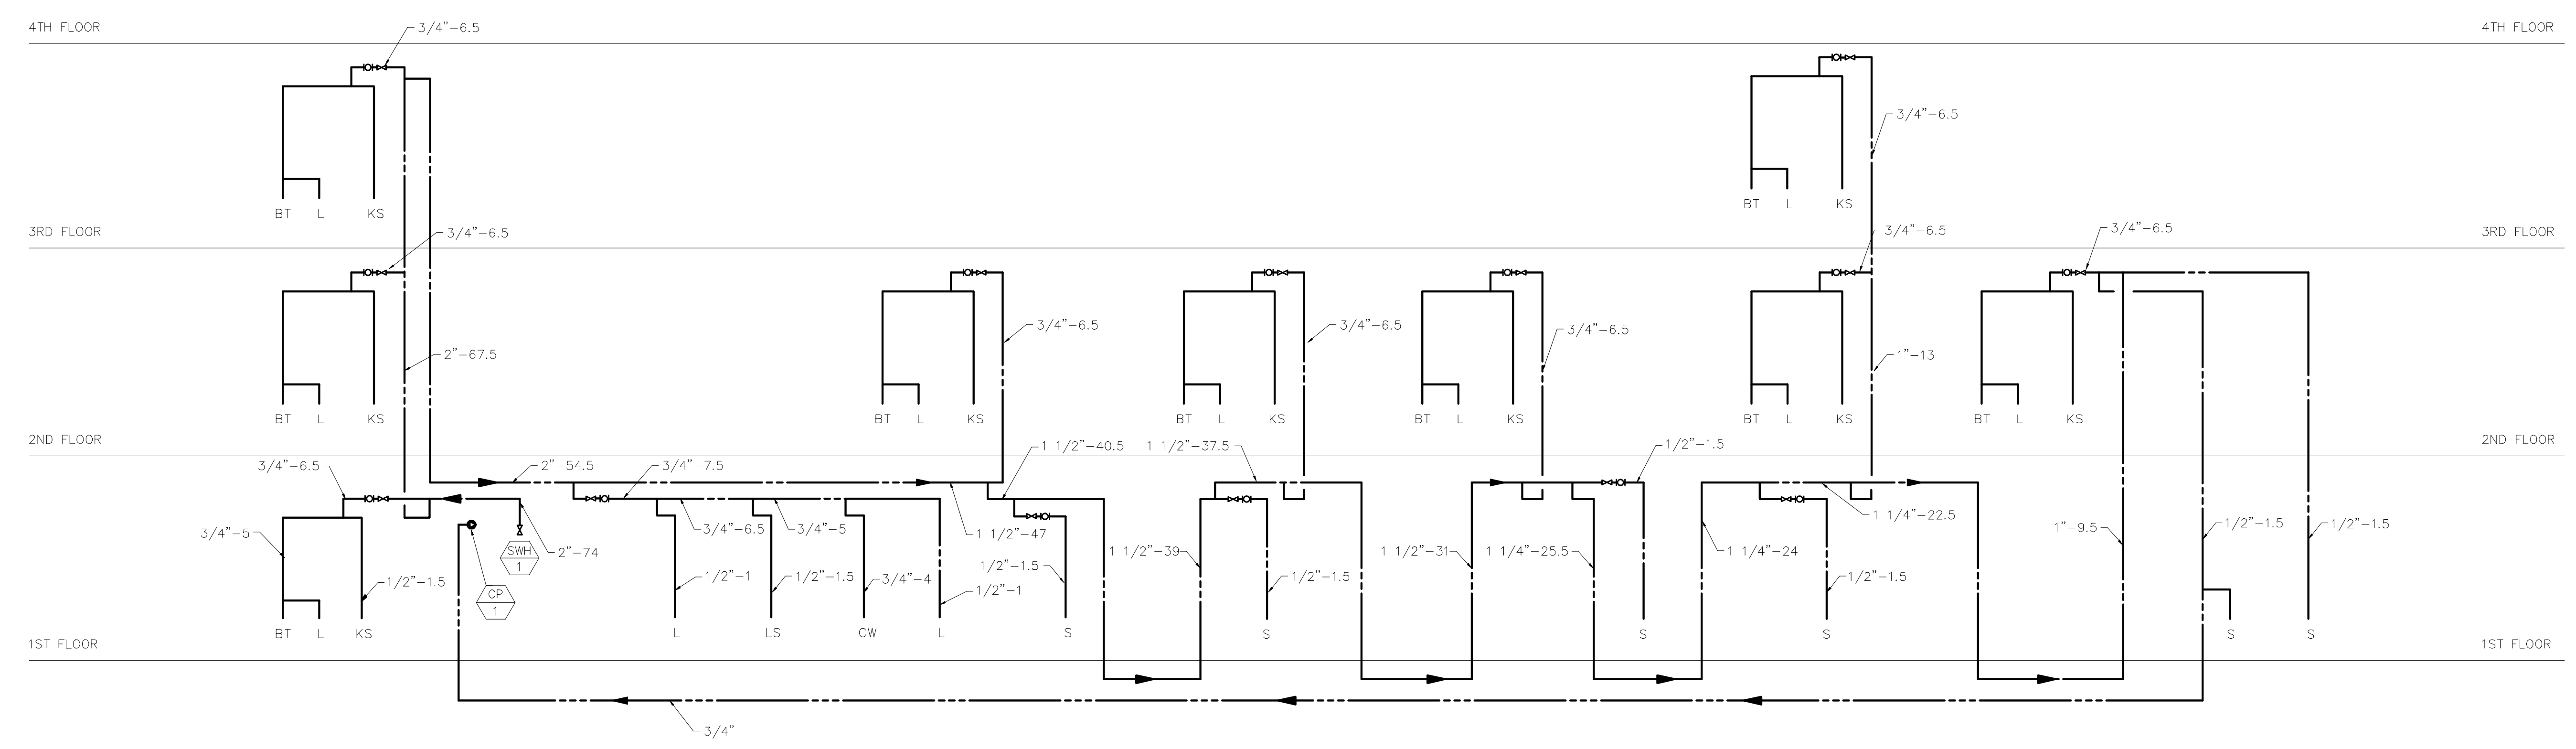

HOT WATER RISER DIAGRAM